

NFPA No.

13E

**FIRE DEPARTMENT OPERATIONS IN
PROPERTIES
PROTECTED
BY SPRINKLER AND STANDPIPE SYSTEMS
1966**



Sixty Cents

Copyright © 1966

**NATIONAL FIRE PROTECTION ASSOCIATION
International**

60 Batterymarch Street, Boston, Mass. 02110

National Fire Protection Association International

Official NFPA Definitions

Adopted Jan. 23, 1964. Where variances to these definitions are found, efforts to eliminate such conflicts are in process.

SHALL is intended to indicate requirements.

SHOULD is intended to indicate recommendations or that which is advised but not required.

APPROVED means acceptable to the authority having jurisdiction. The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of nationally recognized testing laboratories,* i.e., laboratories qualified and equipped to conduct the necessary tests, in a position to determine compliance with appropriate standards for the current production of listed items, and the satisfactory performance of such equipment or materials in actual usage.

*Among the laboratories nationally recognized by the authorities having jurisdiction in the United States and Canada are the Underwriters' Laboratories, Inc., the Factory Mutual Engineering Division, the American Gas Association Laboratories, the Underwriters' Laboratories of Canada, the Canadian Standards Association Testing Laboratories, and the Canadian Gas Association Approvals Division.

LISTED: Equipment or materials included in a list published by a nationally recognized testing laboratory that maintains periodic inspection of production of listed equipment or materials, and whose listing states either that the equipment or material meets nationally recognized standards or has been tested and found suitable for use in a specified manner.

LABELED: Equipment or materials to which has been attached a label of a nationally recognized testing laboratory that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling is indicated compliance with nationally recognized standards or the conduct of tests to determine suitable usage in a specified manner.

AUTHORITY HAVING JURISDICTION: The organization, office or individual responsible for "approving" equipment, an installation, or a procedure.

Units of Measurements

Units of measurements used here are U. S. standard. 1 U. S. gallon = 0.83 Imperial gallons = 3.785 liters. One foot = 0.3048 meters. One inch = 25.40 millimeters. One pound per square inch = 0.06805 atmospheres = 2.307 feet of water. One pound = 453.6 grams.

Copyright and Republishing Rights

This publication is copyrighted © by the National Fire Protection Association. Permission is granted to republish in full the material herein in laws, ordinances, regulations, administrative orders or similar documents issued by public authorities. All others desiring permission to reproduce this material in whole or in part shall consult the National Fire Protection Association.

Recommendations for
Fire Department Operations in Properties Protected
by Sprinkler and Standpipe Systems

NFPA No. 13E — 1966

The material in this publication is substantially the same as that issued as an informative report, *Fire Department Operations in Protected Properties*, NFPA No. SP1 — 1961. The National Fire Protection Association adopted it in its present form at the Annual Meeting, Chicago, May 17, 1966. This action was taken on recommendation of the Committee on Standpipes and Outside Protection as well as concurrent recommendations of the Committees on Automatic Sprinklers, Fire Department Equipment and Fire Service Training. Except for appropriate updating of references, and the change of name, only one substantive editorial change has been made in the 1961 text. One editorial change was made on recommendation of the Committee on Standpipes and Outside Protection. By this change, one sentence in Section 1045, paragraph (6) reads (the words in italics were added), "Only when the fire is extinguished, *or under control*, should the sprinklers be shut off."

Origin and Development of No. 13E

The NFPA adopted in 1933 an informative brochure, prepared by the Committee on Field Practice, *Use of Automatic Sprinklers by Fire Departments*. This was published as a separate pamphlet and reprinted in 1936. The work formerly carried on by the Committee on Field Practice was distributed to a number of new committees in 1938 and at that time the Committee on Standpipes and Outside Protection was given responsibility for this brochure. A subcommittee of the Committees on Standpipes and Outside Protection, Automatic Sprinklers, Fire Department Equipment and Fire Service Training prepared a revision, *Fire Department Operations in Protected Properties*, which, on recommendation of the four committees, was adopted as an informative report at the NFPA Annual Meeting, Detroit, May 16, 1961. The informative report was published and circulated as a separate pamphlet No. SP1 — 1961, but was not included in the annual volumes of the National Fire Codes.

Committee on Standpipes and Outside Protection

Kenneth J. Carl, *Chairman*

American Insurance Association, 85 John St., New York, N. Y. 10038

- S. Auck** (SFPE), Underwriters' Laboratories, Inc.
- Allen S. Dimoff** (SFPE), **Richard H. Erbe**, *alternate*, Fire Insurance Rating Bureau, Milwaukee, Wisconsin.
- Douglas C. Doody** (SFPE), American Mutual Insurance Alliance.
- Robert Ely** (SFPE), Battalion Chief, San Diego, California Fire Chiefs' Assn.
- E. E. Hinderer**, Caterpillar Tractor Co. (Personal).
- R. H. Jensen** (SFPE), Illinois Institute of Technology.
- W. P. Kliment**, Manufacturers' Standardization Society of the Valve and Fittings Industry.
- I. L. Lamar**, South-Eastern Underwriters' Assn.
- C. T. Mallory**, Plainfield, N. J. (Personal).
- Richard Martineau**, National Automatic Sprinkler and Fire Control Assn.
- Edward P. McAniff**, former Chief, Fire Dept., New York, Bayside, N. Y. (Personal), **James G. O'Hanlon**, Deputy Chief, Fire Dept., New York, *alternate*.
- A. J. Mercurio**, Factory Insurance Assn., Hartford, **W. J. Swingler**, Factory Insurance Assn., Chicago, *alternate*.
- Wallace T. Miller**, Cast Iron Pipe Research Assn.
- Richard T. Montgomery**, U. S. National Park Service.
- James W. Nolan** (SFPE), Chicago (Personal).
- C. F. Reininger**, Standpipe Equipment Manufacturers' Assn.
- W. A. Roessler** (SFPE), **Charles E. Nichols**, *alternate*, Assn. of Mill and Elevator Mutual Insurance Cos.
- J. S. Slicer, Jr.** (SFPE), Factory Mutual Engineering Div.
- H. W. Stainsby**, Underwriters' Laboratories of Canada.
- J. R. Welshman**, National Automatic Sprinkler and Fire Control Assn.
- J. Milton Wright** (SFPE), American Reciprocal Insurers.

**Recommendations for
Fire Department Operations in Properties Protected
by Sprinkler and Standpipe Systems**

NFPA No. 13E — 1966

CONTENTS

	<i>Page No.</i>
Introduction	4
ARTICLE 100. Automatic Sprinkler Systems	5
1010. General	5
1020. Inspection and Pre-Fire Planning	5
1030. Water Supply for Fire Fighting	11
1040. Fire Ground Operations in Sprinklered Properties	12
1050. Restoring Protection	19
1060. After the Fire	20
ARTICLE 200. Outside Sprinklers for Protection Against Exposure Fires	21
2010. General	21
2020. Pre-Fire Planning	22
2030. Water Supply for Fire Fighting	22
2040. Fire Ground Operations Involving Outside Sprinklers	23
ARTICLE 300. Properties Protected by Standpipe Systems	24
3010. General	24
3020. Inspection and Pre-Fire Planning	25
3030. Water Supply for Fire Fighting	27
3040. Fire Ground Operations Involving Standpipe Systems	29

**Recommendations for
Fire Department Operations in Properties Protected
by Sprinkler and Standpipe Systems**

NFPA No. 13E — 1966

INTRODUCTION

Many properties have private fire protection equipment provided both to protect lives and preserve property values. Such protection includes sprinkler systems and standpipe systems. Each year fire departments respond to thousands of alarms in properties having such protection. These properties are located not only in areas protected by paid departments but also in areas protected by call and volunteer departments. If the private protection equipment is to do the job for which it is designed, it is essential that fire departments:

(1) Make plans for operations in properties so protected. This calls for inspection by responsible fire department personnel and what is termed in the fire service, "pre-fire planning," including consultation and cooperation with the property emergency fire organization.

(2) Develop standard procedures for operating at fires in protected properties so that the private fire protection facilities will be used to maximum efficiency.

The purpose of this text is to cover three types of private fire protection equipment as follows:

Article 100 suggests procedures for fire department operations in properties protected by automatic sprinklers;

Article 200 suggests procedures for fire department operations at properties having outside sprinkler systems for exposure protection;

Article 300 suggests procedures for fire department operations in buildings having standpipe systems.

ARTICLE 100. AUTOMATIC SPRINKLER SYSTEMS

1010. General

1011. Complete details on the installation of all approved types of sprinkler systems and the care and maintenance of sprinkler systems are covered by the following: Standard for Installation of Sprinkler Systems, NFPA No. 13, and Care and Maintenance of Sprinkler Systems, NFPA No. 13A.

1012. The National Fire Protection Association records of about 100,000 fires over a 65-year period show that automatic sprinkler protection is over 96 per cent effective. The small percentage of fires in which operation of automatic sprinklers is unsatisfactory is responsible for a large percentage of the losses in sprinklered properties.

1013. There are two principal causes of unsatisfactory sprinkler performance: closed valve in water supply line and inadequate water delivered to the sprinkler system. Unsatisfactory sprinkler performance from these causes can be reduced by intelligent fire department planning and operations, if the fire department is called soon enough. Every fire department training program should include a course on the fundamentals of sprinkler systems.

1014. Automatic sprinkler protection is designed to put water on a fire automatically without waiting for human operation. If the automatic sprinkler system should not completely extinguish the fire, it can ordinarily be depended upon to hold a fire in check at the point of origin and give an alarm so that proper measures may be taken to complete extinguishment.

1020. Inspection and Pre-Fire Planning

1021. Success of fire department operations at fires in properties protected by automatic sprinklers will generally reflect the adequacy of the fire department inspections and plans made in advance of an emergency. Unless the fire department officers, who will be in direct charge of operations at a particular property, are fully familiar with plant layout, general occupancy hazards and processes, and the nature and operation of private fire protection equipment, unnecessarily large losses may be expected.

1022. In properties protected by automatic sprinklers fire officers including the chief of the district and officers assigned to first due companies should know:

(1) The buildings and nature of occupancies protected by automatic sprinklers, the extent of this protection, and the type of sprinkler systems;

(2) The water supply to the sprinklers including the source and type of supply, the volume and pressure normally available;

(3) The location of all sprinkler control valves, what each valve controls, and the consequence of shutting off any valve;

(4) The location of fire department connections to sprinkler systems, the specific area each connection serves, and the water supply, hose and pumper layout that will be used to feed the sprinkler connections.

1023. In pre-fire planning of operations in sprinklered buildings, perhaps the most important step is preparation of a sketch of the sprinkler water supply system. This should be prepared by the fire department officers who will be concerned with operations at actual fires. In order to be fully familiar with the sprinkler system, it is very important that the officers making these sketches for fire department operations study the actual water supply piping to the sprinklers from the source to the sprinkler risers, noting on the sketch all controlling valves with indication as to the type of valve and what each controls. Water supply may be from city mains, plant fire pump, gravity tank or pressure tank, or a combination of these.

1024. Where supply is from a fire pump it is important to note the source of suction, the type of power for the pump and arrangement for starting the pump.

NOTE: See Standard for the Installation of Centrifugal Fire Pumps, NFPA No. 20.

1025. For all types of water supplies, it is important that the fire flow and pressure available be determined by appropriate flow tests. Where the water supplying the sprinklers is limited it should be obvious that diversion of water to large hose streams (approximately 250 gpm each) may make the sprinklers ineffective. By studying the water supply connections and piping, fire department personnel will realize that the sprinkler system automatically delivers the water directly to every potential fire area with the maximum efficiency.

1026. In many cases the organization carrying fire insurance on a sprinklered property has the information needed to prepare the fire department sketches. Such information may be available through the property owner. In some instances the fire department inspectors may find that the plant engineer or other plant official has available detailed plans or information on the

sprinkler layout; however, experience has shown that often such plans are not up to date and may be inaccurate. By making their own sketches, the fire department will not only have up-to-date information but will be familiar with the layout of the plant's fire protection. Also, on many occasions inspectors have found closed valves or otherwise impaired protection that could only be located by regular inspections.

NOTE: Fig. 101 is a suggested form which may be useful to fire departments inspecting sprinklered properties.

FIG. 101. SUGGESTED INSPECTION FORM FOR SPRINKLERED PROPERTIES

Name of Plant..... Fire Inspection District No.....
 Location Fire Alarm Code No.....
 Description of Property.....
 Plant Official Responsible for Sprinklers.....
 Phone.....
 Type of Automatic Sprinkler System (Wet, Dry, Deluge, etc.).....
 No. Sprinkler Heads..... Size of Connection to Main.....
 Spare Sprinkler Heads Available..... Stored.....
 Automatic Sprinkler Valves:
 Location..... Type..... Controlling.....
 Cold Weather Valve.....
 Water Supplies to Sprinklers:
 Public Main....., Gravity Tank..... Pressure Tank.....
 Private Fire Pump....., Volume in Storage.....
 Static Pressure.....psi.gpm Available at Residual Pressure
 Post Indicator Valve Location.....
 Fire Department Connections:
 Location.....
 Company Assigned to Pump Into Sprinkler on First Alarm.....
 Hydrant to be Used (normal procedure).....
 Supplemental Pumper Supply Available.....
 Sprinkler Alarm Devices:
 Local Waterflow..... Master Alarm Box.....
 Central Station..... Other.....
 Supervised by.....
 Watchman Service:
 Remarks: Include any pertinent special information that may affect fire department operations.....

 Inspected by..... Approved by..... Date.....

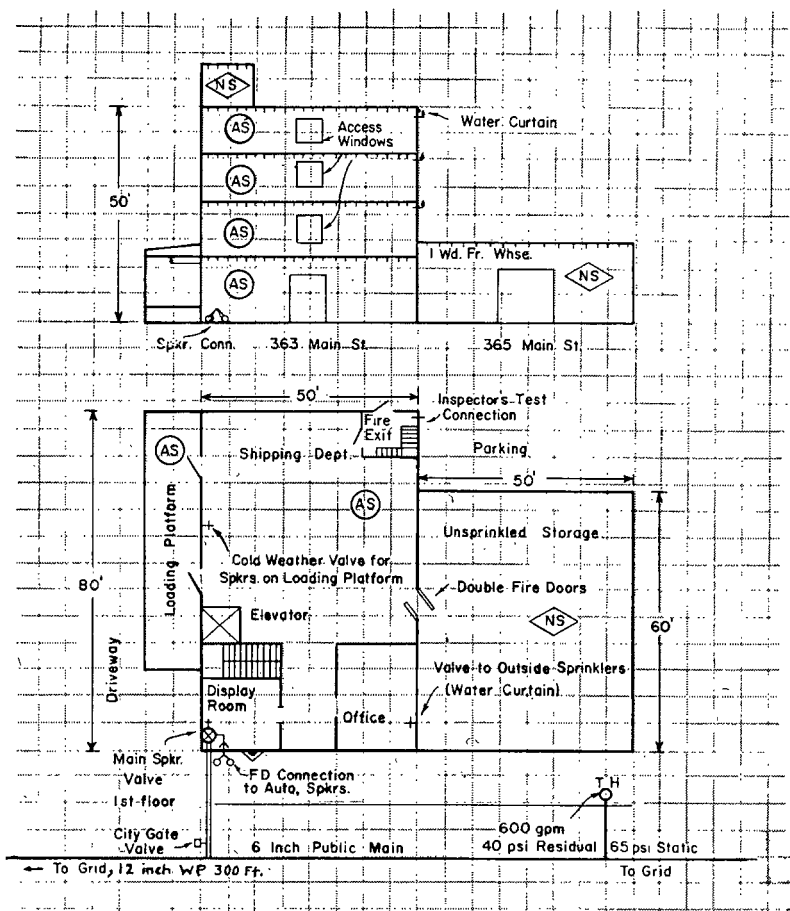


Fig. 102. Typical quick sketch by a fire inspector of an industrial property. Notes which he might make concerning water supply, pre-fire planning and fire ground operations are shown on the opposite page.

Notes:

363 Main St., 4 story, brick-joist, protected by wet pipe sprinkler system supplied by 6-inch public water main. FD connection on front of building. Main control valve in display room front end of 1st floor (left side). Valve for manual operation of water curtain in office on 1st floor (right side of entrance). Cold weather valve for sprinklers on loading platform in shipping room between doors. Inspector's test connection at right hand rear of shipping room on 1st floor. In event of fire in unsprinklered section: Make certain fire doors are closed. Operate water curtain. Place charged hose line to cover fire door opening. Pump into fire department connection.

Pre-Fire Planning:

Notes on FD operation at 363 Main St. Main Building — 4 story brick; 50 x 80; wood-joisted floors; protected by wet pipe automatic sprinkler system supplied by 6-inch public water main. FD sprinkler connection at left side of front wall. Nearest hydrant 70 feet from front door and 90 feet from sprinkler connection. (Note: In the event the fire is in unsprinklered wood-frame warehouse, it might not be possible to connect pumper directly to this hydrant. Main sprinkler control valve is in display room at right of main entrance on 1st floor. Inspector's test connection is in rear fire exit tower. Automatic sprinklers on loading platform are controlled by cold weather valve between doors on left-hand side of shipping department. Valve controlling outside (manually operated) water curtain is located in office at right-hand side of main entrance.

Special procedure in event of fire in unsprinklered warehouse at 365 Main St.

1. Operate valve controlling water curtain on main building.
2. Check to see that fire doors are closed between buildings.
3. Pump into fire department sprinkler connection in main building. (Do not use hydrant in front of fire for this purpose.)
4. Run charged line to guard fire door openings into main building.
5. Make certain that all windows are closed through which smoke or fire could enter main plant.

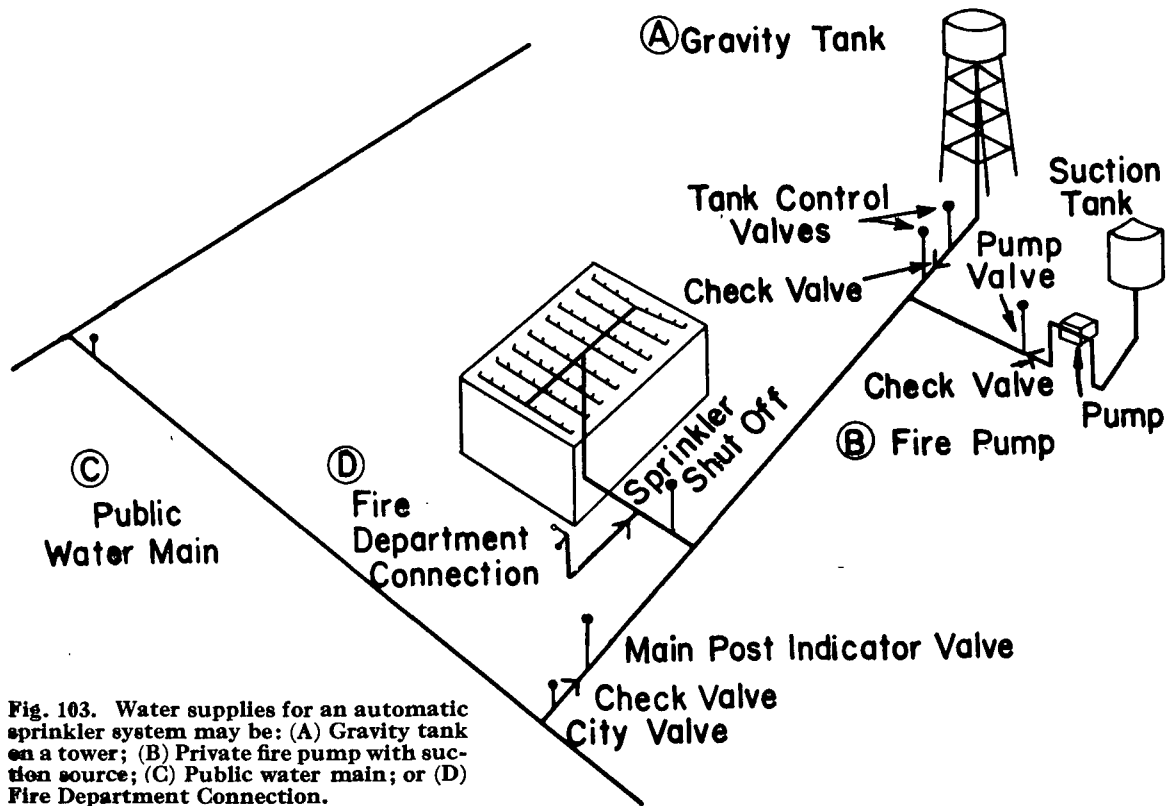


Fig. 103. Water supplies for an automatic sprinkler system may be: (A) Gravity tank on a tower; (B) Private fire pump with suction source; (C) Public water main; or (D) Fire Department Connection.

1030. Water Supply for Fire Fighting

1031. The effectiveness of automatic sprinkler protection, like most other fire fighting operations, depends in large measure upon the adequacy of the water supply. Sprinklers put water on fires faster and with greater effect than manually applied hose streams and thus are generally the most effective means of getting water on a fire. From the fire department's point of view it is like having lines laid and spray nozzles placed in advance, always ready in case of fire.

1032. In fighting fires in sprinklered buildings, it is important to make certain the sprinklers get plenty of water at good pressure. This means that the pre-fire planning must be concerned with sources of water supply and where pumpers will be located. Each situation must be worked out on its own merits. However, the fire department should avoid competing with the sprinklers for water supply for hose streams. The water for hose streams should not come from mains supplying sprinklers unless the mains are known to have sufficient capacity and pressure for both sprinklers and hose streams. Otherwise, as shown in Fig. 105, water for hose streams should come from another water main or from a pumper at draft. It is generally considered poor practice to attach pumpers to hydrants on private water systems.

1033. Contrariwise, it is generally good practice to pump promptly into private water mains supplying sprinklers to boost the flow normally available. Some private water systems have fire department siamese connections at the property line near public hydrants. In some instances, instead of a siamese a "reverse hydrant" is installed so that lines from a pumper at the city hydrant can pump into the private hydrant. The reverse hydrant has swivel connections on the 2½-inch hose connections rather than the usual male outlets. A regular private hydrant may be used for the same purpose by attaching double female connections to several outlets. Where fire protection equipment has different threads from the local fire department hose thread, this fact should be determined by the inspector and suitable adapters provided. The pre-fire planning and routine inspection should make certain that access to the private fire protection supply connections is not blocked by yard storage, security fences, railroad sidings or other obstructions that could delay connection of fire department supply lines. In some cases it has been found necessary to obtain the cooperation of plant management in relocating or extending the fire department con-

nections to a more convenient location. Periodic inspections of piping between the fire department siamese and the check valve are recommended, using a hydrostatic test where necessary.

1040. Fire Ground Operations in Sprinklered Properties

1041. It is most important that each fire department responding to properties having automatic sprinkler protection have standard operating procedures developed for handling fires in sprinklered buildings. It is the duty of the officer in charge at the fire to see that these procedures are carried out as promptly and efficiently as possible. For the best results the standard operating procedures should be in the nature of guide lines or general good practice and not hard and fast rules which rob the fire ground commander of responsibility and initiative.

1042. When responding to a fire in a sprinklered property it is important that fire fighting operations be based upon a thorough knowledge of the property resulting from prior inspection and "pre-fire planning" (see Section 1020).

1043. On arrival of the first officer, size-up of the fire situation is the first prerequisite of good operation. A fire fighter should be sent immediately to see that control valves are fully opened. Pumper lines should always be connected to the fire department siamese as quickly as possible to supply adequate volume and pressure to the sprinkler system in the fire area. Additional lines should be stretched to the fire area.

1044. If no fire or smoke is visible, it is likely that the fire is very small and either one or two sprinklers have extinguished the fire or the sprinklers have not yet operated. If an outside water motor gong is operating or the alarm was received as a central or remote station sprinkler waterflow signal, it is evident that water is or has been flowing from sprinklers (or in the case of dry pipe sprinkler systems, has entered the system if the dry pipe valve has tripped prematurely or accidentally). Where steam is visible it is evident that the sprinklers have operated and probably have the fire under control or in check. Prompt action should be taken to complete extinguishment to reduce damage. If black smoke and flame are visible, it may be that sprinklers are not operating or that the supply valve is closed.

1045. The following are good practice suggestions for the guidance of chiefs or officers in charge of fire department operations in sprinklered buildings:

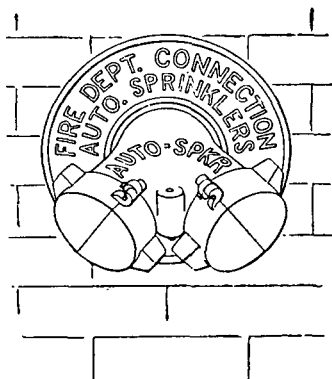


Fig. 104. Typical fire department connection to automatic sprinkler systems showing 2½-inch intakes which would be supplied by lines from one of the first responding pumpers.

(1) Immediately send a fire fighter to the proper control valve to:

(a) Determine that the valve is fully open. (Valves are designed to show open or closed positions.)

(b) Open the valve if it has been closed. (One possible exception would be where valve is "tagged for repairs.")

(c) Shut the valve only when ordered to do so by the officer in charge.

(d) Remain at the valve so that in the event of rekindling or any detected extension of fire, the valve can be reopened immediately.

NOTE: The man assigned to the valve should take a light and portable radio so that no time will be lost in transmitting orders to open or close the valve. He should remain at the valve until orders are given for the companies to make up and return to quarters.

(2) One of the first alarm pumper companies on arriving at the fire should immediately connect two lines to the proper sprinkler siamese connection and start pumping at about 150 pounds per square inch (see Fig. 104). If there is more than one sprinkler system in the fire area, pumpers should be connected to provide adequate pressure and volume to each sprinkler system that may be in operation.

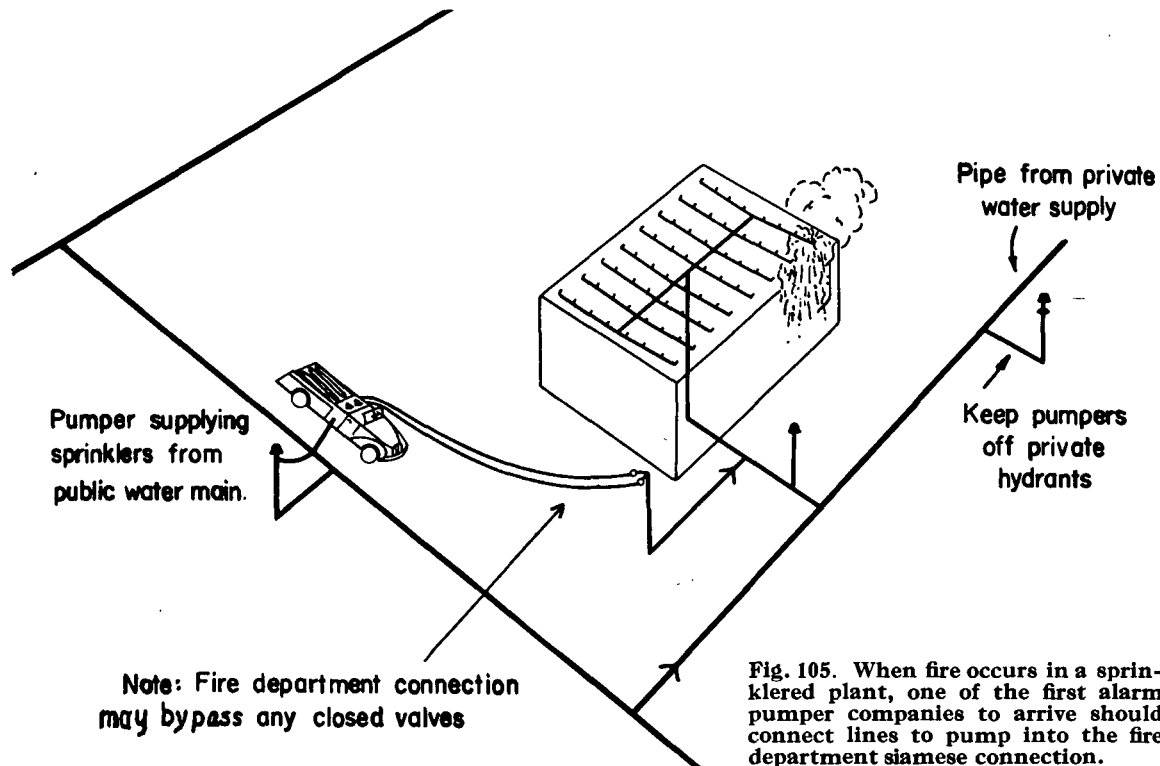


Fig. 105. When fire occurs in a sprinklered plant, one of the first alarm pumper companies to arrive should connect lines to pump into the fire department siamese connection.

NOTE: Pumpers should not be connected to hydrants on private water systems unless such systems are designed to maintain the flow needed by fire department pumpers in addition to that required by sprinklers or other private fire protection facilities. Use of pumpers on private hydrants has on a number of occasions deprived private fire protection facilities, including sprinklers, of their water supply resulting in heavy damage or total losses.

Two 2½-inch pumper lines can effectively supply 20 to 25 sprinkler heads. If 3-inch or other large hose is available, this should be used to take advantage of the available pumper capacity. If it is obvious that a serious fire is in progress, as much water as possible should be pumped into the sprinkler connection. This can be done by connecting a fire department siamese to a line feeding the automatic sprinkler siamese to permit attachment of another line or by increasing pressure at the pump to 175 or 200 pounds per square inch if the hydrant flow and pumper capacity make this possible. (750 gallons-per-minute pumpers are designed to give 525 gallons per minute at 200 pounds per square inch at draft and 1,000 gallons-per-minute pumpers provide 700 gallons per minute at 200 pounds at draft. Higher flows may be obtained from good hydrants.)

The sprinkler siamese on a single sprinkler system is generally on the system side of the main control valve (see Fig. 107). In such cases, the fire department pumper can immediately provide pressure to the system whether the main sprinkler control valve is open or not. In the case, however, of a building protected by more than one sprinkler system, the fire department connection is usually located at a point between the gate valve controlling the water supply and the gate valves controlling the individual systems. Therefore, closure of a gate valve controlling one of the individual systems would deprive that particular system of the use of the fire department connection. Gate valves are not permitted to be installed in the direct line from the fire department connection.

(3) An officer should immediately be ordered to the fire area to determine the location and extent of fire. He will determine whether sprinklers have extinguished the fire or are holding the fire under control. He will check for any possible extension of fire both horizontally or vertically including concealed spaces. He should have a portable radio so that he can immediately report to the officer in charge. Where there are sectional or floor valves he should make certain that these are open. In such cases when the fire is extinguished, sprinklers may be shut off at the sectional or floor valve without shutting off the entire system.

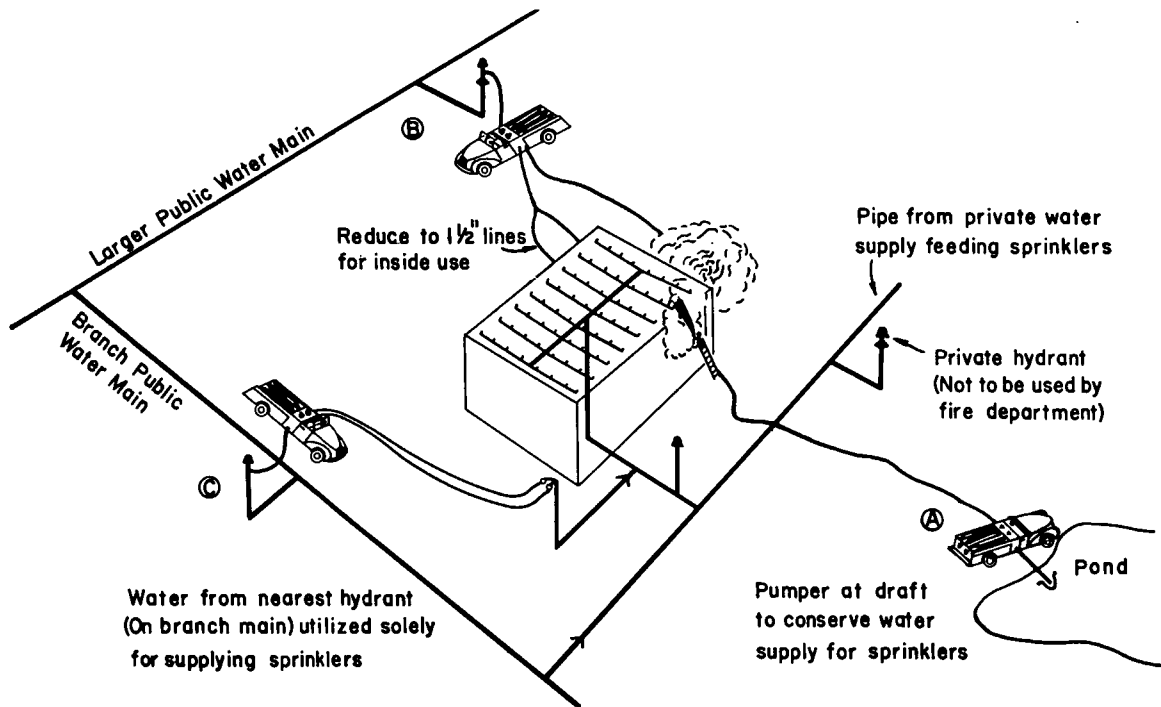


Fig. 106. Where hose streams must be used, water must be taken from sources that do not reduce the sprinkler protection. Pumpers should be supplied either by: (A) Drafting from static sources; (B) Connecting to water mains not needed for sprinkler supply; (C) Connecting to large mains which flow tests have indicated are adequate to supply both sprinklers and the required hose streams.

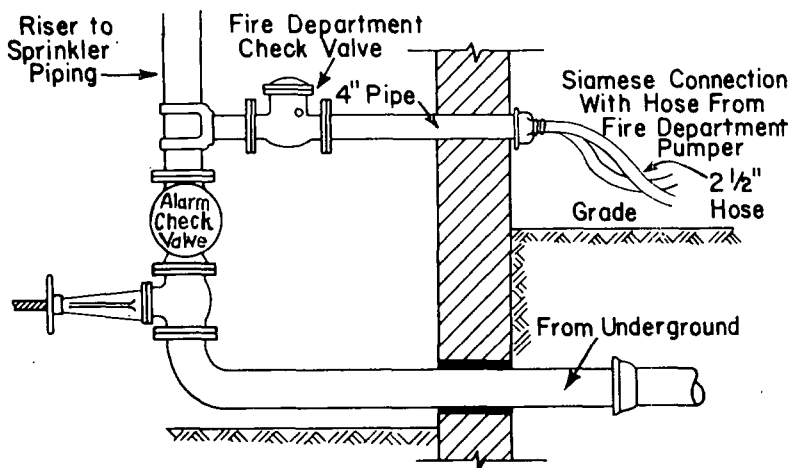


Fig. 107. The fire department siamese connection is generally arranged so that water can be pumped to the sprinklers even though the main sprinkler control valve and sprinkler shut-off valve happen to be closed. Also, the use of the fire department pump makes it possible to provide better pressures for the sprinklers than is normally available from a gravity tank or city main.

The inspection records should indicate the location of such valves. In all cases, the officer in charge must use good judgment before he orders any sprinkler system valve to be closed.

(4) As quickly as possible and before any sprinkler valve is closed, hose lines should be used to prevent any extension of fire and to complete extinguishment. In general, $1\frac{1}{2}$ -inch hose with combination spray nozzles can be used for this purpose. These lines are not only more efficient for interior fire fighting but discharge 50 to 100 gallons per minute as compared with 200 to 250 gallons per minute from $2\frac{1}{2}$ -inch lines. The smaller lines thus divert less of the available water from the sprinkler system and reduce water damage. As a general rule, it is much more effective to distribute water through the sprinkler system. Hose streams will be required to merely mop up and extinguish fire in concealed spaces out of reach of sprinklers. Where the fire area is on upper floors or otherwise remote from the fire department apparatus it may be desirable to also use standpipe equipment as discussed elsewhere in this text. In advancing and operating hose streams in sprinklered areas, it is good practice to make use

of *self-contained* breathing apparatus so that advance into the fire area will not be delayed by smoke, heat and steam. From a fire fighter's point of view, the effect of the sprinklers may be compared with the well-known effect of spray nozzles.

(5) The ladder company, squad company, or other unit performing "truck" duties should be ordered to ventilate the fire area as needed in order that there be no delay in advancing hose lines to complete extinguishment. Windows should be opened promptly in the fire area. Smoke removal fans should be used as necessary. If a serious fire is found to be in progress, full fire department ventilation procedures including opening of skylights and roofs may be indicated provided that charged hose lines are available to immediately attack the fire.

(6) Often it will be found that the sprinklers have practically extinguished the fire or have it under control. Sometimes the sprinkler discharge may be driving the heat, steam and smoke toward the floor, making it impossible to enter the immediate area for final extinguishment or overhauling. In such cases when charged hose lines are in place, it is important to provide adequate ventilation. Only when the fire is extinguished, or under control, should the sprinklers be shut off. If there is a sectional or floor valve, this should be closed. However, if the only control is at the main valve, the order should be sent by radio or messenger to the men stationed at this valve. Orders should also be given to the pump operator to shut down the lines connected to the siamese as these by-pass the main valve, and in the absence of a floor valve, water will flow until the pump discharge gates are closed.

Where only a few sprinkler heads are operating, sprinkler tongs or tapered wooden wedges may be used to immediately stop the flow from the opened heads. This use of tongs or wedges keeps the system in operation and is sometimes a faster operation than shutting the control valve (see Fig. 108).

(7) As soon as manpower permits, salvage operations should be started.

NOTE: Salvage techniques are described in the pamphlet on Fire Department Salvage Operations published by the American Insurance Association (formerly National Board of Fire Underwriters), 85 John Street, New York, N. Y. 10038.

(8) When overhauling is completed so that there is no possible danger of rekindling requiring use of sprinklers, the lines from

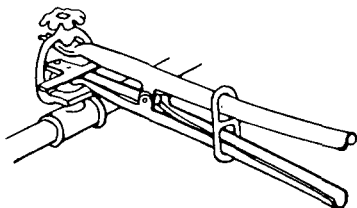


Fig. 108. One variety of sprinkler stop or tongs.

the pumper to the sprinkler system siamese may be ordered disconnected.

Figures 105 and 106 show the proper placement and use of fire department pumps and hose streams at fires in sprinklered properties.

1050. Restoring Protection

1051. When possible, sprinkler protection should be restored by installing new heads of the proper type and rating. Orders should then be given to the man at the valve to turn on the water. If new heads are not immediately available, the sprinkler tongs or wedges may be left in place until the heads are replaced so that protection may be promptly restored. If the temperature is below freezing and adequate heat cannot be maintained, the piping must be drained until heat can be restored or until air pressure is restored to a dry-pipe system and the sprinkler dry valve has been reset. If there is no sight glass to indicate when a system is drained, a man should be directed to check the flow from the drain. Whenever possible, the fire department should not leave the scene until the system has been placed back in operation.

NOTE: Specifications for Motor Fire Apparatus, NFPA No. 19, calls for 12 assorted sprinkler heads, 6 sprinkler stoppers or wedges, and 2 sprinkler head wrenches to be carried on ladder trucks or other apparatus equipped for salvage work. The wrenches must be suitable for servicing the various types of sprinkler heads. The sprinkler heads carried should include standard types for both upright use where piping is exposed and pendent use where piping is concealed. All fire departments, regardless of size and type of organization, whether paid or volunteer, should have available a supply of automatic sprinkler heads for use as replacement after the fire is extinguished. Such supply of sprinkler heads should be of various degree ratings and marked to be readily identifiable as replacements. Mechanical tongs or wedges of hardwood or similar material, if used to stop flow while the system is being shut off and drained, should be replaced immediately with proper sprinklers. (See NFPA Industrial Fire Brigades Training Manual.)

1052. Ordinarily, fire departments do not pump air into a dry-pipe system or reset dry valves or deluge valves. This is the responsibility of the property owner or his sprinkler contractor.

1053. Unless there is a representative of the owner or occupant on the premises, the officer in charge should direct the fire alarm operator to notify the owner or authorized representative that the sprinklers have operated and that protection should be restored. If there is central station supervision of valves, that company should be contacted if a runner has not arrived before the fire department is ready to leave the premises.

NOTE: Where automatic sprinkler protection cannot be restored and no representative of the owner or occupant is present, it is a good practice to leave a fire fighter on the premises as a watchman so that sprinklers can be turned on promptly should a fire rekindle or another fire occur. If any appreciable amount of burning has occurred in the building or stock that might cause rekindling, it is good practice to leave a detail with a watch line until the private protection is restored.

1060. After the Fire

1061. Many large losses have occurred in sprinklered buildings when subsequent fires occurred before sprinkler protection was restored. Protection should be restored, if possible, before the department leaves the scene. If this is not possible, the fire department job at a fire in a sprinklered property is not completed when the apparatus returns to quarters. It is very important to follow up with an inspection to see that normal protection is completely restored.

1062. Each fire department should have a regular method for following up on restoration of automatic sprinkler protection. This may be handled by the fire prevention bureau, by the officers of the fire company in the district where the fire occurred or by the chief of the district. A good practice frequently followed is for the chief in charge at the fire to revisit the property several hours later to follow up on the situation to make certain that protection has been restored. This often provides an opportunity to obtain additional information relative to the circumstances of the fire and make suggestions to the occupants both as to fire prevention and action to be taken in the event of future fires.

1063. It is also very important that the officer in charge include with his fire report essential data regarding the operation of the sprinkler system. This should always include notation of which company connected to the sprinkler siamese and pumped into the sprinkler system and the effect of the sprinkler operation on the fire. Any equipment such as hose streams or extinguishers used in controlling the fire should be noted. If the sprinklers were shut off or not operating properly, this should be reported and the reasons given.

1064. A fire department report of fire in a sprinklered building should include pertinent additional information regarding automatic sprinkler operation such as:

No. of Sprinkler Heads Operating

Location of Heads Operating

Result of Sprinkler Operation

Reason for any Unsatisfactory Operation

What Member of Department was Assigned to Check Control Valve?

Was Valve Closed After Fire?____ Who Ordered Valve Closed?

Is Sprinkler Protection Fully Restored?

By Whom?

Did the Private Water Supply to Sprinklers Operate Satisfactorily?

Was Water Pumped Into System?

Did Fire Department Connect to Sprinkler System?

If Not, Why Not?

Company Connected to Sprinkler System: Engine Number____

Number of Sprinkler Heads Replaced by Fire Department____

Type of Heads Installed____

Was Representative of Management Notified?

1065. Of course, the fire report will also indicate other fire fighting equipment, such as hose streams used on the fire. In addition, a company that has pumped into a sprinkler system should prepare a detailed report including orders received, lines connected to sprinklers, water supply used, pressure maintained, and length of time sprinklers were supplied.

ARTICLE 200. OUTSIDE SPRINKLERS FOR PROTECTION AGAINST EXPOSURE FIRES

2010. General

2011. Many buildings or properties having a severe exposure problem are equipped with outside or external sprinkler systems designed to provide a water curtain capable of shielding the property from fires in other buildings or in storage areas. Most of these systems are designed for manual operation. Some are

thermostatically operated, open-head systems. Some are specially designed sprinkler heads on pipes extending from a wet or dry-pipe sprinkler system inside the building and so placed as to protect window openings.

2012. Sprinkler heads for outside protection are specially designed for water curtain effect and when properly used should prevent an exposure fire from entering the building. Heads having various size orifices are available. Small orifice sprinklers ($\frac{1}{4}$ -inch, $\frac{5}{16}$ -inch, and $\frac{3}{8}$ -inch) are used when windows are narrow or recessed or where the water supply is limited. Large orifice sprinklers are used for more serious hazards where water supply permits. Standard for Installation of Sprinkler Systems, NFPA No. 13, specifies the size of risers and pipes necessary to supply the various sizes of sprinkler heads required.

2020. Pre-Fire Planning

2021. The important things the fire department must know in planning operations in properties having outside sprinklers are the following:

- (1) Is the system automatically or manually operated?
- (2) If the system is automatically operated, where are the control valves used to shut off the sprinklers?
- (3) If the system is manually operated, where are the control valves for turning the system on and off and who is responsible for operation of the valves?
- (4) What water supplies are provided for the outside sprinklers?
- (5) Is there a fire department connection for pumping into the outside sprinklers? (See Fig. 102.)

2030. Water Supply for Fire Fighting

2031. A sketch should be prepared showing the location of the control valves, the fire department supply connections, and the hydrants to be used for pumping into the system. Where there is an exposure fire problem it must be assumed that there may be a major fire which will also require a number of hose streams for manual fire fighting. There may also be standard automatic sprinkler systems in the fire area which must also be supplied with lines from pumps.

2040. Fire Ground Operations Involving Outside Sprinklers

2041. The purpose of outside sprinkler systems is to prevent extension of fires to exposed properties. It is the duty of the officer in charge of the fire to see that these systems are used to fulfill their intended purpose. To do this it is necessary that the officer in charge know of the existence of the system and how it is supplied with water. Next to the saving of life, one of the first responsibilities of the fire department is the protection of exposures. The proper use of outside sprinklers helps the department to carry out this responsibility.

2042. The officer in charge shall ascertain as quickly as possible whether outside sprinklers are operating. If the system is manually operated, a fire fighter should be sent to the valve to open the valve immediately in the event the outside sprinklers are needed. In some cases there will be several valves controlling different exposed parts of the protected buildings and it is important to open the correct valves. Care must be taken to conserve water supply by shutting off the outside sprinklers when they are no longer needed.

2043. The officer in charge should:

- (1) Make certain that sufficient help is called to handle a serious exposure fire.

- (2) Send a man to the proper control valve with orders to turn on the outside sprinklers as necessary.

- (3) Order an engine company to pump into the fire department siamese supplying the outside sprinklers.

- (4) Order men into the exposed buildings on each side to see that all windows are closed and that fire has not extended into the buildings concerned.

- (5) If the exposure is severe, set up fire department lines in the exposed buildings using standpipe facilities if available.

- (6) Send men to the roof to make certain that no part of the roof structure has ignited.

- (7) Begin salvage operations in exposed buildings.

- (8) Order outside sprinklers shut off and drained when no longer needed.

ARTICLE 300. PROPERTIES PROTECTED BY STANDPIPE SYSTEMS

3010. General

3011. Many properties have standpipe systems serving fire hose outlets in various parts of one or more buildings. Standpipe systems of various types may be used by the fire department to place streams in service quickly in areas that cannot be reached conveniently with hose lines directly connected to pumps or hydrants outside of buildings. Unfortunately, in some cases fire departments have ignored the availability of standpipe systems and have established no inspection or operational procedures for their effective use.

3012. Complete details regarding standpipe systems appear in Standard for Installation of Standpipes and Hose Systems, NFPA No. 14, prepared by the NFPA Committee on Standpipes and Outside Protection. There are two general types of standpipes for fire protection purposes. One is installed as a first aid fire fighting device primarily for use by building occupants. The other provides 2½-inch outlets for supplying fire department hose streams at locations which cannot be readily reached by lines laid from outside the building or property. Some installations combine both types of systems. Standpipes for 2½-inch hose are also designed to supply small hose streams. These systems may have either a separate 1½-inch hose valve or an easily removable 2½-inch by 1½-inch adapter.

3013. Minimum water supplies required in Standard for the Installation of Standpipes and Hose Systems, NFPA No. 14, for small hose standpipes are 70 gallons per minute with at least 25 pounds per square inch at the highest outlet with water flowing. This is intended to supply two small first aid streams. Thirty-five gallons per minute is the flow from a ½-inch nozzle orifice at 22 pounds per square inch. This flow would cause about 5 pounds loss through 50 feet of unlined 1½-inch standpipe hose.

3014. Minimum flows required for standpipes serving 2½-inch hose outlets are 250 gallons per minute for buildings having one fire department standpipe and 500 gallons per minute for buildings having two or more standpipes. It is recommended that the water supply be capable of providing 40 pounds at the top floor outlet with water being discharged through a nozzle with a 1⅛-inch nozzle tip supplied by 50 feet of 2½-inch rubber lined fire hose. This would provide about 220 gallons per minute

at 34 pounds. However, pressures as low as 20 pounds may be accepted providing about 150 gallons per minute at 17 pounds nozzle pressure with the same hose layout.

3015. Minimum private water supplies required for standpipes supplying 2½-inch hose outlets not served by adequate city water pressure are either an approved 250-gallon-per-minute fire pump, 4,500-gallon pressure tank, or a 5,000-gallon gravity tank. However, all standpipe systems for 2½-inch hose located in areas served by fire department pumpers must have at least one fire department pumper connection so that adequate volume and pressure can be supplied. Many standpipes are of a dry type and depend entirely on the fire department pumper connection for water supply. These are known as "dry standpipes." The connections to these systems are marked: "Dry Standpipe for Fire Department Use Only."

3016. Standard for the Installation of Standpipe and Hose Systems, NFPA No. 14, specifies the minimum size of risers required to supply standpipes. For small hose standpipe the riser must be at least 2-inch pipe for buildings not exceeding 4 stories or 50 feet in height and 2½-inch for taller buildings. For supplying 2½-inch hose, the standpipe must be not less than 4 inches for buildings not exceeding 6 stories or 75 feet and 6 inches for taller buildings.

3017. Water supplies acceptable for standpipes include:

- (1) Public water supplies having adequate pressure
- (2) Automatic fire pumps
- (3) Manual fire pumps in combination with pressure tanks
- (4) Pressure tanks
- (5) Gravity tanks
- (6) Manually controlled fire pumps operated by remote control devices at each hose station

3020. Inspection and Pre-Fire Planning

3021. The procedure for fire department study of standpipe systems is in many ways similar to that of automatic sprinkler systems. The inspector must determine the source and reliability of water supply and follow the piping, noting the control valves. However, instead of sprinkler heads the system supplies outlets for hose streams.

FIG. 301. SUGGESTED INSPECTION FORM FOR PROPERTIES HAVING FIRE STANDPIPE SYSTEMS

Name of Plant Fire Inspection District No.

Location Fire Alarm Code No.

Description of Property No. of Stories

Plant Official Responsible for Standpipe System

Phone

Type of Standpipe Systems:

 First Aid Standpipes for Occupants No. of Risers

 Size of Risers No. of Hose Outlets Location of
 Valves Controlling Standpipes

 Fire Dept. Standpipes No. of Risers Size of Risers

 No. of Hose Outlets Location of Valves Controlling Stand-
 pipes

Water Supplies to Standpipes:

Gravity Tank Pressure Tank

 Volume in Storage

Fire Pumps: Manual or Automatic Operation

 Capacity Location

Public Water Main Static Pressure

Private Water Main Static Pressure

..... GPM Available at Residual Pressure at Elevation

Fire Department Connections:

 Location of Connections

 Standpipe Supplied:

 First Aid Fire Dept.

 Company Assigned to Pump into Standpipe System on First Alarm

Hydrant to be Used (normal procedure)

Supplemental Pumper Supply Available

Hose Provided at Standpipe Outlets:

 Type Length

 Size Condition

Any Special Hose Threads or Adapters Provided?

Type of Nozzle Provided: Straight Stream Spray

Are Standpipes Inter-connected?

Standpipe Waterflow Alarm Devices

Remarks: Include any pertinent special information that may affect fire de-
partment operations

Inspected by Approved by Date