

NFPA[®]

17

Standard for
Dry Chemical Extinguishing
Systems

2021



IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REVISION SYMBOLS IDENTIFYING CHANGES FROM THE PREVIOUS EDITION

Text revisions are shaded. A **Δ** before a section number indicates that words within that section were deleted and a **Δ** to the left of a table or figure number indicates a revision to an existing table or figure. When a chapter was heavily revised, the entire chapter is marked throughout with the **Δ** symbol. Where one or more sections were deleted, a **•** is placed between the remaining sections. Chapters, annexes, sections, figures, and tables that are new are indicated with an **N**.

Note that these indicators are a guide. Rearrangement of sections may not be captured in the markup, but users can view complete revision details in the First and Second Draft Reports located in the archived revision information section of each code at www.nfpa.org/docinfo. Any subsequent changes from the NFPA Technical Meeting, Tentative Interim Amendments, and Errata are also located there.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

ADDITIONAL IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org.

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/docinfo.

Copyright © 2020 National Fire Protection Association®. All Rights Reserved.

NFPA® 17

Standard for

Dry Chemical Extinguishing Systems

2021 Edition

This edition of NFPA 17, *Standard for Dry Chemical Extinguishing Systems*, was prepared by the Technical Committee on Dry and Wet Chemical Extinguishing Systems. It was issued by the Standards Council on June 1, 2020, with an effective date of June 21, 2020, and supersedes all previous editions.

This edition of NFPA 17 was approved as an American National Standard on June 21, 2020.

Origin and Development of NFPA 17

The Dry Chemical Extinguishing Systems Committee was established in 1952. At that time, there was no dry chemical extinguishing system tested and listed by a testing laboratory, but by late 1954, a system was tested and listed by Underwriters Laboratories Inc. At its meeting in January 1955, the Committee prepared an outline of a standard on dry chemical extinguishing systems and, in the following year, prepared the standard that was tentatively adopted by the National Fire Protection Association on June 7, 1956. Changes to the tentative standard led to approval of the first official NFPA standard on dry chemical extinguishing systems in 1957. Further amendments were made in 1958, 1968, 1969, 1972, 1973, 1975, and 1980. The 1985 edition was a complete revision of the standard. The 1990 edition was a partial revision.

The 1998 edition of the standard was revised to clarify the requirements for protection of unclosable openings and equipment shutdown.

Changes to the 2002 edition consisted of an editorial restructuring of the standard in accordance with the *Manual of Style for NFPA Technical Committee Documents*, a specific reference for the listing of pre-engineered systems, and a simplification of the requirements for common ducts.

The 2009 edition included requirements for service technician qualifications. Definitions were coordinated with the NFPA *Glossary of Terms*.

The 2013 edition of this standard clarified the requirements for inspection and maintenance and provided new requirements for installation acceptance.

The 2017 edition included revisions to clarify the intent of component and system requirements in Chapters 4 and 5, respectively. Editorial changes included an update of the standard to comply with the *Manual of Style for NFPA Technical Committee Documents*.

The 2021 edition of this standard provides new requirements consistent with NFPA 12 and NFPA 2001 on the methods for supporting pipe, and addresses provisions on a common failure of special hazard fire-extinguishing systems, consistent with NFPA 72® and NFPA 2001.

Technical Committee on Dry and Wet Chemical Extinguishing Systems

David A. de Vries, *Chair*
Firetech Engineering Inc., IL [SE]

Larry Angle, M. Jacks Fire & Safety, TX [IM]
Rep. National Association of Fire Equipment Distributors
Art Black, Carmel Fire Protection Associates, CA [E]
Jack K. Dick, Heiser Logistics, Inc., NY [M]
Stephen M. Hill, JENSEN HUGHES, MD [SE]
George Hollingsworth, Fairfax County Fire & Rescue, VA [E]
Bradley T. Howard, Koorsen Fire & Security, OH [IM]
Bill Isemann, Guardian Fire Protection Services LLC, MD [IM]
Kurt M. Juliano, All State Fire Equipment, NY [IM]
Edward J. Kaminski, Clark County Department of Building and Fire Prevention, NV [E]
Doug Kline, Nowak Supply Fire Systems, IN [M]
Rep. Fire Suppression Systems Association
Jacob Peter Lindquist, Minnesota State Fire Marshals Division, MN [E]
Richard T. Long, Jr., Exponent, Inc., MD [SE]
Scott Matthews, AFEX Fire Suppression Systems, NC [M]
Michael P. McGreal, Firedyne Engineering, PC, IL [SE]
Sean J. McLaughlin, DunnWell, LLC, NC [IM]

Stephen M. Micke, Allianz, CA [I]
J. R. Nerat, UTC/Badger Fire Protection, MI [M]
Rep. NFPA Industrial Fire Protection Section
Christopher S. O'Shell, Chubb Limited, AZ [I]
Scott M. Plumer, Arvada Fire Protection District, CO [E]
Neal G. Pulvermacher, West Bend Mutual Insurance, WI [I]
James R. Richardson, Lisle Woodridge Fire District, IL [E]
Frederick Sanford, Liberty Mutual Insurance Company, MA [I]
Steven A. Sheldon, Fisher Engineering, Inc., AZ [SE]
Blake M. Shugarman, UL LLC, IL [RT]
Raymond A. Stacy, FM Approvals, MA [I]
Rep. FM Global
William Vegso, Buckeye Fire Equipment Company, NC [M]
Rep. Fire Equipment Manufacturers' Association
Adam D. Walker, Johnson Controls, WI [M]
Rep. Johnson Controls
Derek P. Wester, Amerex Corporation, AL [M]
Thomas Steven Wright, Wright Fire Consulting, Inc., NC [SE]

Alternates

Mark T. Conroy, Brooks Equipment Company, MA [M]
(Alt. to Jack K. Dick)
Evan T. de Vries, Firetech Engineering Incorporated, IL [SE]
(Alt. to David A. de Vries)
Bruce J. Euler, Buckeye Fire Equipment Company, NC [M]
(Alt. to William Vegso)
Gray M. Fowler, Liberty Mutual Insurance Group, MS [I]
(Alt. to Frederick Sanford)
Scott D. Henderson, Allianz, MA [I]
(Alt. to Stephen M. Micke)
Kevin Holly, Jr., UL LLC, IL [RT]
(Alt. to Blake M. Shugarman)
Jeremy W. John, Fisher Engineering, Inc., GA [SE]
(Alt. to Steven A. Sheldon)
James Knowles, Amerex, WA [M]
(Alt. to Derek P. Wester)
Doug Lackey, Ahern Fire Protection, WI [M]
(Alt. to Doug Kline)
Timothy J. Lawyer, JENSEN HUGHES, CA [SE]
(Alt. to Stephen M. Hill)
Richard L. Lupien, UTC/Kidde-Fenwal, Inc., MA [M]
(Alt. to J. R. Nerat)

Norbert W. Makowka, National Association of Fire Equipment Distributors, IL [IM]
(Alt. to Larry Angle)
Grant William May, Clark County Fire Prevention Bureau, NV [E]
(Alt. to Edward J. Kaminski)
Timothy McGreal, McGreal Forensic Engineers, IL [SE]
(Alt. to Michael P. McGreal)
Thomas L. McVerry, III, Academy Fire Protection, NC [IM]
(Alt. to Sean J. McLaughlin)
Nicholas A. Nava, Exponent, MD [SE]
(Alt. to Richard T. Long, Jr.)
Erik G. Olsen, Chubb Limited, NJ [I]
(Alt. to Christopher S. O'Shell)
Laurie K. Szumla, All State Fire Equipment of WNY, NY [IM]
(Alt. to Kurt M. Juliano)
Sean Troutt, Johnson Controls, WI [M]
(Alt. to Adam D. Walker)
Dale Underwood, Koorsen Fire & Security, TN [IM]
(Alt. to Bradley T. Howard)
Christopher Zeidler, West Bend Mutual Insurance, WI [I]
(Alt. to Neal G. Pulvermacher)

Nonvoting

Edward D. Leedy, Naperville, IL
(Member Emeritus)

Jacqueline Wilmot, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the design, installation, operation, testing, maintenance, and use of dry and wet chemical extinguishing systems for fire protection.

Contents

Chapter 1 Administration	17- 5	6.2 Hazard Specifications.	17- 12
1.1 Scope.	17- 5	Chapter 7 Local Application Systems	17- 13
1.2 Purpose.	17- 5	7.1 Uses.	17- 13
1.3 Retroactivity.	17- 5	7.2 Hazard Specifications.	17- 13
1.4 Equivalency.	17- 5	Chapter 8 Hand Hose Line Systems	17- 13
1.5 Units and Formulas.	17- 5	8.1 Separate Supplies.	17- 13
1.6 Qualifications.	17- 5	8.2 Location, Spacing, and Actuation.	17- 13
Chapter 2 Referenced Publications	17- 5	8.3 Dry Chemical Requirements.	17- 13
2.1 General.	17- 5	8.4 Training.	17- 13
2.2 NFPA Publications.	17- 5	Chapter 9 Pre-Engineered Systems	17- 14
2.3 Other Publications.	17- 5	9.1 Uses.	17- 14
2.4 References for Extracts in Mandatory Sections. ...	17- 6	9.2 Types of Systems.	17- 14
Chapter 3 Definitions	17- 6	9.3 Commercial Kitchen Hood, Duct, and Cooking Appliance Systems.	17- 14
3.1 General.	17- 6	9.4 Manual Actuation Requirements.	17- 14
3.2 NFPA Official Definitions.	17- 6	9.5 System Annunciation Requirements.	17- 15
3.3 General Definitions.	17- 6	9.6 System Supervision.	17- 15
3.4 Systems Definitions.	17- 7	9.7 Review and Certification.	17- 15
Chapter 4 Components	17- 7	9.8 Vehicle Fueling Service Station Systems.	17- 15
4.1 General.	17- 7	9.9 Systems for the Protection of Mobile Equipment.	17- 15
4.2 Detectors.	17- 7	9.10 Hand Hose Line Systems.	17- 16
4.3 Hose Line.	17- 7	Chapter 10 Plans and Acceptance Tests	17- 16
4.4 Nozzles.	17- 8	10.1 Specifications.	17- 16
4.5 Operating Devices.	17- 8	10.2 Plans.	17- 16
4.6 Pipe and Fittings.	17- 8	10.3 Approval of Plans.	17- 16
4.7 Dry Chemical.	17- 8	10.4 Approval of Installations.	17- 16
4.8 Expellant Gas.	17- 9	10.5 Manual.	17- 17
4.9 Electrical Wiring and Equipment.	17- 9	Chapter 11 Inspection, Maintenance, and Recharging ...	17- 17
4.10 Storage Containers.	17- 9	11.1 General Requirements.	17- 17
4.11 Indicators.	17- 9	11.2 Owner's Inspection.	17- 17
4.12 Assembly.	17- 9	11.3 Maintenance.	17- 18
Chapter 5 System Requirements	17- 9	11.4 Recharging.	17- 19
5.1 Use and Limitations.	17- 9	11.5 Hydrostatic Testing.	17- 19
5.2 Multiple Systems Protecting a Common Hazard. .	17- 9	Annex A Explanatory Material	17- 20
5.3 Systems Protecting Two or More Hazards.	17- 9	Annex B Informational References	17- 27
5.4 Dry Chemical Requirements and Distribution.	17- 9	Index	17- 28
5.5 Special Considerations.	17- 10		
5.6 Personnel Safety.	17- 10		
5.7 Operation and Control of Systems.	17- 10		
5.8 Dry Chemical and Expellant Gas Supply.	17- 11		
5.9 Piping.	17- 11		
Chapter 6 Total Flooding Systems	17- 12		
6.1 General.	17- 12		

NFPA 17

Standard for

Dry Chemical Extinguishing Systems

2021 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notices and Disclaimers Concerning NFPA Standards.” They can also be viewed at www.nfpa.org/disclaimers or obtained on request from NFPA.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with all TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by TIAs or Errata, please consult the National Fire Codes® Subscription Service or the “List of NFPA Codes & Standards” at www.nfpa.org/docinfo. In addition to TIAs and Errata, the document information pages also include the option to sign up for alerts for individual documents and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced and extracted publications can be found in Chapter 2 and Annex B.

Chapter 1 Administration

1.1* Scope. This standard includes minimum requirements for dry chemical fire-extinguishing systems that discharge dry chemical from fixed nozzles or hand hose lines by means of expellant gas.

1.2 Purpose. This standard is prepared for the use and guidance of those charged with the purchasing, designing, installing, testing, inspecting, approving, listing, operating, or maintaining of dry chemical fire-extinguishing systems in order that such equipment will function as intended throughout its life.

1.3 Retroactivity.

1.3.1 The provisions of this document are considered necessary to provide a reasonable level of protection from loss of life and property from fire. They reflect situations and the state of the art at the time the standard was issued.

1.3.2 Unless otherwise noted, it is not intended that the provisions of this document be applied to facilities, equipment, structures, or installations that were existing or approved for

construction or installation prior to the effective date of this document.

1.4 Equivalency. Nothing in this standard is intended to prevent the use of new methods or devices, provided sufficient technical data are submitted to the authority having jurisdiction to demonstrate that the new method or devices are equivalent in quality, effectiveness, durability, and safety to those prescribed by this standard.

1.5 Units and Formulas.

1.5.1 When a primary value for measurement in English units as given in this standard is followed by a parenthetical equivalent value in metric units, the primary English value stated is to be regarded as the requirement.

1.5.1.1* Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI).

1.5.1.2 The conversion procedure used for the SI units is to multiply the primary English quantity by the conversion factor and then round the result (if necessary) to the appropriate number of significant digits.

1.6* Qualifications. Only trained persons shall be considered competent to design, install, and service dry chemical systems.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 30, *Flammable and Combustible Liquids Code*, 2021 edition.

NFPA 70®, *National Electrical Code*®, 2020 edition.

NFPA 72®, *National Fire Alarm and Signaling Code*®, 2019 edition.

NFPA 96, *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations*, 2021 edition.

2.3 Other Publications.

2.3.1 ASME Publications. American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

ANSI/ASME B31.1, *Power Piping*, 2018.

Boiler and Pressure Vessel Code, 2018.

2.3.2 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM A53/A53M, *Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless*, 2018.

2.3.3 IEEE Publications. IEEE, 3 Park Avenue, 17th Floor, New York, NY 10016-5997.

National Electrical Safety Code (NESC), 2017.

Δ 2.3.4 UL Publications. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062-2096.

UL 300, *Fire Testing of Fire Extinguishing Systems for Protection of Commercial Cooking Equipment*, 2019.

UL 1254, *Pre-Engineered Dry and Wet Chemical Extinguishing System Units*, 2019.

2.3.5 U.S. Government Publications. U.S. Government Publishing Office, 732 North Capitol Street, NW, Washington, DC 20401-0001.

Title 29, Code of Federal Regulations, Part 1910, Subpart S.

2.3.6 Other Publications.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 17A, *Standard for Wet Chemical Extinguishing Systems*, 2021 edition.

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, 2020 edition.

NFPA 72®, *National Fire Alarm and Signaling Code*®, 2019 edition.

NFPA 96, *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations*, 2021 edition.

NFPA 122, *Standard for Fire Prevention and Control in Metal/Nonmetal Mining and Metal Mineral Processing Facilities*, 2020 edition.

NFPA 820, *Standard for Fire Protection in Wastewater Treatment and Collection Facilities*, 2020 edition.

NFPA 2001, *Standard on Clean Agent Fire Extinguishing Systems*, 2018 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.4* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the

authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.5 Shall. Indicates a mandatory requirement.

3.2.6 Should. Indicates a recommendation or that which is advised but not required.

3.2.7 Standard. An NFPA Standard, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA Manuals of Style. When used in a generic sense, such as in the phrase “standards development process” or “standards development activities,” the term “standards” includes all NFPA Standards, including Codes, Standards, Recommended Practices, and Guides.

3.3 General Definitions.

3.3.1 Auxiliary Equipment. Listed equipment used in conjunction with the dry chemical systems, for example, to shut down power, fuel, or ventilation to the hazard being protected or to initiate signaling devices.

3.3.2 Caking. A phenomenon that occurs when moisture chemically reacts with a dry chemical fire-extinguishing agent. This reaction results in materials that, being hydrated by moisture, stick together to form a large agglomerate, or what is more commonly referred to as lumps.

3.3.3* Calculation and Design. The process of computing, with the use of equations, graphs, tables, or computer software, the system characteristics such as flow rate, pipe size, area, or volume protected by each nozzle, nozzle pressure, and pressure drop.

3.3.4 Clearance. The air distance between extinguishing system equipment, including piping and nozzles, and unenclosed or uninsulated live electrical components not at ground potential. [2001, 2018]

3.3.5 Discharge Nozzle. Device from which the extinguishing agent is discharged to provide for suppression of a fire in the designated hazard. [17A, 2021]

3.3.6 Dry Chemical. A powder composed of very small particles, usually sodium bicarbonate-, potassium bicarbonate-, or ammonium phosphate-based, with added particulate material supplemented by special treatment to provide resistance to packing, resistance to moisture absorption (caking), and the proper flow capabilities.

3.3.6.1 Multipurpose Dry Chemical. Ammonium phosphate-based extinguishing agent that is effective on fires involving ordinary combustibles, such as wood or paper, and fires involving flammable liquids.

3.3.7 Duct.

3.3.7.1 Branch Duct. The duct work that contains the exhaust air from a single hood or hazard area.

3.3.7.2 Common Duct. The duct work containing the exhaust air from two or more branch ducts.

3.3.8 Expellant Gas. The medium used to discharge extinguishing agent from its container. [17A, 2021]

N 3.3.9 Hose. A flexible circular conduit for conveying extinguishing agent to discharge nozzles.

3.3.10 Indicator. A mechanical or electrical device that shows when an extinguishing system or a critical component of it is ready to operate or if it has already operated.

3.3.11 Inspection. A visual examination of a system or portion thereof to verify that it appears to be in operating condition and is free of physical damage. [820, 2020]

3.3.12 Lumps. Agglomerations of dry chemical that do not crumble into particles when dropped from a height of 4 in. (101 mm) onto a hard surface.

3.3.13 Maintenance. Work, including, but not limited to, repair, replacement, and service, performed to ensure that equipment operates properly.

3.3.14 Manual.

3.3.14.1* Manufacturer's Design, Installation, and Maintenance Manual. The document referenced for the design, installation, and maintenance of the listed dry chemical extinguishing system equipment.

3.3.14.2 Owner's Manual. A pamphlet containing the manufacturer's recommendations for the proper inspection and operation of the extinguishing system.

3.3.15 Operating Devices. Mechanical, electrical, or pneumatic devices involved in the operation of a system. [17A, 2021]

3.3.16 Operation.

3.3.16.1 Automatic Operation. Operation without human intervention. [25, 2020]

3.3.16.2 Manual Operation. Operation of a system or its components through human action. [25, 2020]

Δ 3.3.17* Pipe. A rigid circular conduit for conveying the extinguishing agent to the discharge nozzle(s).

3.3.18 Recharge. The replacement of the extinguishing agent and expellant gas. [17A, 2021]

3.3.19 Selector Valve. A device used to direct dry chemical to the hazard being protected.

3.3.20 Servicing. Performing maintenance, recharging, or hydrostatic testing.

3.3.21 Signal. An indication of a condition communicated by electrical, visible, visual, audible, wireless, or other means. [72, 2019]

3.3.22 Trained. A person who has undergone the instructions necessary to safely design, install, and reliably perform the maintenance and recharge service in accordance with the manufacturer's design, installation, and maintenance manual.

3.3.23 Transport Canada (TC). The department that has jurisdiction over design and transportation of compressed gas cylinders and cartridges in Canada.

3.3.24 U.S. Department of Transportation (DOT). The department that has jurisdiction over the design and transportation of compressed gas cylinders and cartridges in the United States.

3.4 Systems Definitions.

3.4.1 Dry Chemical System. A means of applying dry chemical that can be automatically or manually actuated to discharge through a distribution system onto or into the protected hazard, which could include auxiliary equipment.

3.4.2 Engineered Systems. Those systems requiring individual calculation and design to determine the flow rates, nozzle pressures, pipe size, area, or volume protected by each nozzle, quantities of dry chemical, number and types of nozzles, and their placement in a specific system.

3.4.3 Hand Hose Line System. A hose and nozzle assembly connected by fixed piping or connected directly to a supply of extinguishing agent. [122, 2020]

3.4.4 Local Application System. A supply of dry chemical permanently connected to fixed piping with nozzles arranged to discharge directly onto the fire.

3.4.5* Pre-Engineered Systems. Those systems having predetermined flow rates, nozzle pressures, and quantities of extinguishing agent and having specific pipe size, maximum and minimum pipe lengths, flexible-hose specifications, number of fittings, and number and types of nozzles.

3.4.6 Total Flooding System. A supply of dry chemical permanently connected to fixed piping and nozzles that are arranged to discharge dry chemical into an enclosure surrounding the hazard.

Chapter 4 Components

N 4.1 General.

N 4.1.1 Only system components referenced or permitted in the manufacturer's design, installation, and maintenance manual or alternative components that are listed for use with the specific extinguishing system shall be used.

N 4.1.2 Used components shall not be permitted to be installed in new systems.

4.2 Detectors. Automatic detection equipment shall be capable of detecting and indicating heat, flame, smoke, combustible vapors, or an abnormal condition in the hazard that is likely to produce fire.

4.2.1 Automatic detection equipment utilized in engineered systems shall be listed devices.

4.2.2 Automatic detection equipment used in a pre-engineered system shall be included within the listing of the pre-engineered system.

Δ 4.3 Hose Line.

4.3.1* Hose. Hose lines on systems shall be coupled to the dry chemical supply and shall incorporate hose listed for this use.

4.3.2 Hose Nozzle. A hose nozzle shall be so designed that it can be handled by one person.

4.3.2.1 A hose nozzle shall incorporate a shutoff device to control the flow of dry chemical.

4.3.3 Hose Line Storage. The hose shall be coiled on a hose reel or rack so that it can be readily uncoiled with a minimum of delay.

4.3.3.1 If installed, hose line stored outdoors shall be protected against the weather.

4.4 Nozzles.

4.4.1 Discharge Nozzles. Discharge nozzles shall be listed for their intended use.

4.4.1.1 Discharge nozzles shall be of adequate strength for use with the expected working pressures.

4.4.1.2 Discharge nozzles shall be of brass, stainless steel, or other corrosion-resistant materials or shall be protected inside and out against corrosion.

4.4.1.3 Discharge nozzles shall be made of noncombustible materials and shall withstand the expected fire exposure without deformation.

4.4.1.4 Discharge nozzles shall be permanently marked for identification.

4.4.2 Protective Devices for Discharge Nozzles.

4.4.2.1 Discharge nozzles shall be provided with blowoff caps or other suitable devices or materials to prevent the entrance of moisture, environmental contaminants, or other foreign materials into the piping.

4.4.2.2 The protective device shall blow off, blow open, or blow out upon agent discharge.

4.5 Operating Devices.

4.5.1 Operating devices shall be listed.

4.5.1.1 All operating devices shall be designed for the service they will encounter, shall not be rendered inoperative or susceptible to accidental operation, and shall operate at least from 32°F to 120°F (0°C to 49°C).

4.5.1.2 Operating devices shall be marked to indicate their listed minimum and maximum temperature limitations, but all devices shall operate at least from 32°F to 120°F (0°C to 49°C).

4.5.2 Manual Actuators.

4.5.2.1 Manual actuators shall not require a force of more than 40 lbf (178 N) to initiate operation.

4.5.2.2 Manual actuators shall not require movement of more than 14 in. (356 mm) to secure operation.

4.5.2.3 All readily accessible manual operating devices on systems with fixed nozzles shall identify the hazards they protect.

4.5.2.3.1 The operating instructions shall be permitted to include the use of pictographs and shall have lettering at least ¼ in. (6.35 mm) in height. (See 5.7.1.7.)

4.5.2.4 All remote manual operating devices shall be identified as to the hazard they protect.

4.5.3 Shutoff Devices. Shutoff devices shall require manual resetting prior to fuel or power being restored.

4.5.4 Valves.

▲ **4.5.4.1** All valves shall be listed for the intended use.

4.5.4.2 Selector valves shall be of the quick-opening type.

4.5.4.3 Selector valves shall allow free passage of the dry chemical.

4.6 Pipe and Fittings.

4.6.1* General. Pipe and fittings shall be of noncombustible material having physical and chemical characteristics such that their integrity under stress can be predicted with reliability. The pipe, fittings, and connection joints shall withstand the maximum expected pressure in the piping system.

4.6.1.1 Pipe and fittings shall be galvanized steel, stainless steel, copper, or brass. Special corrosion-resistant materials or coatings shall be required in severely corrosive atmospheres. Black steel pipe and fittings shall be permitted in noncorrosive atmospheres.

4.6.1.2 For pre-engineered systems, pipe, tubing, and fitting materials shall be in accordance with the manufacturer's design, installation, and maintenance manual.

▲ **4.6.1.3*** For all other systems, the thickness of the piping shall be calculated in accordance with ANSI/ASME B31.1, *Power Piping*.

4.6.1.3.1 The internal pressure used for the calculation in 4.6.1.3 shall not be less than the greater of either of the following values:

- (1) The normal charging pressure in the agent container at 70°F (21°C)
- (2) 80 percent of the maximum pressure in the agent container at a maximum storage temperature of not less than 130°F (54°C)

▲ **4.6.1.3.2** If higher storage temperatures are approved for a given system, the internal pressure used for the calculation shall be adjusted to the maximum pressure in the container at the higher temperature using ANSI/ASME B31.1, *Power Piping*.

4.6.2 Cast iron pipe and fittings; steel pipe conforming to ASTM A53/A53M, *Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless*; aluminum pipe; or nonmetallic pipe shall not be used.

4.6.3* Flexible piping (hose) shall be used only if specified in the manufacturer's design, installation, and maintenance manual.

4.6.4* Other types of pipe and fittings that have been investigated and listed for this service shall be permitted to be used.

4.6.5 Previously installed piping shall not be permitted to be used in new fire-extinguishing systems unless approved by the authority having jurisdiction.

4.7 Dry Chemical.

4.7.1* The type of dry chemical used in the system shall not be changed unless listed for that system.

4.7.2 Systems shall be designed on the basis of the flow and extinguishing characteristics of a specific make and type of dry chemical.

4.7.3* Different types of dry chemical shall not be mixed.

4.8 Expellant Gas.

4.8.1 Carbon dioxide used in expellant gas cartridges shall meet the following specifications:

- (1) The vapor phase shall not be less than 99.5 percent carbon dioxide.
- (2) The water content of the liquid phase shall not be more than 0.01 percent by weight [-30°F (-34.4°C) dew point].
- (3) The oil content shall not be more than 10 ppm by weight.

4.8.2 Nitrogen used as an expellant gas shall be standard industrial grade with a dew point of -60°F (-52.2°C) or lower.

4.9 Electrical Wiring and Equipment. Electrical wiring and equipment shall be installed in accordance with *NFPA 70*.

4.10 Storage Containers.

4.10.1 The dry chemical containers used in dry chemical systems shall be designed to meet the requirements of the U.S. Department of Transportation (DOT) or Transport Canada (TC) if used as shipping containers under pressure.

4.10.2* If not shipping containers under pressure, the dry chemical containers shall be designed, fabricated, inspected, certified, and stamped in accordance with the *ASME Boiler and Pressure Vessel Code*.

4.10.3 The design pressure shall be suitable for the maximum pressure developed at 130°F (55°C) or at the maximum controlled temperature limit.

4.11 Indicators. Dry chemical systems shall be provided with an audible or a visual indicator to show that the system is in a ready condition or is in need of recharging.

4.12 Assembly.

4.12.1* During assembly, the piping system shall be examined internally to detect and remove contaminants or other foreign materials.

4.12.2 All extinguishing agent storage containers shall be examined to ensure that they are fastened securely to their mounting brackets.

Chapter 5 System Requirements

5.1 Use and Limitations.

5.1.1* Use. The types of hazards and equipment that shall be protected using dry chemical extinguishing systems shall include the following:

- (1) Flammable or combustible liquids
CAUTION: Extinguishment of flammable liquid fires, especially Class I liquids (*see NFPA 30*), can result in a reflash unless all sources of ignition have been removed.
- (2) Flammable or combustible gases
CAUTION: Flammable gases present a potential explosion hazard if the flow of gas is not stopped before or during extinguishment.
- (3) Combustible solids, including plastics, that melt when involved in fire

- (4) Electrical hazards such as oil-filled transformers or circuit breakers
- (5) Textile operations subject to flash surface fires
- (6) Ordinary combustibles such as wood, paper, and cloth
- (7) Restaurant and commercial hoods, ducts, and associated cooking appliance hazards such as deep-fat fryers

5.1.2 Limitations. Dry chemical extinguishing systems shall not be considered satisfactory protection for the following:

- (1) Chemicals containing their own oxygen supply, such as cellulose nitrate
- (2) Combustible metals such as sodium, potassium, magnesium, titanium, and zirconium
- (3) Deep-seated or burrowing fires in ordinary combustibles where the dry chemical cannot reach the point of combustion

5.1.2.1* Multipurpose dry chemical shall not be used on machinery such as carding equipment in textile operations and delicate electrical equipment.

5.1.2.2 Before dry chemical extinguishing equipment is considered for use in protecting electronic equipment or delicate electrical relays, the effect of residual deposits of dry chemical on the performance on electronic equipment shall be evaluated.

5.1.2.3 Dry chemical extinguishing system equipment shall be used within its listed temperature limitations.

5.1.2.3.1 The agent storage container shall be marked to indicate the listed minimum and maximum temperature limitations of the fire suppression system equipment.

5.1.2.3.2 The minimum temperature limitation shall be at most 32°F (0°C).

5.1.2.3.3 The maximum temperature limitation shall be at least 120°F (48.9°C).

5.2 Multiple Systems Protecting a Common Hazard.

5.2.1 Where two or more systems are used to protect a common hazard, they shall be arranged for simultaneous operation. Operation of a single actuator shall cause all systems to operate.

5.2.2 Pre-engineered systems shall be designed in accordance with Chapter 9.

5.3 Systems Protecting Two or More Hazards.

5.3.1 Where two or more hazards could be simultaneously involved in fire by reason of their proximity, the hazards shall be protected by either of the following:

- (1) Individual systems installed to operate simultaneously
- (2) A single system designed to protect all hazards that could be simultaneously involved

5.3.2 Any hazard that will allow fire propagation from one area to another shall constitute a single fire hazard.

5.4 Dry Chemical Requirements and Distribution.

5.4.1 General.

5.4.1.1* The following factors shall be considered in determining the amount of dry chemical required:

- (1) Minimum quantity of dry chemical
- (2) Minimum flow rate of dry chemical

- (3) Nozzle placement limitations, including spacing, distribution, and obstructions
- (4) High ventilation rates, if applicable
- (5) Prevailing wind conditions, if applicable

5.4.1.2* The amount of dry chemical required for pre-engineered systems and hand hose line systems shall be determined in accordance with Chapter 7.

5.4.2 Compensation for Special Conditions. Additional quantities of dry chemical and additional nozzles, if necessary, shall be provided to compensate for special condition(s) such as high ventilation rates or prevailing wind conditions that could adversely affect the extinguishing effectiveness of the system.

5.5 Special Considerations.

5.5.1* Where systems protect hazards that are normally heated, the power or fuel supply to heaters shall be shut off automatically upon actuation of the extinguishing systems.

5.5.2 Where systems protect hazards that have flowing flammable or combustible fluids or gases, the systems shall be provided with automatic means to ensure shutoff of power and fuel valves upon operation of the extinguishing systems.

5.5.3 Where systems protect hazards that have conveyors moving flammable or combustible materials or commodities, the conveyors shall be automatically shut off upon operation of the extinguishing systems.

5.5.4 All shutoff systems shall be fail-safe.

5.5.5 All shutoff systems shall require manual resetting prior to restoration of the operating conditions existing before operation of the extinguishing systems.

5.5.6 All shutoff devices shall function with the system operation.

5.5.6.1 Expellant gas that is used to pneumatically operate shutoff devices shall be taken prior to its entry into the dry chemical containers.

5.6* Personnel Safety.

5.6.1 Safety Requirements.

5.6.1.1 Where total flooding and local application systems are used and there is a possibility that personnel could be exposed to a dry chemical discharge, suitable safeguards shall be provided to ensure prompt evacuation of such locations.

CAUTION: Hazards to Personnel. The discharge of large amounts of dry chemical can create hazards to personnel such as reduced visibility and temporary breathing difficulty.

5.6.1.2 Safety procedures shall provide a means for prompt rescue of any trapped personnel.

5.6.1.3 Safety items to be considered shall include, but not be limited to, the following:

- (1) Personnel training
- (2) Warning signs
- (3) PredischARGE alarms
- (4) Discharge alarms
- (5) Respiratory protection
- (6) Emergency eye wash stations

5.6.2 Electrical Clearances.

5.6.2.1 All system components shall be located to maintain no less than minimum clearances from live electrical parts.

Δ 5.6.2.2 The following references shall be considered as the minimum electrical clearance requirements for the installation of dry chemical systems:

- (1) *National Electrical Safety Code (NESC)*
- (2) *NFPA 70*
- (3) Subpart S of 29 CFR 1910

5.6.2.3 Where the design's basic insulation level (BIL) is not available and where nominal voltage is used for the design criteria, the highest minimum clearance specified for this group shall be used.

5.7* Operation and Control of Systems.

5.7.1 Methods of Actuation.

5.7.1.1 Systems shall be provided with both automatic and manual means of operation.

5.7.1.2 The automatic and manual means of mechanical system actuation, external to the control head or releasing device, shall be separate and independent of each other so that failure of one will not impair the operation of the other.

5.7.1.3 Hand hose line systems shall not require automatic means of operation.

5.7.1.4 Operation of any automatic or manual actuator shall be all that is required to bring about the full operation of the system.

5.7.1.5 At least one manual actuator shall be provided for each system.

5.7.1.6 All operating devices shall be designed, located, installed, or protected so that they are not subject to mechanical, environmental, or other conditions that could render them inoperative or cause inadvertent operation of the system.

5.7.1.7* At least one readily accessible means for manual actuation shall be located in the path of egress or at a location acceptable to the AHJ.

5.7.1.7.1 Where manual actuation is used for protection of hazards other than mobile equipment, the manual actuation device shall be installed no more than 48 in. (1200 mm) and no less than 42 in. (1067 mm) above the floor.

5.7.1.8* Where automatic systems protect only common exhaust ducts, a remote manual actuator shall not be required.

5.7.1.9 The manual actuation device shall clearly identify the hazard protected and be provided with instructions for its use. [96:10.5.1.2]

5.7.1.10 Where a listed releasing mechanism is used employing a single line for mechanical detection and remote manual control, the remote manual control shall be installed in-line, prior to all detection devices, so that malfunction of one does not impede operation of the other.

5.7.1.11 Automatic detection and system actuation shall be in accordance with this standard and the manufacturer's design, installation, and maintenance manual.

5.7.2 Supervision.

5.7.2.1 Supervision of electrically or pneumatically operated automatic systems shall be provided unless specifically waived by the authority having jurisdiction.

N 5.7.2.1.1* Removal of an electric actuator(s) from an agent storage container(s) or from an expellant discharge valve that it controls and selector valves shall result in an audible and visual indication of system impairment at the system's releasing control panel.

5.7.2.2 Pneumatic actuation piping, hose, and tubing that is not normally pressurized shall not require supervision.

5.7.3* **Notification.** An audible or visual indicator shall be provided to show that the system has operated, that personnel response might be needed, and that the system is in need of recharge.

Δ 5.7.4 **Connection to the Alarm System.** The extinguishing system shall be connected to the fire alarm system, if provided, in accordance with the requirements of *NFPA 72* so that the actuation of the dry chemical system will sound the fire alarm as well as provide the function of the extinguishing system.

5.8 Dry Chemical and Expellant Gas Supply.

5.8.1 **Quantity.** The amount of dry chemical in the system shall be at least sufficient for the largest single hazard protected or for the group of hazards that is to be protected simultaneously.

5.8.2* Reserve Supply.

5.8.2.1 Where a dry chemical system protects multiple hazards by means of selector valves, sufficient dry chemical and expellant gas shall be kept on hand for one complete recharge of the system.

5.8.2.2 For single hazard systems, a similar supply shall be kept on hand if the importance of the hazard is such that it cannot be shut down until recharges can be procured.

5.8.2.3 Where uninterrupted protection is required, both the main supply and the reserve supply shall be permanently connected to the distribution piping and arranged for change-over.

5.8.2.3.1 Changeover shall be accomplished by a main/reserve selector switch or valve or other approved method.

5.8.3 **Container.** The dry chemical container and expellant gas assemblies shall be located near the hazard or hazards protected but not where they will be exposed to a fire or explosion in these hazards.

5.8.3.1 The dry chemical container and expellant gas assemblies shall be located so as not to be subjected to severe weather conditions or to mechanical, chemical, or other damage.

5.8.3.2 Where excessive climatic or mechanical exposures are expected, suitable enclosures or guards shall be provided.

5.8.3.3* The dry chemical container and expellant gas assemblies utilizing nitrogen shall be located where the ambient temperature is normally -40°F to 120°F (-40°C to 48.9°C).

5.8.3.4 Assemblies utilizing carbon dioxide shall be located where the ambient temperature is normally 32°F to 120°F (0°C to 48.9°C).

5.8.3.5 If temperatures are outside the limits specified in 5.8.3.3 and 5.8.3.4, the equipment shall be listed for such temperatures, or means shall be provided for maintaining the temperatures within the ambient ranges given.

5.8.3.6 The dry chemical container and expellant gas assemblies shall be located where they will be accessible for inspection, maintenance, and service.

5.9 Piping.

5.9.1* Arrangement and Installation of Pipe and Fittings.

5.9.1.1 Piping and fittings shall be installed in accordance with good commercial practices.

5.9.1.2 All piping shall be laid out to produce the desired dry chemical flow rate at the nozzles.

5.9.1.3 All piping shall be installed to avoid possible restrictions due to foreign matter, faulty fabrication, or improper installation.

5.9.1.4 The piping system shall be securely supported and shall not be subject to mechanical, chemical, or other damage.

N 5.9.1.4.1* Pipe hangers and supports shall be designed and installed in accordance with recognized industry practices and manufacturer's instructions.

N 5.9.1.4.2 All pipe hangers and supports shall be attached directly to a rigid, fixed structure.

N 5.9.1.4.3 All hangers and components shall be steel.

N 5.9.1.4.4 Ordinary cast-iron hangers/supports, conduit clamps, or "C" clamps shall not be used.

N 5.9.1.4.5 All pipe supports shall be designed and installed to prevent lateral movement of supported pipe during system discharge while permitting longitudinal movement due to expansion and contraction caused by temperature changes.

N 5.9.1.4.6 Rigid hangers shall be installed wherever a change in elevation or direction occurs.

N 5.9.1.4.7 Nozzles shall be supported so as to prevent movement of the nozzle during discharge.

N 5.9.1.4.8 Where required, seismic bracing shall be in accordance with local codes and the authority having jurisdiction.

5.9.1.5 Where explosions are possible, the piping system shall be hung from supports that are least likely to be displaced.

5.9.1.6 Pipe shall be reamed and cleaned before assembly, and after assembly, the entire piping system shall be blown out with dry gas before nozzles or discharge devices are installed.

5.9.1.7 Pipe thread compound or tape shall not be used.

5.9.1.8 Pipe thread tape shall be permitted where installed in accordance with the manufacturer's design, installation, and maintenance manual.

5.9.1.9 Where the pipe or conduit penetrates a duct, plenum, paint spray booth, hood, or other protected areas, the penetration shall have a liquidtight continuous external weld or be sealed by a listed device.

5.9.2 Pipe Size and Nozzle Determination.

5.9.2.1 For engineered systems, pipe sizes and nozzles shall be selected, on the basis of calculations, to deliver the required dry chemical flow rate at each nozzle.

5.9.2.2 For pre-engineered systems, pipe sizes and nozzles shall be selected in accordance with the manufacturer's listed installation and maintenance manual.

5.9.2.3 Equations, graphs, or computer software shall be used to determine the pressure drop in the pipeline in engineered systems.

Δ 5.9.2.3.1 The design information of 5.9.2.3 shall be based on tests performed by the manufacturer and shall be confirmed by a testing laboratory.

N 5.9.2.3.2 Design information shall not be required in pre-engineered systems.

N 5.9.2.3.3 Computer software used in lieu of equations or graphs shall be listed.

5.9.2.4 All discharge nozzles shall be designed and subsequently located, installed, and protected so that they are not subject to mechanical, environmental, or other conditions that could render them inoperative.

5.9.2.5 Discharge nozzles shall be connected and supported so that they will not be readily put out of alignment.

5.9.2.6 Where nozzles are connected directly to flexible hose, they shall be provided with mounting brackets or fixtures to ensure that they can be aligned properly and that the alignment will be maintained.

Chapter 6 Total Flooding Systems

6.1* General.

Δ 6.1.1 A total flooding system shall be used only where there is a permanent enclosure surrounding the hazard that adequately enables the required concentration to be built up.

6.1.2 The total area of uncloseable openings shall not exceed 15 percent of the total area of the sides, top, and bottom of the enclosure.

6.1.3 Where the total area of uncloseable openings exceeds 15 percent of the total enclosure surface area, a local application system shall be used to protect the entire hazard.

6.1.4 Pre-engineered total flooding systems shall be permitted to protect permanent enclosures having uncloseable openings greater than 15 percent only when listed for such use.

6.1.5 Deep-seated fires involving solids subject to smoldering shall be protected by multipurpose dry chemical systems where the dry chemical can reach all surfaces involved in combustion.

6.1.5.1 Bicarbonate-based dry chemicals shall not be used for protection against the type of fires described in 6.1.5.

6.2 Hazard Specifications.

6.2.1 Enclosure. In the design of total flooding systems, the characteristics of the enclosure shall be as specified in 6.2.1.1 through 6.2.1.4.

6.2.1.1 The total area of uncloseable openings for which no compensation is provided shall not exceed 1 percent of the total area of the sides, top, and bottom of the enclosure.

6.2.1.2 Uncloseable openings having an area in excess of 1 percent of the total enclosure area and not exceeding 5 percent shall be compensated for by the provision of additional dry chemical in accordance with 6.2.2.6.

6.2.1.3 Uncloseable openings having an area in excess of 5 percent of the total enclosure area and not exceeding 15 percent shall be screened by local application of additional dry chemical in accordance with 6.2.2.6.1.

6.2.1.4 Pre-engineered systems shall be permitted to protect the permanent enclosures with uncloseable openings using different amounts of dry chemicals from those specified in 6.2.2.6 only when listed for such use.

6.2.2 Leakage and Ventilation. The leakage of dry chemical from the protected space shall be minimized because the effectiveness of the flooding system depends on obtaining an extinguishing concentration of dry chemical.

6.2.2.1 Where possible, openings such as doorways and windows shall be arranged to close before or simultaneously with the start of the dry chemical discharge.

6.2.2.2 Where forced-air ventilating systems are involved, they shall be either shut down or closed before or simultaneously with the start of the dry chemical discharge.

6.2.2.3* The quantity of dry chemical and the flow rate shall be sufficient to create a fire-extinguishing concentration in all parts of the enclosure.

6.2.2.4 Volume Allowances. In calculating the net volume to be protected, allowance shall be permitted for permanently located structures that materially reduce the volume.

6.2.2.5 Rate of Application. In engineered systems, the minimum design rate of application shall be based on the quantity of dry chemical and the maximum time to obtain the design concentration, as described in the manufacturer's listed design and installation manual.

6.2.2.5.1 In engineered systems, the rate of application shall be such that the design concentration in all parts of the enclosure shall be obtained within 30 seconds.

6.2.2.6 Engineered and pre-engineered systems intended for the protection of total flooding applications that have uncloseable openings with areas in excess of 1 percent of the total area of the sides, top, and bottom of the enclosure and not exceeding 5 percent shall be compensated for by the use of supplemental dry chemical in the proportion of not less than 0.5 lb/ft² (2.44 kg/m²) of unclosed opening, applied through the regular distribution system.

6.2.2.6.1 Where the uncloseable openings have areas exceeding 5 percent of the total of the sides, top, and bottom of the enclosure and not exceeding 15 percent, compensation shall be furnished by additional dry chemical in the proportion of not less than 1 lb/ft² (4.88 kg/m²) of unclosed opening, applied simultaneously by local application over the openings.

6.2.2.6.2 Pre-engineered systems shall be permitted to protect uncloseable openings using different amounts of dry chemicals from those specified in 6.2.2.6 and 6.2.2.6.1 only when listed for such use.

6.2.2.6.3 For ventilating systems that will not be shut down, supplementary dry chemical shall be added to the protected volume through the regular distribution system.

6.2.2.6.4 The supplementary dry chemical shall be added at the point or points of air inlet and shall be in proportion to the volume of air removal during the period of dry chemical discharge, calculated as if it were additional volume to be protected.

6.2.2.6.5 Pre-engineered systems listed for restaurant hood and duct protection shall be permitted for use with or without shutoff of the ventilation system or closure of dampers.

Chapter 7 Local Application Systems

7.1* Uses.

7.1.1 Local application systems shall be used for the extinguishment of fires in flammable or combustible liquids, gases, and shallow solids (e.g., paint deposits) where the hazard is not enclosed or where the enclosure does not conform to the requirements for total flooding.

7.1.2 Where an enclosure exists and conforms to the requirements of Section 6.1, total flooding application shall be used as directed in 6.2.1.1 and 6.2.2.6.

7.2 Hazard Specifications.

7.2.1* Extent of Hazard. The hazard shall be isolated from other hazards or combustibles so that fire will not spread outside the protected area.

7.2.2 The entire hazard shall be protected.

7.2.3* The hazard shall include all areas that are or might become coated by combustible or flammable liquids or shallow solid coatings and all associated materials or equipment that might extend fire outside or lead fire into the protected area.

7.2.4* Location. The design of the system shall consider the location of the hazard, which might be indoors, partly sheltered, or completely outdoors.

7.2.5 For flammable liquid fires, the nozzles shall be placed tankside or overhead, or a combination of tankside and overhead within the limits of the listing, and located to prevent splashing during discharge.

7.2.6* Coated Surfaces. Coated surface areas shall be treated as if they were deep-layer flammable liquid areas.

7.2.7 Duration of Discharge. The minimum effective discharge time shall be determined by the required minimum quantity of dry chemical and the minimum application rate.

7.2.7.1 Minimum effective discharge time for pre-engineered systems shall be determined in accordance with Chapter 9.

Chapter 8 Hand Hose Line Systems

8.1 Separate Supplies.

8.1.1 Where hand hose lines are used on a hazard that is also protected by a fixed system, separate dry chemical supplies shall be provided.

8.1.2 If a single dry chemical supply is used for both a hand hose line system and a fixed nozzle system, the hazards protected by the two systems shall be separated so that the hand hose lines cannot be simultaneously used on the hazard protected by the fixed nozzle system.

8.1.3 Hand hose line systems shall be permitted to supplement fixed nozzle fire protection systems or to supplement portable fire extinguishers for the protection of specific hazards for which dry chemical is a suitable extinguishing agent.

8.1.4 Hand hose systems shall not be used as a substitute for dry chemical extinguishing systems equipped with fixed nozzles except where the hazard cannot be adequately or economically provided with fixed nozzle protection.

▲ 8.1.5 The decision whether hand hose lines shall be permitted to be used for a particular hazard shall be made by the authority having jurisdiction.

8.2 Location, Spacing, and Actuation.

8.2.1* Location. Hand hose line stations shall be placed so that they are easily accessible and shall have hose lines long enough to reach the most distant hazard that they are expected to protect.

8.2.2 Spacing. If multiple hose stations are used, they shall be spaced so that any area within the hazard can be covered by one or more hose lines.

8.2.3 Actuation. Manual actuation of the dry chemical system shall be possible at each hose line station.

8.3 Dry Chemical Requirements.

8.3.1* Rate and Duration of Discharge. A hand hose line shall have a sufficient quantity of dry chemical to permit its effective use for a minimum of 30 seconds.

8.3.1.1 The minimum flow rate also shall be sufficient to prevent surging and interrupted discharge.

8.3.1.2 The value for minimum flow rate shall be confirmed by a testing laboratory.

8.3.2 Simultaneous Use of Hose Lines. Where simultaneous use of two or more hose lines is possible, a sufficient quantity of dry chemical shall be available to supply the maximum number of nozzles that are likely to be used at any one time for at least 30 seconds and at the appropriate flow rates.

8.3.3* Operation of Hose Lines.

8.3.3.1 The pressurizing valve shall remain in the open position during the entire fire-fighting operation.

8.3.3.2 The hose lines shall be cleared of dry chemical immediately after use.

8.4 Training. All personnel who are likely to use hand hose line equipment shall be kept properly trained in its operation and in the fire-fighting techniques applicable to this equipment.

Chapter 9 Pre-Engineered Systems

9.1 Uses.

9.1.1* Pre-engineered systems shall be installed to protect hazards within the limitations of the listing.

Δ 9.1.2 Fire-extinguishing systems referenced in 9.1.1 shall comply with UL 1254, *Pre-Engineered Dry and Wet Chemical Extinguishing System Units*, or an equivalent listing standard.

9.1.3 Only system components referenced in the manufacturer's design, installation, and maintenance manual or alternative suppliers' components that are listed for use with the specific extinguishing system shall be used.

Δ 9.1.4 Used components shall not be permitted to be installed in new systems.

9.2 Types of Systems. Pre-engineered dry chemical systems shall be of the following types:

- (1) Local application
- (2) Total flooding
- (3) Hand hose line
- (4) Combination of local application and total flooding

9.3* Commercial Kitchen Hood, Duct, and Cooking Appliance Systems.

Δ 9.3.1 Dry chemical fire-extinguishing systems for commercial kitchen hood, duct, and cooking appliances shall comply with UL 300, *Fire Testing of Fire Extinguishing Systems for Protection of Commercial Cooking Equipment*, or an equivalent listing standard.

9.3.1.1 Fixed automatic dry chemical extinguishing systems shall be installed in accordance with the terms of the listing, the manufacturer's design, installation, and maintenance manual, and this standard.

9.3.2 Each protected cooking appliance(s), individual hood(s), and branch exhaust duct(s) directly connected to the hood shall be protected by a system or systems designed and installed for simultaneous operation.

9.3.2.1 At least one fusible link or heat detector shall be installed within each exhaust duct opening in accordance with the manufacturer's listing.

9.3.2.2 A fusible link or heat detector shall be provided above each protected cooking appliance and in accordance with the extinguishing system manufacturer's listing.

9.3.2.3 Fusible links or heat detectors located at or within 12 in. (305 mm) into the exhaust duct opening and above the protected appliance shall be permitted to meet the requirements of 9.3.2.2.

9.3.3 Systems protecting two or more hoods, plenums, or both that meet the requirements of Section 5.2 shall be installed to ensure the simultaneous operation of all systems protecting the hoods, plenums, or both and associated cooking appliances located below the hoods.

9.3.4* Protection of Common Exhaust Duct.

9.3.4.1 Common exhaust ducts shall be protected by one of the following methods:

- (1)* Simultaneous operation of all independent hood, duct, and appliance protection systems

- (2)* Simultaneous operation of any hood, duct, and appliance protection system and the system(s) protecting the entire common exhaust duct

9.3.4.1.1 A fusible link or other mechanically operated heat detection device from the common duct fire-extinguishing system shall be located at each branch duct-to-common duct connection where electrical operation of the common duct fire-extinguishing system does not meet the requirements of 9.6.1.

9.3.4.1.2 Where a fusible link or mechanically operated heat detector is located at a branch duct-to-common duct connection, an access panel shall be installed in accordance with NFPA 96 to enable servicing of the detector when the detector is not accessible from the branch duct connection to the exhaust hood.

9.3.4.2 All sources of fuel or heat to appliances served by the common exhaust duct shall be shut down upon actuation of any protection system in accordance with 9.3.5.

9.3.4.3 The building owner(s) or the owner's agent shall be responsible for the protection of a common exhaust duct(s) used by more than one tenant.

9.3.4.3.1 The tenant shall be responsible for the protection of a common exhaust duct(s) serving hoods located within the tenant's space and up to the point of connection to the building owner's common exhaust duct.

9.3.4.3.2 The tenant's common duct shall be considered a branch duct to the building owner's common duct.

9.3.5* Shutoff Devices. Upon actuation of any cooking equipment fire-extinguishing system, all sources of fuel and electric power that produce heat to all equipment protected by the system shall be shut down.

9.3.5.1 Steam supplied from an external source shall not require shutdown.

9.3.5.2* Exhaust fans and dampers shall not be required to be shut down upon system actuation.

9.3.5.3 Any gas appliance not requiring protection but located under the same ventilating equipment shall be automatically shut off upon actuation of any extinguishing system.

9.3.5.4 Shutoff devices shall require manual resetting prior to fuel or power being restored. [96:10.4.4]

N 9.3.5.4.1 Where an electrical gas valve is used for shutting off gas to appliances, a manually reset relay shall be used to restore electrical power to the gas valve. [96:10.4.4.1]

9.4 Manual Actuation Requirements.

9.4.1 Such mechanical means shall not rely on any of the hardware components that would be common to the automatic function of the fixed fire-extinguishing equipment.

9.4.2 The means for manual actuation shall be mechanical and shall not rely on electrical power for actuation, unless in accordance with 9.4.3.

9.4.3 Electrical power shall be permitted to be used for manual actuation if a reserve power supply is provided in accordance with 9.6.1.

9.4.4 The manual actuation means of an automatic extinguishing system shall be totally independent of the automatic means.

9.4.5 A failure of a system component shall not impair both the automatic and the manual means of actuation.

9.5 System Annunciation Requirements.

9.5.1 Upon actuation of a fixed automatic fire-extinguishing system, an audible alarm or visual indicator shall be provided to show that the system has been actuated.

△ 9.5.2 Where a fire alarm signaling system is serving the occupancy where the extinguishing system is located, the activation of the automatic fire-extinguishing system shall activate the fire alarm signaling system in accordance with the requirements of *NFPA 72*.

9.6 System Supervision.

9.6.1 Where electrical power is required to operate the fixed automatic fire-extinguishing system, the system shall be monitored by a supervisory alarm and provided with a reserve power supply.

9.6.2 Where fixed automatic fire-extinguishing systems include automatic mechanical detection and actuation as a backup detection system, electrical power required for automatic operation shall not require monitoring or a reserve power supply.

9.6.3 Where fixed automatic fire-extinguishing systems are interconnected or interlocked with the cooking equipment power sources so that if the fire-extinguishing system becomes inoperable due to power failure, all sources of fuel and heat to all cooking equipment serviced by that hood shall automatically shut off, and electrical power monitoring shall not be required.

9.7 Review and Certification.

9.7.1 If required, complete drawings of the system installation shall be submitted to the authority having jurisdiction for review and approval.

9.7.1.1 System drawings shall include the following:

- (1) Hood(s)
- (2) Exhaust duct(s)
- (3) Appliances
- (4) Interface of the fire-extinguishing system detectors
- (5) Piping
- (6) Nozzles
- (7) Fuel shutoff devices
- (8) Agent storage container(s)
- (9) Manual actuation device(s)

9.7.2* Design and installation of systems shall be performed only by persons properly trained and qualified to design and/or install the specific system being provided.

9.7.2.1 The installer shall provide certification to the authority having jurisdiction that the installation is in complete agreement with the terms of the listing and the manufacturer's instructions and/or approved design.

9.8* Vehicle Fueling Service Station Systems.

9.8.1 Each hazard protected by two or more systems shall have these systems connected for simultaneous operation.

9.8.2 The protected area of each hazard shall include the area within the arc scribed by the nozzle end of the hose on each vehicle fuel dispenser.

9.8.2.1 The manufacturer of the system shall be consulted to determine the need for additional coverage under adverse wind conditions.

9.8.3 Equipment shall be provided to shut down all vehicle fuel dispensers simultaneously upon system actuation.

9.8.3.1 In the event of a system discharge, the hazard being protected shall not be returned to service until the system is recharged and operational.

9.8.4 Automatic detection and actuation of the extinguishing system shall be provided.

9.8.4.1 The manufacturer's listed installation and manufacturer's design, installation, and maintenance manual shall be consulted regarding the type and location of the detectors.

9.8.5 A remote manual actuator or operating device shall be provided in a conspicuous and accessible location away from the vehicle fuel dispensers and protected area. (*See Section 4.5.*)

△ 9.8.6 All discharge nozzles shall be located to minimize the likelihood of damage or misalignment and within the limitations and constraints of the manufacturer's design, installation, and maintenance manual.

9.9 Systems for the Protection of Mobile Equipment.

9.9.1* Only pre-engineered systems, including detection systems that have been listed for such use, shall be installed on mobile equipment.

9.9.2 Compartments or areas that could be subject to fire shall be protected in accordance with the manufacturer's design, installation, and maintenance manual.

9.9.3 Each protected compartment or area shall be provided with a listed fire detection device specified in the manufacturer's design, installation, and maintenance manual to automatically actuate the extinguishing system.

9.9.3.1 Manual actuation only shall be permitted to be provided if acceptable to the authority having jurisdiction.

9.9.4 Only the flexible piping (hose) and fittings specified in the manufacturer's design, installation, and maintenance manual shall be used.

9.9.5 All discharge nozzles shall be located to minimize the likelihood of damage or misalignment and within the limitations and constraints of the manufacturer's design, installation, and maintenance manual.

9.9.6 Location of agent containers, expellant gas cartridges or cylinders, and a manual actuator station(s) shall be appropriate to each application, protected against physical damage, and accessible.

9.9.7 At least one easily accessible manual actuator or operating device shall be provided for use by the equipment operator.

9.9.8 An additional manual actuator or operating device shall be located so that it is in the path of egress and operable from ground level.

9.9.9 If the system is provided with a discharge delay device, both audible and visual alarms shall be provided to warn of the impending system discharge.

9.9.10 In the event of system discharge, the vehicle being protected shall not be returned to service until the system is recharged and operational.

9.10 Hand Hose Line Systems.

9.10.1 Dry chemical hand hose line systems shall be provided with turrets, skid-mounted hose reels, remote hose reels, or combinations thereof.

9.10.2 The length and size of piping and hose and the type of nozzles shall be within the limitations stated in the manufacturer's design, installation, and maintenance manual.

9.10.3 Differences in elevation between the dry chemical storage tank and each turret or hose reel shall be within the limitations of the manufacturer's design, installation, and maintenance manual.

9.10.4 If multiple cylinders are used to pressurize the dry chemical agent containers, each cylinder shall be provided with a pressure gauge and a manual means of operation.

9.10.4.1 Slave cylinders without manual actuators shall be permitted if at least two master cylinders with manual actuators are provided.

9.10.4.2 Only one manual actuator shall be required to be provided for self-contained skid-mounted systems.

9.10.5 Each turret and hose reel shall be provided with a shut-off nozzle or flow control valve.

9.10.6 An integral method shall be provided to blow out all system piping and hose reels after any use.

9.10.7 Turret nozzles shall be provided with caps or other suitable devices to prevent moisture or foreign materials from entering the turret or piping.

10.1.4 The specifications shall include system acceptance tests.

10.1.5 The specifications shall indicate the hazard to be protected and shall include such information as physical dimensions, combustibles, air-handling equipment, heat sources, and so on.

10.2 Plans. Where plans are required, they shall be prepared by qualified persons trained in the design and application of these systems.

10.2.1 The plans shall be drawn to an indicated scale or be suitably dimensioned and shall be reproducible.

10.2.2 The plans shall contain sufficient detail to enable the authority having jurisdiction to evaluate the hazard or hazards and to evaluate the effectiveness of the system.

10.2.2.1 The details on the hazards shall include the materials involved, the location and arrangement, and the exposure to the hazard.

10.2.3 The details on the system shall include sufficient information and calculations on the following:

- (1) The amount of dry chemical
- (2) The size, length, and arrangement of connected piping or of piping and hose
- (3) The description and location of nozzles so that the adequacy of the system can be determined

10.2.3.1 Flow rates of nozzles used shall be provided for engineered systems.

10.2.3.2 Information shall be submitted pertaining to the location and function of detection devices, operating devices, auxiliary equipment, and electrical circuitry, if used.

10.2.3.3 Sufficient information shall be indicated to properly identify the apparatus and devices used.

10.3 Approval of Plans. Where plans are required, they shall be submitted to the authority having jurisdiction for approval before work starts.

10.3.1 Where field conditions necessitate any substantial change from the approved plan, the corrected as-installed plans shall be submitted to the authority having jurisdiction for approval.

10.4 Approval of Installations. The completed system shall be tested by a service technician as outlined in 11.1.3.

10.4.1 The tests shall determine that the system has been properly installed and will function as intended.

10.4.2 The installer shall certify that the installation has been made in accordance with the approved plans, where required, and the manufacturer's design, installation, and maintenance manual.

10.4.2.1 Verification shall be required that nozzles and pipe sizes are in accordance with approved plans, where required, and the manufacturer's design, installation, and maintenance manual.

10.4.2.2 Verification shall be required that piping supports are securely fastened.

10.4.3 Prior to the test required by 10.4.3.1, piping shall be physically checked for tightness.

Chapter 10 Plans and Acceptance Tests

10.1 Specifications. Specifications for dry chemical extinguishing systems shall be drawn up with care under the supervision of a trained person and with the advice of the authority having jurisdiction.

10.1.1 The provisions of 10.1.2 through 10.1.5 shall be included in the system specifications.

10.1.2 The specifications shall designate the authority having jurisdiction and indicate whether plans shall be required for pre-engineered systems.

10.1.2.1 Plans shall be required for all engineered systems.

10.1.3 The specifications shall state that the installation shall conform to this standard and meet the approval of the authority having jurisdiction.

10.1.3.1 The specification shall indicate that only equipment that is specifically listed and compatible for use with the extinguishing system shall be used.

10.1.3.1.1 The specification shall indicate special auxiliary devices acceptable to the system manufacturer and the authority having jurisdiction.

10.4.3.1* A test using nitrogen or dry air shall be performed on the piping network at a pressure not to exceed the normal operating pressure of the extinguishing system and to verify that nitrogen or dry air has discharged out of each nozzle in the system.

10.4.3.2 The method of verification shall be acceptable to the authority having jurisdiction.

10.4.3.3 Piping shall not be hydrostatically tested.

10.4.3.4 The labeling of devices with proper designations and instructions shall be verified.

10.4.3.5 Where the system is connected to a building alarm system, verification that alarm-sounding or notification devices and remote annunciation devices are functional shall be required.

10.4.3.6 Verification that all manual release devices (manual pull stations) are readily accessible and accurately identified shall be required.

10.4.3.7 Where a releasing control panel is provided, verification that it is connected to a dedicated circuit and labeled properly shall be required.

10.4.3.8 Where a releasing control panel is provided, verification that it is readily accessible and restricted from unauthorized personnel shall be required.

10.4.4 System Operational Tests. System operational tests shall be performed in accordance with the manufacturer's design, installation, and maintenance manual and shall include functional tests of the automatic detection system, the manual release devices, and shutdown devices, where provided.

10.4.5 Return the System to Operational Condition.

10.4.5.1 Verification shall be required that each extinguishing agent storage container is reconnected and the system has been returned to its fully operational condition.

10.4.5.2 After completion of functional testing, if the system is connected to an alarm-receiving office, the alarm-receiving office and all concerned personnel at the end user's facility shall be notified that the fire system test is complete and that the system has been returned to its fully operational condition.

10.4.6* The installing contractor shall complete and sign an acceptance test report acceptable to the authority having jurisdiction.

10.5 Manual. The owner shall be provided with a copy of the manufacturer's design, installation, and maintenance manual or the owner's manual.

Chapter 11 Inspection, Maintenance, and Recharging

11.1 General Requirements. The responsibility for inspection, testing, maintenance, and recharge of the fire protection system shall ultimately be that of the owner of the system, provided that this responsibility has not been transferred in written form to a management company, tenant, or other party.

11.1.1 Where dry chemical pressure containers are not attached to piping or hand hose lines, the discharge outlet shall be provided with a protective diffusing safety cap to protect personnel from recoil and high-flow discharge in case of accidental actuation.

11.1.1.1 Protective caps also shall be used on empty pressure containers to protect threads.

11.1.1.2 Protective caps shall be provided by the manufacturer of the equipment.

11.1.2 Storage. Storage of charging supplies of dry chemical shall be in a constantly dry area, and the dry chemical shall be contained in metal drums or other containers that will prevent the entrance of moisture even in small quantities.

11.1.2.1 Prior to the dry chemical chamber being charged, the dry chemical shall be checked carefully to determine that it is in a flowing condition.

11.1.3* A service technician who performs maintenance on an extinguishing system shall be trained and shall have passed a written or online test that is acceptable to the authority having jurisdiction.

11.1.3.1 The service technician shall possess a certification document confirming the requirements in 11.1.3 issued by the manufacturer or testing organization that is acceptable to the authority having jurisdiction.

11.1.4* A service technician that has the applicable manufacturer's design, installation, and maintenance manual and service bulletins shall service the dry chemical fire-extinguishing system at intervals no more than 6 months apart as outlined in Section 11.3.

11.1.5* All dry chemical extinguishing systems shall be inspected in accordance with the owner's manual and maintained and recharged in accordance with the manufacturer's design, installation, and maintenance manual and service bulletins.

11.1.6 Recharge Agents.

11.1.6.1* Dry chemical provided for the system shall be listed for the system.

11.1.6.1.1 Expellant gas for stored pressure cylinders shall be standard industrial-grade nitrogen with a dew point of -60°F (-51°C) or lower (CGA nitrogen specification G10.1).

11.1.6.1.2 The dry chemical provided by the equipment manufacturer and the type of expellant gas specified by the equipment manufacturer shall be required to be used.

11.1.6.1.3 Where carbon dioxide or nitrogen is used as the expellant gas, it shall be of good commercial grade and free of water and other contaminants that might cause container corrosion.

11.1.7 System access for inspection or maintenance that requires opening panels in fire chases, ducts, or both shall not be permitted while any appliance(s) or equipment protected by that system is in operation.

11.2 Owner's Inspection.

11.2.1 On a monthly basis, inspection shall be conducted in accordance with the manufacturer's design, installation, and maintenance manual or the owner's manual.

11.2.1.1 As a minimum, inspection shall include verification of the following:

- (1) The extinguishing system is in its proper location.
- (2) The manual actuators are unobstructed.
- (3) The tamper indicators and seals are intact.
- (4) The maintenance tag or certificate is in place.

- (5) The system shows no physical damage or condition that might prevent operation.
- (6) The pressure gauge(s), if provided, is inspected physically or electrically to ensure it is in the operable range.
- (7) The nozzle blowoff caps, where provided, are intact and undamaged.
- (8) Neither the protected equipment nor the hazard has been replaced, modified, or relocated.

11.2.2 If any deficiencies are found, appropriate corrective action shall be taken immediately.

11.2.2.1 Where the corrective action involves maintenance, it shall be conducted by a service technician as outlined in 11.1.3.

11.2.3 Personnel making inspections shall keep records for those extinguishing systems that were found to require corrective actions.

11.2.4 At least monthly, the date the inspection is performed and the initials of the person performing the inspection shall be recorded. The records shall be retained until the next semi-annual maintenance.

11.3 Maintenance.

11.3.1* At least semiannually and after any system activation, maintenance shall be conducted in accordance with the manufacturer's design, installation, and maintenance manual.

11.3.1.1 As a minimum, such maintenance shall include the following:

- (1) A check to see that the hazard has not changed
- (2) An examination of all detectors, expellant gas container(s), agent container(s), releasing devices, piping, hose assemblies, nozzles, signals, and all auxiliary equipment
- (3)* Verification that the agent distribution piping is not obstructed
- (4) Examination of the dry chemical (If there is evidence of caking, the dry chemical shall be discarded and the system shall be recharged in accordance with the manufacturer's instructions.)

N 11.3.1.2 Six-Year Internal Examination of Certain Types of Containers.

N 11.3.1.2.1 Every 6 years, stored-pressure extinguishing system containers that require a 12-year hydrostatic test shall be emptied and subjected to the applicable internal and external examination procedures as detailed in the manufacturer's instructions and this standard.

N 11.3.1.2.2 The 6-year requirement shall go into effect as of the date the applicable maintenance procedures are performed during periodic recharging or hydrostatic testing.

11.3.1.3 Dry chemical in stored pressure systems shall not require semiannual examination but shall be examined at least every 6 years.

11.3.1.3.1* Dry chemical containers that pass the applicable 6-year requirement of 11.3.1.3 shall have the maintenance information recorded on a durable weatherproof label that is a minimum size of 2 in. × 3 ½ in. (51 mm × 89 mm).

11.3.1.3.2 The new label shall be affixed to the container by a heatless process, and any old labels shall be removed.

11.3.1.3.3 These labels shall be of the type that self-destructs when their removal from a dry chemical container is attempted.

11.3.1.3.4 The label shall include the following information:

- (1) Month and year the maintenance was performed, indicated by a perforation such as done by a hand punch
- (2) Name or initials of the person performing the maintenance and the name of the agency performing the maintenance

11.3.1.3.5* Each system container that has undergone maintenance that includes internal examination or has been recharged shall have a verification-of-service collar located around the neck of the container.

11.3.1.3.6 The collar shall not interfere with the operation of the system container discharge valve.

11.3.1.3.7 The collar shall include the following information:

- (1) Month and year the service was performed, indicated by a perforation such as done by a hand punch
- (2) Name of the agency performing the maintenance or recharge

11.3.1.3.8 Cartridge- or cylinder-operated dry chemical system containers shall not be required to comply with 11.3.1.3.1 through 11.3.1.3.7.

11.3.1.4 Where maintenance of any dry chemical containers reveals conditions such as, but not limited to, corrosion or pitting in excess of the manufacturer's limits; structural damage; fire damage; or repairs by soldering, welding, or brazing, the affected container shall be replaced or hydrostatically tested in accordance with the recommendations of the manufacturer or the listing agency; hydrostatic testing of dry chemical containers shall be in accordance with Section 11.5.

11.3.1.4.1 Where maintenance of any dry chemical system components reveals conditions such as, but not limited to, corrosion or pitting in excess of the manufacturer's limits, structural damage, or fire damage, the affected part(s) shall be replaced.

11.3.1.5* All dry chemical systems shall be tested, which shall include the operation of the detection system, signals, and releasing devices, including manual stations and other associated equipment.

11.3.1.6* Where the maintenance of the system(s) reveals defective parts that could cause an impairment or failure of proper operation of the system(s), the defective parts shall be replaced or repaired in accordance with the manufacturer's instructions.

11.3.1.6.1 Until such repairs are accomplished, the system(s) shall be tagged as noncompliant, and the owner or owner's representative responsible for the system and the authority having jurisdiction shall be notified of the impairment by the end of the following business day.

11.3.1.6.2 When all repairs have been accomplished and the system has been restored to its full operating condition, all previously notified parties shall be informed that the system is in its full operating condition.

11.3.1.7* Pressure regulators shall be operationally checked at least annually to ensure they meet the equipment manufacturer's recommended static outlet pressure and minimum flow rate tolerances.

11.3.1.7.1 Defective regulator(s) shall not be adjusted but shall be replaced or sent to a factory-authorized regulator rebuilding facility for repair.

11.3.1.8* Auxiliary pressure cylinders that incorporate hand-operable valves shall have their pressure checked at least annually with a device to verify the cylinder pressure meets the equipment manufacturer's tolerance specifications.

11.3.1.9 The maintenance report, including any recommendations, shall be filed with the owner or with the owner's representative.

11.3.1.9.1 The owner or owner's representative shall retain all maintenance reports for a period of 1 year after the next maintenance of that type required by this standard.

11.3.1.10* Each dry chemical system shall have a tag or label indicating the month and year the maintenance is performed and identifying the person performing the service; only the current tag or label shall remain in place.

11.3.2* Fixed temperature-sensing elements of the fusible metal alloy-type shall be replaced at least semiannually from the date of installation.

11.3.2.1 Upon removal of the fusible metal alloy temperature-sensing elements, the links shall be destroyed.

11.3.2.2 The year of manufacture and the date of installation of the fixed temperature-sensing element shall be marked on the system inspection tag.

11.3.2.3 The tag shall be signed or initialed by the installer.

11.3.3* Heat detectors other than metal alloy-type fusible links shall be permitted to remain continuously in service, provided they are inspected, cleaned, and tested, or replaced if necessary, in accordance with *NFPA 72* and the manufacturer's instructions, at least semiannually or sooner depending on operating conditions.

11.3.3.1 At a minimum, maintenance for restorable-type heat detectors shall include the following:

- (1) A visual inspection to determine that there is no damage to the detector or buildup of foreign debris
- (2) An operational/functional test in accordance with the detector manufacturer's testing instructions
- (3) A calibration verification test, if applicable, in accordance with the detector manufacturer's instructions

11.3.3.2 Nonrestorable heat detectors shall be functionally tested in accordance with the manufacturer's instructions.

11.3.3.3 Heat detectors and all associated wiring that show signs of fire damage shall be tested in accordance with the manufacturer's instructions and replaced if necessary.

11.3.3.4 Fixed temperature-sensing or rate-compensated thermal detection devices installed on mobile equipment that has

been involved in a fire incident, that has been subjected to flame contact, or that exhibits scorch marks or other signs of excessive temperature shall be replaced.

11.4 Recharging.

11.4.1 All extinguishing systems shall be recharged after use or as indicated by an inspection or a maintenance check.

11.4.2 Systems shall be recharged in accordance with the manufacturer's design, installation, and maintenance manual.

11.5* Hydrostatic Testing. Hydrostatic testing shall be performed by persons trained in pressure-testing procedures and safeguards and having available suitable testing equipment, facilities, and an appropriate service manual(s).

▲ 11.5.1* The following parts of dry chemical extinguishing systems shall be subjected to a hydrostatic pressure test at intervals not exceeding 12 years:

- (1) Dry chemical containers
- (2) Auxiliary pressure containers
- (3) Hose assemblies

■ 11.5.1.1 Parts of dry chemical extinguishing systems that meet the following criteria shall be exempt from the hydrostatic pressure test requirement of 11.5.1:

- (1) Dry chemical containers that are part of extinguishing systems having an agent capacity exceeding 150 lb (68 kg)
- (2) Auxiliary pressure containers not exceeding 2 in. (0.05 m) outside diameter and less than 2 ft (0.6 m) in length
- (3) Auxiliary pressure containers bearing the DOT "3E" marking

11.5.2 Dry chemical containers, auxiliary pressure containers, and hose assemblies shall be subjected to a hydrostatic test pressure equal to the marked factory test pressure or the test pressure specified in the manufacturer's design, installation, and maintenance manual.

11.5.2.1 No leakage, rupture, or movement of hose couplings shall be permitted.

11.5.2.2 The pressure in a hydrostatic test of a cylinder shall be maintained for a minimum of 30 seconds but for no less time than is required for complete expansion of the cylinder and to complete the visual examination of the cylinder.

11.5.2.3* Prior to being refilled or transported, in accordance with DOT or TC requirements, containers bearing DOT or TC markings shall be retested or replaced in accordance with the appropriate DOT or TC requirements.

11.5.3 Dry chemical agent removed from the containers prior to hydrostatic testing shall be discarded.

11.5.4 Care shall be taken to ensure that all tested equipment is thoroughly dried prior to reuse.

11.5.5 To protect the hazard during hydrostatic testing, if there is no connected reserve, alternative protection acceptable to the authority having jurisdiction shall be provided.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.1 The dry chemical systems described in this standard are designed to discharge dry chemical from fixed nozzles and piping or from hose lines by means of an expellant gas. The intent of the standard is to present the design considerations applicable to these systems. It contains only the essential requirements and recommendations needed to make the standard workable in the hands of those skilled in this field.

Because the flow of dry chemical (solid particles suspended in a gaseous medium) does not follow general hydraulic theories, most of the flow principles have been determined experimentally. The dry chemicals produced by various manufacturers usually are not identical in all characteristics, and each manufacturer designs equipment for use with a specific dry chemical. System design principles applicable to the products of one manufacturer are not applicable to the products of another manufacturer. As a result, it is not practical to include system design details as a part of this standard.

It is now generally accepted that the flame-extinguishing properties of dry chemicals are due to the interaction of the particles, which stops the chain reaction that takes place in flame combustion. Dry chemicals vary in their flame-extinguishing effectiveness. Multipurpose dry chemical owes its effectiveness in extinguishing fires involving ordinary combustibles, such as wood and paper, to the formation of a glow-retarding coating over the combustible material. For additional information on dry chemicals and their extinguishing characteristics, see A.4.7.1.

Portable dry chemical equipment is covered in NFPA 10.

A.1.5.1.1 See IEEE/ASTM SI 10, *American National Standard for Metric Practice*.

A.1.6 Although training and qualification might be available elsewhere, it is recommended that such training and qualification be performed by the manufacturer of the equipment being installed or serviced or by the manufacturer's agent.

It might be necessary for many of those charged with purchasing, inspecting, testing, approving, operating, and maintaining this equipment to consult an experienced fire protection engineer competent in this field in order to discharge their respective duties effectively.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase "authority having jurisdiction," or its acronym AHJ, is used in

NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.2.4 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.3 Calculation and Design. This information is not required for listed pre-engineered systems because these systems must be installed in accordance with their pretested limitations described in the manufacturer's design, installation, and maintenance manual.

A.3.3.14.1 Manufacturer's Design, Installation, and Maintenance Manual. This document contains a description of the hazards that can be protected, as well as the limitations of the dry chemical extinguishing system. It also requires that the dry chemical extinguishing system be designed, installed, inspected, maintained, and serviced in accordance with NFPA 17.

A.3.3.17 Pipe. Wherever *pipe* is used in this standard, it is understood to also mean *tube*.

A.3.4.5 Pre-Engineered Systems. Pre-engineered systems should be listed by a testing laboratory. The maximum and minimum pipe lengths and the number of fittings should be permitted to be expressed in equivalent feet (meters) of pipe. The hazards protected by these systems should be limited as to type and size based on actual fire tests. Limitations on hazards that are permitted to be protected by these systems are contained in the manufacturer's design, installation, and maintenance manual that is part of the listing of the system.

A.4.3.1 Normally, identifying markings on the hose indicate the acceptability of the hose for this purpose.

A.4.6.1 Piping should be installed in accordance with good commercial practice. Care should be taken to avoid possible restrictions due to foreign matter, faulty fabrication, or improper installation.

The piping system should be securely supported with due allowance for agent thrust forces and thermal expansion and contraction and should not be subjected to mechanical, chemical, vibration, or other damage. ANSI/ASME B31.1, *Power Piping*, should be consulted for guidance on this matter. Where explosions are likely, the piping should be attached to supports that are least likely to be displaced.

Although dry chemical piping systems are not subjected to continuous pressurization, provisions should be made to ensure that the type of piping installed can withstand the maximum stress at maximum storage temperatures.

A.4.6.1.3 In performing the calculation, the guidelines provided in the FSSA publication *Pipe Design Handbook for Use with Special Hazard Fire Suppression Systems* should be consulted.

A.4.6.3 The piping for a dry chemical system embodies distinctive features necessitated by the characteristics of the agent. The use of flexible piping or hose in a dry chemical system introduces a number of factors to be considered that do not normally affect rigid piping. The most important of these is the nature of any changes of direction. The minimum radius of curvature for any flexible hose to be used in a dry chemical system is usually shown in the listing information for a particular system. Other areas of concern for listing that are evaluated in the test are resistance to the effects of vibration, flexure, tension, torsion, temperature, flame, compression, and bending. It is also necessary for the hose to have the strength to contain the dry chemical during discharge and to be made of materials that will be resistant to atmospheric corrosion.

A.4.6.4 The use of such pipe and fittings should consider the following factors:

- (1) Pressure rating
- (2) Corrosion (chemical and electrolytic)
- (3) Methods of joining
- (4) Resistance to fire exposure and rapid temperature changes
- (5) Flow characteristics

▲ **A.4.7.1** A dry chemical extinguishing agent is a finely divided powdered material that has been specially treated to be water repellent and capable of being fluidized and free-flowing so that it can be discharged through hose lines and piping when under expellant gas pressure. Dry chemicals currently in use are described briefly as follows.

Sodium Bicarbonate-Based Dry Chemical. This agent consists primarily of sodium bicarbonate (NaHCO_3) and is suitable for use on all types of flammable liquid and gas fires (Class B) and for fires involving energized electrical equipment (Class C).

It is particularly effective on fires in common cooking oils and fats. In combination with these materials, the sodium bicarbonate-based agent reacts to form a type of soap (i.e., saponification) that floats on a liquid surface, such as in deep-fat fryers, and effectively prevents re-ignition of the grease.

Sodium bicarbonate-based dry chemical is not generally recommended for the extinguishment of fires in ordinary combustibles (Class A), although it can have a transitory effect in extinguishing surface flaming of such materials.

Dry Chemicals Based on the Salts of Potassium. Commercially available agents are essentially potassium bicarbonate (KHCO_3), potassium chloride (KCl), and urea-based potassium bicarbonate ($\text{KC}_2\text{N}_2\text{H}_3\text{O}_3$). All three agents are suitable for use on all types of flammable liquid and gas fires (Class B) and also for fires involving energized electrical equipment (Class C).

It is generally recognized that salts of potassium are more effective in terms of chemical extinguishment mechanisms than sodium salts in extinguishing Class B fires, except those in deep-fat fryers and other cooking equipment.

Dry chemicals based on the salts of potassium are not generally recommended for the extinguishment of fires in ordinary combustibles (Class A), although they can have a transitory effect in extinguishing surface flaming of such materials.

Multipurpose Dry Chemical. This agent has monoammonium phosphate ($\text{NH}_4\text{H}_2\text{PO}_4$) as its base and is similar to the other dry chemicals in its effect on Class B and Class C fires. However, it does not possess a saponification characteristic and should not be used on fires in deep-fat fryers. Unlike the other dry chemicals, it does have a considerable extinguishing effect on Class A materials. The agent, when heated, decomposes to form a molten residue that will adhere to heated surfaces. On combustible solid surfaces (Class A), this characteristic excludes the oxygen necessary for propagation of the fire.

Foam-Compatible Dry Chemicals. When or where foam dry chemical systems are used or proposed for the protection of a hazard, the manufacturer should be consulted about the compatibility of the agents.

A.4.7.3 Mixtures of certain dry chemicals can generate dangerous pressures and form lumps.

A.4.10.2 Independent inspection and certification are recommended.

A.4.12.1 Contaminants and foreign materials can affect the extinguishing agent distribution due to a reduction in the effective nozzle orifice area.

▲ **A.5.1.1** Gas fires normally should not be extinguished unless the source of burning gas can be shut off because an explosive mixture could form with air that, if ignited, might cause greater damage than the original fire.

Factors that determine whether the gas fire should be extinguished prior to shutting off the gas supply are as follows:

- (1) *Accessibility of Gas Shutoff Valves.* Where water hose streams are not available, it might be necessary to extinguish the fire to reach the shutoff valves.
- (2) *Proximity of Other Flammable or Combustible Materials.* If ignition of these materials could result in a more hazardous condition, the fire might have to be extinguished prior to gas shutoff.
- (3) *Personnel Rescue.* Dry chemical should be applied at flow rates and discharge patterns that will be effective. Gas line flange, line rupture, or impinging fires might need special flow rates and discharge patterns.

A.5.1.2.1 Dry chemical, when discharged, will drift from the immediate discharge area and settle on surrounding surfaces. Prompt cleanup will minimize possible staining or corrosion of certain materials that can take place in the presence of moisture.

Monoammonium phosphate and potassium chloride are slightly acidic and, in the presence of moisture, can corrode metals such as steel, cast iron, and aluminum.

Potassium bicarbonate, sodium bicarbonate, and urea-based potassium bicarbonate are slightly basic and, in the presence of moisture, can corrode metals such as aluminum, aluminum brass, aluminum bronze, and titanium.

Such corrosion will vary from a dull or tarnished finish to mild surface corrosion. Corrosion should not be of concern if the dry chemical is promptly cleaned up. For the most part, these dry chemical agents can be readily cleaned up by wiping, vacuuming, or washing the exposed materials. A monoammonium phosphate-based agent will need some scraping and washing if the exposed surfaces were hot when the agent was applied.

Upon exposure to temperatures in excess of 250°F (121°C) or relative humidity in excess of 50 percent, deposits will be formed that can be corrosive, conductive, and difficult to remove.

A.5.4.1.1 The limiting specifications for a dry chemical system are a function of the flow characteristics of the particular dry chemical and the equipment used by the manufacturer of the system. Therefore, it is not possible to specify in this standard the exact values for the quantity needed, rate of flow needed, or nozzle distribution. The considerations provided in this standard point out the important features that should be made available to the purchaser, inspector, or other authorities charged with the examination and evaluation of the system. These data should be established by investigation and tests confirmed by a testing laboratory.

A.5.4.1.2 In pre-engineered systems, the factors in 5.4.1.1(1) through 5.4.1.1(3) are established for specific volume and other conditions given in the manufacturer's design, installation, and maintenance manual.

A.5.5.1 Examples of these hazards are wax tanks and, in a kitchen, deep-fat fryers, charbroilers, upright broilers, griddles, and ranges.

A.5.6 Dry chemical extinguishing agents are considered nontoxic from a physiological point of view. However, as with any finely divided material, they can produce mild irritation effects, especially when used in an enclosed area. In general, the effects are neither serious nor permanent.

For more specific guidance on individual dry chemical extinguishing agent components and their hazards to personnel (threshold limit values), consult the dry chemical manufacturer.

A.5.7 See *NFPA 72* for detection, alarm, and control functions for dry chemical extinguishing systems.

A.5.7.1.7 Common exhaust ducts normally are located in concealed areas such that the need for manual discharge of the system might not be readily apparent. It is recommended that the number and location of remote controls, if any, be given careful consideration.

N A.5.7.1.8 Common exhaust ducts are normally located in concealed areas, therefore the need for manual discharge of the system might not be readily apparent. It is recommended that the number and location of remote controls, if any, be given careful consideration.

N A.5.7.2.1.1 Paragraph 14.2.6.4 of *NFPA 72* states that suppression systems be secured from inadvertent actuation, including disconnection of releasing solenoids or electric actuators, closing of valves, other actions, or combinations thereof, for the specific system, for the duration of the fire alarm system testing.

Dry chemical systems could have a device, referred to as an electric actuator, attached to one or more agent storage or expellant container discharge valves that, upon signal from the fire system's releasing control unit, causes the discharge valve(s) to release the agent. This actuator is typically either a solenoid-operated device or a squib-operated device.

During system maintenance, it is common procedure to remove the solenoid-operated actuator from the agent storage container discharge valve to prevent accidental discharge of

the system and permit functional testing of the actuator. Some systems that incorporate selector valves also have electric actuators attached to the selector valves to control their operation by electrical signal from the control panel. These electric actuators might also need to be removed from their selector valves during routine maintenance.

Since the electrical connection between the solenoid and the system control panel is not broken by this maintenance procedure, special provision is required to provide an indication of system impairment at the releasing control panel when the electric actuator is physically removed from the valve it controls. There have been numerous reports of systems inadvertently left disabled after maintenance because the technician failed to reinstall the actuator on its valve. Fortunately, in all reported cases, the impairment was discovered before the system was required to operate, and only successful extinguishments have been reported. No failures to operate under fire conditions have come to the attention of the technical committee responsible for this standard.

Squib actuators are covered by this requirement only if the manufacturer's maintenance instruction manual requires physical removal of the squib-operated device from the valve it controls.

A.5.7.3 If only local alarms are provided, consideration should be given to transmitting these alarms to a constantly attended location.

A.5.8.2 A fully charged reserve unit permanently connected to the system is desirable and can be required by the authority having jurisdiction.

A.5.8.3.3 Listed systems for use at higher temperatures up to 210°F (99°C) or lower temperatures down to -65°F (-54°C) are available from most system manufacturers. Special systems can be specially designed for extreme temperature conditions.

A.5.9.1 The following material provides some of the necessary considerations that must be incorporated when piping a mixture of dry chemical and expellant gas. The flow of the mixture of dry chemical and gas does not strictly follow general hydraulic principles, because it is a two-phase flow. The flow characteristics are dependent upon the composition and physical characteristics of the type and make of the dry chemical being used, the type of expellant gas being used, and the design of the equipment being used.


Pre-engineered systems do not need calculations for flow rate, pressure drop, and nozzle pressure, since they have been tested for fire extinguishment with minimum and maximum piping limitations, including length of pipe and number and type of elbows, and minimum and maximum temperature limitations. These limitations have been verified by testing laboratories and are published in the manufacturer's installation manual.

Engineered systems are calculated to show that the proper flow rate and nozzle pressure are obtained using the pressure drop occurring in the piping layout. The necessary charts, graphs, and nozzle pattern information must be obtained from the equipment manufacturer and verified by testing laboratories.

Changes in direction of flow cause separation of expellant gas and dry chemical. To provide proper distribution of dry chemical upon splitting the stream, special attention must be

given to the method in which an approach is made to a tee after a change in direction. Certain acceptable methods are shown in Figure A.5.9.1(a) and Figure A.5.9.1(b). Other methods and equipment can be recognized by a testing laboratory in its listings.

N A.5.9.1.4.1 FSSA's *Pipe Design Handbook for Use with Special Hazard Fire Suppression Systems* provides guidance on pipe hangers and supports according to established industry practices. Additional guidance based on industry standard best practices is found in ANSI/MSS SP-58, *Pipe Hangers and Supports — Materials, Design, Manufacture, Selection, Application, and Installation*, for locations where seismic qualification is not required and in MSS SP-127, *Bracing for Piping Systems: Seismic — Wind — Dynamic Design, Selection, and Application*, for locations where seismic qualification is required.

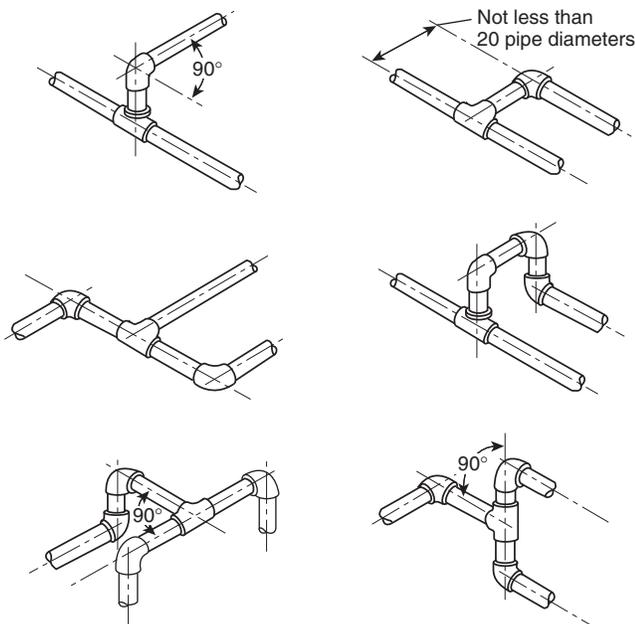

Δ FIGURE A.5.9.1(a) Illustrations of Acceptable Means of Piping into a Tee in a Dry Chemical System.

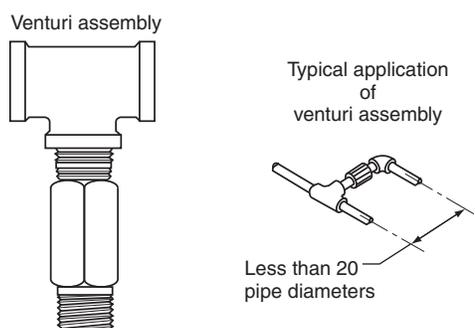


FIGURE A.5.9.1(b) Venturi Assembly.

A.6.1 Consideration should be given to the elimination of probable sources of re-ignition because the extinguishing action of a dry chemical flooding system is transient.

A.6.2.2.3 For fires in ordinary combustibles where multipurpose dry chemical should be used for protection, additional dry chemical applied by local application can be needed in order to adequately protect all exposed surfaces.

A.7.1 Examples of hazards that can be successfully protected by local application systems include dip tanks, quenching oil tanks, spray booths, oil-filled electrical transformers, vapor vents, and deep-fat fryers.

A.7.2.1 Protection of the entire hazard can require the combined use of local application and total flooding systems.

A.7.2.3 Examples of areas include areas subject to spillage, leakage, dripping, splashing, or condensation. Examples of associated materials include freshly coated stock, drainboards, hoods, and ducts.

A.7.2.4 CAUTION. Consideration should be given to the effects of wind or other stray air currents on the dry chemical discharge.

A.7.2.6 Coated surface areas are treated as if they were deep-layer flammable liquid areas because no distinction has been made in this standard.

A.8.2.1 In general, hand hose line stations should be located so that they are not exposed to the hazard.

A.8.3.1 An unusually low flow rate will cause the dry chemical to separate from the expellant gas while in the pipe, hose, or both, resulting in uneven flow from the nozzle.

A.8.3.3 Operation of hand hose line systems depends on manual actuation and manipulation of a discharge nozzle. Speed and simplicity of operation are essential.

A.9.1.1 Pre-engineered systems can have special limitations, flow rates, and methods of application that differ from the requirements specified in Chapters 4 through 8 of this standard.

A.9.3 This section has been retained in the event that a new dry chemical system is compliant with the listing standard.

A.9.3.4 One example of each acceptable method for the protection of common exhaust ducts is presented in the figures in A.9.3.4.1(1) and A.9.3.4.1(2). These figures are not intended to be all-inclusive. For additional guidance, consult the system manufacturer.

A.9.3.4.1(1) Separate cooking appliance, hood, and branch duct systems are interconnected so that they operate simultaneously.

Scenario: A fire is detected by System A. System A, protecting cooking appliances, a hood, and a branch duct, is operated. Simultaneously, Systems B, C, D, and E are also actuated. Shutdown of all appliances is in accordance with 9.3.5. [See Figure A.9.3.4.1(1).]

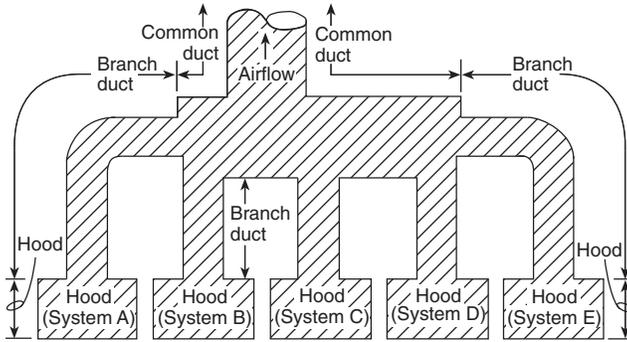


FIGURE A.9.3.4.1(1) Simultaneous Operation of All Systems.

A.9.3.4.1(2) Separate cooking appliances, the hood or branch duct system, and the system protecting the entire common exhaust duct operate simultaneously.

Scenario (a): System 1 protecting the entire common exhaust duct is separate from Systems A, B, C, D, and E. A fire is detected in System A. System A and System 1 are operated simultaneously. Shutdown of all appliances protected by Systems A, B, C, D, and E is in accordance with 9.3.5. [See Figure A.9.3.4.1(2)(a).]

Scenario (b): System E also provides protection for the entire common exhaust duct. A fire is detected in System C. System C and System E operate simultaneously. Shutdown of all appliances protected by Systems A, B, C, D, and E is in accordance with 9.3.5. [See Figure A.9.3.4.1(2)(b).]

Scenario (c): System E also provides protection for the entire common exhaust duct. A fire detected in System E will result in the actuation of System E only. Shutdown of all appliances protected by Systems A, B, C, D, and E is in accordance with 9.3.5. [See Figure A.9.3.4.1(2)(c).]

A.9.3.5 Exhaust fans do not need to be shut down or to have dampers closed upon system actuation, since the systems have been tested under both zero and high-velocity flow conditions.

A.9.3.5.2 The fire-extinguishing systems have been tested under both zero and high velocity; therefore, the exhaust fans and dampers need not shut down upon actuation of the fire-extinguishing systems.

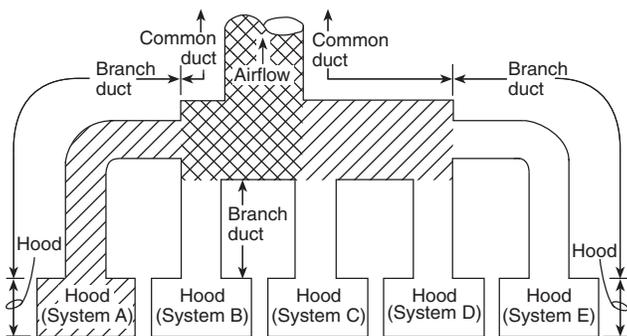


FIGURE A.9.3.4.1(2)(a) Simultaneous Operation of a Single Cooking Appliance, Hood, or Branch Duct System and the System Protecting the Common Duct.

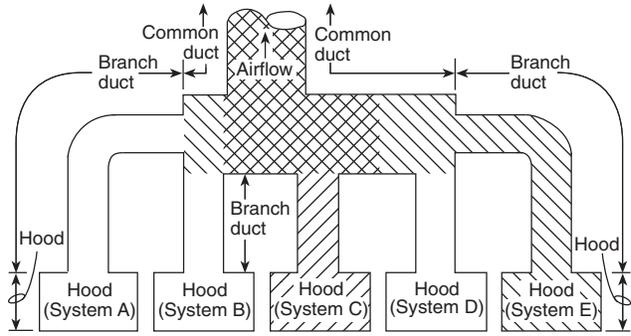


FIGURE A.9.3.4.1(2)(b) Simultaneous Operation of Two Systems in Which One Also Provides Common Duct Protection.

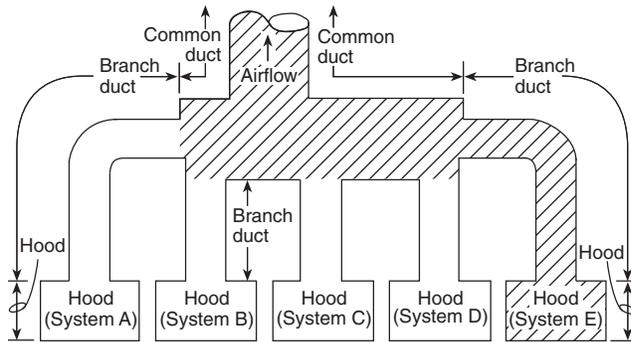


FIGURE A.9.3.4.1(2)(c) Independent Operation of a System That Protects a Hood and the Common Duct.

A.9.7.2 It is recommended that system design and installation personnel be certified in accordance with the manufacturer's requirements. It is standard industry practice to provide expiration dates on training certificates.

A.9.8 Suitable means should be provided to contain a fuel spill within the protected area. See NFPA 30.

A.9.9.1 For information on mobile surface mining equipment, see NFPA 120. For information on mobile mining equipment, see NFPA 122.

A.10.4.3.1 The test is intended to verify that flow is continuous and that the piping and nozzles are reasonably unobstructed. The nitrogen or dry air should be introduced into the piping network at the extinguishing agent container connection using a test cylinder or other suitable source. The quantity of nitrogen or dry air used for this test should be sufficient to verify that each nozzle is unobstructed. Nozzle flow should be verified at each discharge nozzle.

A.10.4.6 Figure A.10.4.6 is an example of an acceptance test report.

A.11.1.3 A reasonable program for qualification of service technicians is for an individual to pass a written or online examination. The test should contain a reasonable number of questions to challenge the individual's knowledge of the subject matter.

A.11.1.4 It is recommended that system maintenance personnel be certified as outlined in 11.1.3. It is standard industry practice to provide expiration dates on certificates.

A.11.1.5 Manufacturers of fire suppression system equipment should make available the manufacturer's design, installation, and maintenance manual and product safety bulletins to the authority having jurisdiction upon request.

A.11.1.6.1 The characteristics of the system should be dependent on the composition of the dry chemical and the type of expellant gas, as well as other factors.

A.11.3.1 Regular service contracts are recommended.

A.11.3.1.1(3) The following methods can be used for verifying that the piping is not obstructed:

- (1) Disassembly of all piping
- (2) Purging of piping with nitrogen or dry air
- (3) Utilizing methods recommended by the manufacturer

A.11.3.1.3.1 In addition to the required tag or label, a permanent file record should be kept for each fire extinguisher. This file record should include the following information, as applicable:

- (1) Maintenance date and the name of the person and the agency performing the maintenance
- (2) Date of the last recharge and the name of the person and the agency performing the recharge
- (3) Hydrostatic retest date and the name of the person and the agency performing the hydrostatic test
- (4) Description of dents remaining after passing of the hydrostatic test
- (5) Date of the 6-year maintenance for stored-pressure dry chemical and halogenated agent types (See 7.3.6 of NFPA 10.)

It is recognized that an electronic bar coding system is often acceptable to the authority having jurisdiction in lieu of a tag or label for maintenance record keeping.

Under special circumstances, or when local requirements are in effect, additional information can be desirable or required.

[10:A.7.3.4]


Δ A.11.3.1.3.5 A verification-of-service collar is installed to show that a cylinder has been depressurized, the valve has been removed, and a complete maintenance has been performed. The verification-of-service collar design also requires that the valve be removed before the collar can be attached to the cylinder. The collar provides the authorities having jurisdiction with a convenient visual proof that the cylinder has been disassembled and that maintenance most likely has been performed.

All cylinders are to have the valve removed for hydrostatic testing and are to be subsequently recharged before they are returned to service. To be valid, the date on the verification-of-service collar should always be the same as or more recent than the date on the hydrostatic test label.

Figure A.11.3.1.3.5 provides a guide to the design of a verification-of-service collar.

A.11.3.1.5 A discharge of the dry chemical should not be part of this test.

N A.11.3.1.6 An impairment is any condition where a system, component of a system, or function of a system does not perform as intended in a fire event. A condition such as the failure of any actuation component, mechanical device, electrical device, detector, container, pipe, hose, fitting, or nozzle to

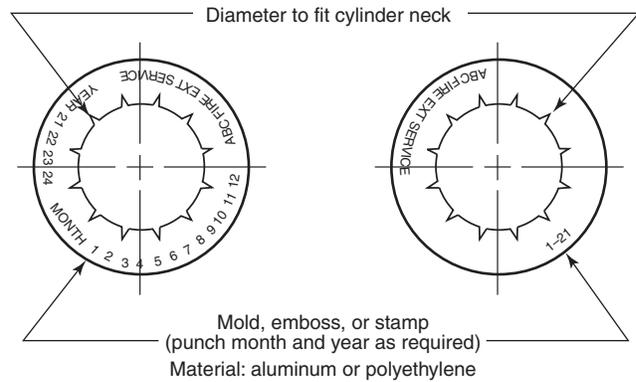

Δ FIGURE A.11.3.1.3.5 Design of a Verification-of-Service Collar.

perform its intended function is considered to be an impairment.

A.11.3.1.7 Defective pressure regulators can impair performance and compromise the operational integrity of the system. Because field adjustments cannot correct internal diaphragm and seating problems, a defective regulator must be replaced with a new regulator or sent to a factory-authorized regulator rebuilding facility for repair, in accordance with 11.3.1.7.1.

A.11.3.1.8 Pressure verification checks on auxiliary pressure cylinders not only ensure the functional operation of the pressure source discharge valve but also help verify that there is sufficient pressure to properly operate the system.

A.11.3.1.10 Under special circumstances or when local requirements are in effect, additional information can be desirable or required.

A.11.3.2 The date of manufacture marked on fusible metal alloy temperature-sensing elements does not limit when they can be used. The intent of 11.3.2 is to require replacement of fusible metal alloy sensing elements that have been installed for up to 1 year in environments subjecting them to contaminant loading, such as grease in restaurant hoods and ducts, that could adversely affect their proper operation.

A.11.3.3 Fixed temperature-sensing or rate-compensated thermal detection devices other than metal alloy-type fusible links that are installed on mobile equipment used off-road should have their set point and/or rate of compensation confirmed annually using devices specified or approved by the system manufacturer or should be replaced every 3 years.

Fixed temperature-sensing or rate-compensated thermal detection devices other than metal alloy-type fusible links that are installed on mobile equipment used over the road should have their set point and/or rate of compensation confirmed annually using devices specified or approved by the system manufacturer or should be replaced every 6 years.

Fixed temperature-sensing or rate-compensated thermal detection devices other than metal alloy-type fusible links that are installed on mobile equipment that have been involved in a fire incident, have been subjected to flame contact, or exhibit scorch marks or other signs of excessive temperature should be replaced.