

NFPA 36

Solvent Extraction Plants

1993 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA Headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable Federal, State and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action which is not in compliance with applicable laws and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision — This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference — Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders or similar instruments. Any deletions, additions and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription — **A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and, (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rulemaking process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rulemaking powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rulemaking powers may apply for and may receive a special royalty when the public interest will be served thereby.

3. Scope of License Grant — The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing and Publication of NFPA Documents which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accepts any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

Errata

NFPA 36

Solvent Extraction Plants

1993 Edition

Reference: Figure 5-1

The Committee on Solvent Extraction Plants notes the following omission in the 1993 edition of NFPA 36, *Standard for Solvent Extraction Plants*.

1. Add the following key to Figure 5-1:

Key

1. 5-1.2, 5-1.4
2. 3-1.1
3. 3-1.2

4. 5-1.5, 5-1.5.1, 5-1.5.2, 5-4.1
5. 5-2.4.1
6. 5-5

Issue Date: July 16, 1993

Copyright © 1993 All Rights Reserved
NATIONAL FIRE PROTECTION ASSOCIATION

CHARLES S. MORGAN LIBRARY
NATIONAL FIRE PROTECTION ASSOCIATION
1 BATTERYMARCH PARK
QUINCY, MA 02269-9101

Copyright © 1993 NFPA, All Rights Reserved

NFPA 36
Standard for
Solvent Extraction Plants
1993 Edition

This edition of NFPA 36, *Standard for Solvent Extraction Plants*, was prepared by the Technical Committee on Solvent Extraction Plants, released by the Correlating Committee on Flammable Liquids, and acted on by the National Fire Protection Association, Inc. at its Fall Meeting held November 16-18, 1992, in Dallas, Texas. It was issued by the Standards Council on January 15, 1993, with an effective date of February 12, 1993, and supersedes all previous editions.

The 1993 edition of this document has been approved by the American National Standards Institute.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

Origin and Development of NFPA 36

This standard was developed at the request of the solvent extraction industry in an effort to achieve greater uniformity in fire protection practices for extraction plants. The purpose of this standard is to provide reasonable standards for the design and operation of solvent extraction processes and extraction plants.

NFPA 36 was tentatively adopted at the 1957 Annual Meeting of the Association. A revision of this tentative edition was adopted at the 1958 Annual Meeting. NFPA 36 was officially adopted by the Association at its 1959 Annual Meeting. Amendments were adopted in 1962, 1964, 1967, 1972, 1973, 1974, 1978, 1983, 1985, and 1988.

This 1993 edition of NFPA 36 incorporates the following amendments to the previous edition:

- A complete rewrite of the Scope of the document to eliminate inconsistencies and potential misapplication of the document to alcohol-based extraction processes.
- Addition of appropriate statements to Chapter 1, General, to address equivalency and retroactivity.
- A complete editorial rewrite of Chapter 1 to comply with NFPA's Manual of Style.
- A complete revision of Subsection 3-1.2, Bulk Solvent Storage Tanks, to address the need for more explicit requirements for aboveground storage tanks.
- An amendment to Paragraph 5-2.7.1 to achieve greater flexibility in siting of cooling towers having fill of limited-combustible materials.
- Amendments to Paragraphs 5-8.2.3 and 5-8.2.4 to clarify the purpose of the vapor seal on the extractor and to recognize that a single seal is adequate in most cases.
- A complete rewrite of Appendix B, General Description of Solvent Extraction Process, to reflect current practices and technology in the industry.
- A complete rewrite of Appendix C, Operational Practices, to reflect current industry practices and certain rules of the U.S. Occupational Safety and Health Administration.

Committee on Flammable Liquids

Correlating Committee

Leon C. Schaller, *Chairman*
E. I. du Pont de Nemours & Co., DE

Robert P. Benedetti, *Secretary*
National Fire Protection Assn., MA
(nonvoting)

John J. Hawley, Underwriters Laboratories Inc., IL
Donald M. Johnson, San Bruno, CA
C. L. Kingsbaker, Jr., Atlanta, GA
Steven Landon, Trophy Club, TX

Eugene S. Schmitt, Dept. of State Police, MI
Orville M. Slye, Jr., Loss Control Assoc. Inc., PA
W. J. Smith, Underwriters Laboratories Inc., IL

Nonvoting

Paul C. Lamb, Englewood, NJ
(Member Emeritus)

Technical Committee on Solvent Extraction Plants

C. L. Kingsbaker, Jr., *Chairman*
Atlanta, GA

George Eli Anderson, Crown Iron Works Co., MN
Frederick L. Deacon, Kemper Nat'l Insurance Cos., IL
John E. Heilman, Continental Grain Co., NY
Rep. NOPA
Richard P. McEnroe, Mill Mutuals, IL
La Rue Medders, Lloyds New York, OK
N. Hunt Moore, N. Hunt Moore & Assoc. Inc., TN
Thomas D. Phillips, Southern Cotton Oil Co., TX
Rep. Nat'l Cottonseed Products Assn.

Harold J. Sandvig, Cargill Inc. Corporate Safety, MN
Rep. Corn Refiners Assn. Inc.
Danny P. Stegall, Jackson Fire Dept., MS
William A. Thornberg, Industrial Risk Insurers, IL
Rep. Industrial Risk Insurers
Leslie R. Watkins, Texas A&M, TX
Rep. Int'l Oil Mill Superintendents Assn.

Alternates

George W. Moore, Industrial Risk Insurers, CT
(Alt. to W. A. Thornberg)
Kenneth C. Poe, Kemper Nat'l Insurance Cos., KS
(Alt. to F. L. Deacon)

Frank J. Potucek, Mill Mutuals, IL
(Alt. to R. P. McEnroe)
Martin Reed, Archer-Daniels-Midland Co., IL
(Alt. to T. D. Phillips)

Robert P. Benedetti, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on criteria for safeguarding against the fire and explosion hazards associated with the design, construction, and operation of extraction plants.

Contents

| | | | |
|---|--------------|---|--------------|
| Foreword | 36- 4 | 3-4 Fire Protection Equipment | 36- 9 |
| Chapter 1 General | 36- 4 | 3-5 Unloading Procedures | 36- 9 |
| 1-1 Scope | 36- 4 | Chapter 4 Preparation Process | 36- 9 |
| 1-2 Purpose | 36- 4 | 4-1 Application | 36- 9 |
| 1-3 Equivalency | 36- 4 | 4-2 Construction of Building | 36- 9 |
| 1-4 Retroactivity and Applicability to Existing Plants | 36- 4 | 4-3 Electricity | 36- 9 |
| 1-5 Units | 36- 5 | 4-4 Dust Removal | 36- 9 |
| 1-6 Definitions | 36- 5 | Chapter 5 Extraction Process | 36-10 |
| Chapter 2 Basic Rules | 36- 6 | 5-1 Location of Extraction Process | 36-10 |
| 2-1 General Requirements | 36- 6 | 5-2 Construction of Extraction Process | 36-10 |
| 2-2 Emergency Procedures | 36- 6 | 5-3 Ventilation of Extraction Buildings | 36-12 |
| 2-3 Repairs in Restricted and Controlled Areas When Plant Is in Operation or Unpurged | 36- 7 | 5-4 Ignition Sources and Heating | 36-12 |
| 2-4 Repairs in Restricted and Controlled Areas When Plant Is Shut Down and Purged | 36- 7 | 5-5 Electricity | 36-12 |
| 2-5 Extractor Start-up | 36- 7 | 5-6 Static Electricity | 36-12 |
| 2-6 Solvent Transfer Equipment | 36- 7 | 5-7 Lightning Protection | 36-12 |
| 2-7 Piping, Valves, and Fittings | 36- 7 | 5-8 Process Equipment | 36-12 |
| 2-8 Controls | 36- 8 | 5-9 Flammable Vapor Detection | 36-14 |
| 2-9 Exits | 36- 8 | Chapter 6 Referenced Publications | 36-14 |
| 2-10 Fire Protection | 36- 8 | Appendix A | 36-14 |
| Chapter 3 Bulk Solvent Unloading and Storage | 36- 8 | Appendix B General Description of Solvent Extraction Process | 36-15 |
| 3-1 Location | 36- 8 | Appendix C Operational Practices | 36-21 |
| 3-2 Design and Construction | 36- 8 | Appendix D Referenced Publications | 36-22 |
| 3-3 Sources of Ignition | 36- 9 | Index | 36-23 |

NFPA 36**Standard for****Solvent Extraction Plants****1993 Edition**

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 6 and Appendix D.

Foreword

In the preparation of this standard the members of the Committee recognized some fundamental differences between the operation of solvent extraction plants and the processing of solvents in other facilities.

Many extraction plants are relatively small units in isolated locations operated without the benefit of overall fire protection measures such as usually are customary in large solvents processing installations.

The operator of an extraction plant must establish and maintain firesafety *esprit de corps* among a small number of employees as opposed to relying on established customs in large-scale operations.

There are certain inherent hazards in the combining and separating of solids and solvents that are peculiar to this industry. Also serving as a complicating problem is the potential dust explosion hazard in some areas of a typical plant. Therefore, it was felt desirable to give consideration to practices that would be applicable to either potential dust-laden or flammable vapor atmospheres.

Chapter 1 General**1-1 Scope.**

1-1.1 This standard shall apply to the commercial scale extraction processing of animal and vegetable oils and fats by the use of Class I flammable hydrocarbon liquids, hereinafter referred to as "solvents." (See Section 1-6 for definitions of terms, including those of "extraction process" and "solvent.")

1-1.2 This standard shall also apply to any equipment and buildings that are located within 100 ft (30 m) of the extraction process.

Exception: As provided for in 1-1.3, 1-1.4, and 1-1.5.

1-1.3 This standard shall also apply to the unloading, storage, and handling of solvents, regardless of distance from the extraction process.

1-1.4 This standard shall also apply to the means of conveying material to be extracted from the preparation process to the extraction process.

1-1.5 This standard shall also apply to the means of conveying extracted desolventized solids and oil from the extraction process.

1-1.6 This standard shall not apply to the storage of raw materials or finished products. (See NFPA 61B, *Standard for the Prevention of Fires and Explosions in Grain Elevators and Facilities Handling Bulk Raw Agricultural Commodities*.)

1-1.7 This standard shall not apply to extraction processes that use liquids that are miscible with water.

1-1.8 This standard shall not apply to extraction processes that use flammable gases, liquefied petroleum gases, or nonflammable gases.

1-1.9 This standard shall prohibit the use of processes that employ oxygen-active compounds that are heat or shock sensitive, such as certain organic peroxides, within the area defined in 1-1.2.

1-2 Purpose. The purpose of this standard is to provide:

(a) Reasonable requirements for the design, construction, and operation of extraction processes that utilize Class I flammable hydrocarbon liquids;

(b) Reasonable requirements for the prevention of fire and explosion in extraction processes;

(c) A means by which plant fire protection and supervisory personnel may evaluate the processes and operations under their control;

(d) Guidance to regulatory and inspection officials in determining whether a given facility is being operated in accordance with good practice;

(e) A workable set of standards for the use of design engineers, architects, and others in the planning and designing of new installations.

1-3 Equivalency. Nothing in this standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, or safety over those prescribed by this standard, provided that technical documentation is submitted to the authority having jurisdiction to demonstrate equivalency and the system, method, or device is approved for the intended purpose.

1-4 Retroactivity and Applicability to Existing Plants.

1-4.1 The provisions of this standard shall apply to all extraction plants. Existing plants that comply with the NFPA standards in effect at the time of construction shall be considered to be in compliance with this standard, provided they do not constitute a recognized hazard to life or adjacent property, as determined by the authority having jurisdiction.

1-4.2 Modifications shall comply with the standard in effect at the time the modifications are made. When modifications adversely affect the intended function or the adequacy of other systems of the existing plant, those affected systems shall be upgraded consistent with good engineering practices and the provisions of this standard.

1-4.3 Modifications shall not be prohibited because of space limitations, provided the modifications comply with the provisions of 5-1.6.

1-5 Units. Metric units of measurement given in this standard are in accordance with the International System of Units (SI), with the exception of two units (kilogram and square centimeter) that are outside of but recognized by SI and that are commonly used in fire protection engineering. Where measured values are given in two units, the first stated is to be regarded as the requirement and the second (stated parenthetically) is its approximate equivalent. The metric equivalents given in this standard have been calculated by multiplying the stated value by the conversion factor, then rounding to the appropriate significant figure.

1-6 Definitions.

Approved. Acceptable to the "authority having jurisdiction."

NOTE: The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations which is in a position to determine compliance with appropriate standards for the current production of listed items.

Authority Having Jurisdiction. The "authority having jurisdiction" is the organization, office or individual responsible for "approving" equipment, an installation or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public safety is primary, the "authority having jurisdiction" may be a federal, state, local or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many circumstances the property owner or his designated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Class I Flammable Liquid. Any liquid having a flash point below 100°F (37.8°C) and having a vapor pressure not exceeding 40 psia (2068 mm Hg) at 100°F (37.8°C).

Condensate. Any material that has been condensed from the vapor state to the liquid state.

Condenser. A piece of equipment that lowers the temperature of a vapor to the point where it changes to a liquid.

Controlled Area. Any area that is more than 50 ft (15.3 m) but less than 100 ft (30.5 m) from the solvent extraction process, as measured horizontally.

Conveyor. Equipment that transports material from one point to another either pneumatically or mechanically, by means of a moving belt, a chain, buckets, or flights.

Desolventized Material. Material from which all absorbed solvent has been removed.

Desolventizer. Equipment that removes the absorbed solvent from the material being processed.

Evaporator. Equipment that vaporizes the solvent from the oil-bearing miscella.

Extraction Process. The operations involving the extractor and the desolventizer, together with pertinent equipment such as heat exchangers, evaporators, and strippers, and which are contained in an enclosed building or in an open structure.

Extractor. Equipment that removes oil and fat from oil- or fat-bearing material by means of a suitable solvent.

Flakes. Oil- or fat-bearing material that has been rolled in preparation for the extraction process.

Flaking Mill. A piece of equipment that utilizes smooth rollers to prepare material for the extraction process.

Flame Arrester. An approved device that effectively prevents flame ignition of flammable vapors on one side when the other side is exposed to a source of ignition.

Heat Exchanger. Equipment that transfers heat from one vapor or liquid to another vapor or liquid.

Hydrocarbon. A chemical substance consisting of only hydrogen and carbon atoms.

Inert Gas. A noncombustible, nonreactive gas that renders the combustible material in a system incapable of supporting combustion.

Inerting. A technique by which a combustible mixture is rendered nonignitable by the addition of an inert gas.

Labeled. Equipment or material to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the "authority having jurisdiction", is concerned with product evaluation, maintains periodic inspection of production of labeled equipment or material, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

Listed. Equipment or materials included in a list published by an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The "authority having jurisdiction" should utilize the system employed by the listing organization to identify a listed product.

Miscella. A mixture, in any proportion, of extracted oil or fat and the extracting solvent.

Preparation Process. The operations involving the equipment used for the preparation of the material for the extraction process.

Purging. The process of displacing flammable vapors from buildings, equipment, or piping.

Restricted Area. The area within 50 ft (15.3 m) horizontally of the extraction process.

Separation Sump. A containment basin that is used to separate oils, miscella, or solvent from water. Its principle of operation is based on the immiscibility of the liquids and their differing densities.

Solvent. Any Class I flammable hydrocarbon liquid that has the ability to extract oils or fats from animal or vegetable material.

Spent Material. Material from which the oil or fat has been extracted, but which has not been desolventized. (Also referred to as "extracted material.")

Stripper. A distillation column or tower, usually operated under vacuum, that is used to remove residual solvent from the extracted oil or fat.

Toaster. Equipment that is capable of producing the desired cooking, toasting, and modification of protein by means of heat and moisture.

Vapor Recovery. The process of reclaiming solvent by means of condensation or absorption.

Vapor Scrubber. A device used to wash entrained dust from a vapor stream by means of a liquid spray.

Vapor Seal. Equipment or material that prevents the escape of solvent vapors from process equipment or conveyors.

Chapter 2 Basic Rules

2-1 General Requirements.

2-1.1 Safe operating practices, including but not limited to start-up and shut-down procedures, shall be the responsibility of management operating the extraction plant.

2-1.2 Operating and maintenance employees shall be instructed in plant operations in general.

2-1.3 Applicable plant regulations shall apply to all visitors and others who may enter the plant, both during operating periods and during shut-down periods. Further information on the control of visitors may be found in Appendix C.

2-1.4 When necessary to make repairs to the plant, the work shall be authorized by the individual in responsible charge of the plant before the work is started. (See Appendix C for a suggested safety work permit.)

2-1.5 Sources of Ignition.

2-1.5.1 Electrical installations shall conform to the requirements of NFPA 70, *National Electrical Code*®, as hereinafter specified.

2-1.5.2 Provisions shall be made for protection against static electricity and lightning as required in other chapters of this standard.

2-1.5.3 There shall be no smoking or other sources of ignition within the restricted and controlled areas. Lighters and matches shall not be carried into the restricted or controlled areas of the extraction plant.

2-1.5.4 Powered vehicles, unless approved for such locations, shall be prohibited within the controlled or restricted area except by special permission of the individual in responsible charge of the plant.

2-1.6 Housekeeping.

2-1.6.1 Flammable liquids not contained in process equipment shall not be stored in the extraction process area except small quantities which shall be stored in approved safety cans.

2-1.6.2 Waste materials such as oily rags, other wastes, and absorbents used to wipe up solvent, paints, and oils, shall be deposited in approved waste cans and removed from the premises not less than once each day.

2-1.6.3 Dust originating from material in process shall be kept to a minimum.

2-1.6.4 Except as provided in 5-2.7.2, the space within the restricted and controlled areas shall be kept completely free of dry grass, weeds, trash, and all combustible materials. Any spills of oil, solvent, or deposits of solvent-bearing material shall be cleaned up immediately and removed to a safe place. The discharge or removal of solvent-bearing material shall be recognized as a severe hazard and operating procedures established to minimize such occurrences.

2-2 Emergency Procedures.

2-2.1 All employees shall be trained in the necessary action to be taken in time of emergency, including emergency shut-down procedures.

2-2.2 Personnel shall be thoroughly indoctrinated as to the location of exits.

2-2.3 All personnel shall be thoroughly trained in the use of and limitations of each type of fire fighting equipment on the premises, including control valves for the water spray systems.

2-2.4 A fire brigade, if established, shall be composed of selected personnel on each shift and shall be trained as a unit with each person assigned definite responsibilities in case of an emergency.

2-2.5 Periodic drills shall be held in order that employees will carry out the above procedures.

2-2.6 Emergency safety devices or systems provided in the plant shall be periodically tested in accordance with established procedures, and a record made thereof.

2-3 Repairs in Restricted and Controlled Areas When Plant Is in Operation or Unpurged.

2-3.1 Power Tools. Maintenance operations involving the use of power tools that may produce sources of ignition shall be prohibited.

2-3.2 Electrical Equipment. Repairs on live electrical wiring or equipment shall be prohibited. If necessary to replace or repair electrical wiring or equipment, the power shall be completely disconnected, and the switch locked in an open position.

2-3.3 Welding and Cutting Operations. Welding and cutting, including brazing and soldering operations, shall be prohibited.

2-4 Repairs in Restricted and Controlled Areas When Plant Is Shut Down and Purged.

2-4.1 Repairs or alterations to equipment or buildings that may produce ignition sources shall be performed only when the plant has been shut down and completely purged, and declared safe by the individual in responsible charge. (*See Appendix C for a suggested work permit form.*)

2-4.2 Prior to initiating purging the following steps shall be taken:

(a) Tanks, vessels, piping, and traps shall be emptied of all materials. All such material shall be removed to a safe location.

(b) All piping and other connections to storage facilities shall be disconnected, plugged, or blanked off.

2-4.3 Purging shall be accomplished by one or a combination of the following methods:

(a) Vapor freeing shall be permitted to be accomplished by the introduction of steam into the equipment. The equipment shall be adequately vented to prevent damage from excessive pressure or vacuum. Steam supply lines shall be bonded to the equipment. The rate of supply of steam shall exceed the rate of condensation so that the equipment is heated close to the boiling point of water. The equipment shall be steamed long enough to vaporize the residues from all portions. After the steaming, the procedures outlined in 2-4.3(b) shall be followed when hot work is to be performed.

(b) Vapor freeing shall be permitted to be accomplished by purging with air, and a safe atmosphere may be sustained by continued ventilating. When fixed ventilating equipment is not provided, air movers may be attached so that air is drawn in and discharged through the air mover, or air may be introduced through the air mover and discharged through another opening. Discharge shall be to a safe location. Air movers shall be approved for such locations. In air purging, the concentration of vapor in air usu-

ally will go through the flammable range before a safe atmosphere is obtained; therefore, precautions shall be taken to ensure that the air mover is bonded to the equipment in order to minimize the hazard of ignition by static electricity.

(c) Vapor freeing shall be permitted to be accomplished by purging with inert gas and then ventilating with air, which minimizes the hazards inherent to passing through the flammable range.

2-4.4 To ensure a safe condition, tests for flammable vapors shall be made with a combustible gas indicator: (1) before commencing alterations or repairs, including welding, cutting, or heating operations; (2) immediately after starting any welding, cutting, or heating operations; and (3) frequently during the course of such work. All such work shall be stopped immediately when the presence of flammable vapor is indicated. The source of the vapor release shall be located and removed, and the tests described in this subsection shall be repeated before such work is recommenced.

2-4.5 Upon completion of repairs or alterations the plant shall be checked by the individual in responsible charge to see that operations may be resumed safely. (*See 2-5.*)

2-5 Extractor Start-up. Procedures for extractor start-up shall be established to minimize the hazard incident to passing through the flammable range. This may be accomplished by inerting to reduce the oxygen content.

2-6 Solvent Transfer Equipment.

2-6.1 Pumps shall be designed for the solvent, the working pressures, and the structural stresses to which they will be subjected.

2-6.2 The use of air pressure as the solvent transferring medium shall be prohibited.

2-6.3 Where practicable all pumps handling solvent in the processing equipment shall be located on the first floor level.

2-6.4 Pump houses, if used, shall be of noncombustible construction and ventilated.

2-7 Piping, Valves, and Fittings.

2-7.1 General. All piping, valves, and fittings shall be designed for the working pressures and structural stresses to which they will be subjected. They shall be of steel or other material approved for the service intended.

2-7.2 Pipe Systems. Pipe systems shall be substantially supported and protected against physical damage caused by expansion, contraction, and vibration.

2-7.3 Process Piping.

2-7.3.1 Piping shall be pitched to drain to avoid trapped liquids, or suitable drains shall be provided. Armored hose shall be permitted to be used where vibration exists or where frequent movement is necessary.

2-7.3.2 Aboveground solvent pipe sections 2 in. (50 mm) in size or over shall be welded and flanged. Welding shall conform to good welding practice.

2-7.4 Drain Valves. Drain valves shall be provided with plugs to prevent leakage.

2-7.5 Pipe Connections. Pipe connections, 2 in. (50 mm) and over, to all tanks and vessels shall be bolted flanges that can be opened and blanked off.

2-7.6 Testing. After installation and before covering or painting, all piping systems, including suction lines, shall be pressure tested to not less than $1\frac{1}{2}$ times the working pressure but not less than 5 psi (0.4 kg/cm²) at the highest point in the system. Tests shall continue for not less than 30 minutes without noticeable drop in pressure.

Exception: Vapor lines operating at less than 20 in. (50 cm) of water column.

2-7.7 Identification of Piping and Equipment. All piping and equipment shall be coded for identification.

2-8 Controls.

2-8.1 Unless solvent tanks are equipped with adequate overflow return lines, solvent flow from bulk storage to the work tank or from the work tank to bulk storage shall be remotely controlled by momentary switches or by other devices that provide for "dead man" controls to prevent overfilling of tanks.

2-8.2 Positive displacement pumps shall be provided with bypasses with pressure relief valves discharging back to the tank or to the pump suction.

2-9 Exits. An extraction building or open process structure over two stories in height shall be provided with at least two remotely located means of egress from each floor, one of which shall be enclosed or separated from the process by a wall which is blank except for doors. The enclosure or separating wall shall be of masonry or other noncombustible construction. Self-closing noncombustible doors, normally kept closed, shall be provided for access to the protected stairway.

2-10* Fire Protection.

2-10.1 An approved water spray, deluge or foam-water system, or a combination of these types of fixed protection systems shall be provided to protect the extraction process equipment and structure. (See NFPA 13, *Standard for the Installation of Sprinkler Systems*; NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*; and NFPA 16, *Standard on the Installation of Deluge Foam-Water Sprinkler and Foam-Water Spray Systems*.)

2-10.2 An approved system of automatic sprinklers shall be provided in the preparation building when within 100 ft (30.5 m) of extraction process. (See NFPA 13, *Standard for the Installation of Sprinkler Systems*.)

2-10.3 A system of yard hydrants shall be provided in accordance with accepted good practice. (See NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*.)

2-10.4 Approved portable fire extinguishers of appropriate size and type shall be provided. (See NFPA 10, *Standard for Portable Fire Extinguishers*.)

2-10.5 Where standpipe and hose protection is installed, combination water fog and straight steam nozzles shall be provided. (See NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*.)

2-10.6 Where explosion prevention systems are installed, they shall be installed in accordance with the provisions of NFPA 69, *Standard on Explosion Prevention Systems*.

2-10.7 Fire alarm signals shall be relayed or sent to a constantly supervised point on or off the premises.

2-10.8 Where service is available a public fire alarm box shall be located nearby.

Chapter 3 Bulk Solvent Unloading and Storage

3-1 Location.

3-1.1 Unloading Site. These sites shall be located so that ignition sources presented by locomotives or tank vehicles are at least 100 ft (30.5 m) from the extraction process and shall be at least 25 ft (7.6 m) from a building or any property line that is or can be built upon. The fill connection to the storage tank shall be at least 25 ft (7.6 m) from the extraction process.

3-1.2 Bulk Solvent Storage Tanks.

3-1.2.1 Bulk solvent storage tanks shall be located outside of any building.

3-1.2.2 Underground solvent storage tanks shall be located at least 1 ft (0.3 m) from any building foundation or support and at least 3 ft (0.9 m) from the nearest property line that is or can be built upon. The loads carried by the building foundations or supports shall not be transmitted to the tanks.

3-1.2.3 Aboveground solvent storage tanks shall be located:

(a) Within the restricted area, at least 25 ft (7.6 m) from the extraction process and at least 25 ft (7.6 m) from any important building; or

(b) Within the controlled area, at least 25 ft (7.6 m) from any important building and at least 25 ft (7.6 m) from any property line that is or can be built upon; or

(c) Outside the controlled area, at least 25 ft (7.6 m) from any important building and at least 25 ft (7.6 m) from any property line that is or can be built upon.

3-1.2.4 Aboveground storage tanks shall be enclosed by a fence, i.e., within the fence already provided for in the restricted area or in a separate fenced area.

3-2 Design and Construction.

3-2.1 Unloading Stations. Unloading structures and platforms shall be constructed of noncombustible material and shall be designed and installed in accordance with accepted practice.

Tentative Interim Amendment

NFPA 36

Standard for Solvent Extraction Plants

1993 Edition

Reference: 1-1.6, 1-6, 4-1.1

TIA 93-1 (NFPA 36)

Pursuant to Section 4 of the NFPA Regulations Governing Committee Projects, the National Fire Protection Association has issued the following Tentative Interim Amendment to NFPA 36, *Standard for Solvent Extraction Plants*, 1993 edition. The TIA was processed by the Technical Committee on Solvent Extraction Plants, and was issued by the Standards Council on January 12, 1996, with an effective date of February 1, 1996.

A Tentative Interim Amendment is tentative because it has not been processed through the entire standards-making procedures. It is interim because it is effective only between editions of the standard. A TIA automatically becomes a proposal of the proponent for the next edition of the standard; as such, it then is subject to all of the procedures of the standards-making process.

1. Add a new Subsection 1-1.6 to read as follows:

1-1.6 This standard shall also apply to the preparation and meal finishing processes that are directly connected by conveyor to the extraction process, regardless of intervening distance.

2. Add a definition for Meal Finishing Area in Section 1-6 to read as follows:

Meal Finishing Area. The area that contains the equipment necessary to prepare the extracted and desolventized material for storage or shipment.

3. Revise Subsection 4-1.1 to read as follows:

4-1.1 The provisions of this chapter shall apply to preparation and meal finishing areas that are directly connected by conveyor to the extraction process, regardless of intervening distance.

3-2.2 Storage Tanks. Storage tanks shall be designed, constructed, installed, and tested in accordance with accepted good practice.

(For information on tank design and construction, venting, foundations and supports, installation of underground tanks, anchorage, spacing, dikes and walls for above-ground tanks, and testing of tanks see NFPA 30, *Flammable and Combustible Liquids Code*.)

3-3 Sources of Ignition.

3-3.1 Electrical Equipment. All electrical equipment and its installation shall conform to Class I Group C or D (depending on solvent used).

3-3.1.1 Where enclosures are provided that house solvent handling equipment such as solvent pumps or valves or in which solvents are transferred to individual containers, these enclosures shall be considered to be Division 1 locations.

3-3.1.2 In outdoor locations, areas adjacent to loading racks or platforms, or to aboveground tanks shall be considered to be Division II locations. Such areas shall be considered to extend 25 ft (7.6 m) horizontally from such racks or tanks, and upward from adjacent ground level to a height of 15 ft (4.6 m). (See NFPA 70, *National Electrical Code*.)

3-3.2 Static and Stray Currents.

3-3.2.1 All storage tanks, solvent transfer equipment, tank cars or tank trucks, and unloading structures shall be effectively bonded.

3-3.2.2 Transfer or storage tanks, unloading structures, tank cars, and tank trucks shall be electrically interconnected with supply piping or containers during the transfer of liquids.

3-3.2.3 Static protection shall be installed in accordance with accepted good practice. (See NFPA 77, *Recommended Practice on Static Electricity*.)

3-3.3 Smoking and open flames shall be prohibited, and appropriate "No Smoking" and "Keep Fire Away" signs shall be posted in conspicuous locations.

3-4 Fire Protection Equipment.

3-4.1 Approved portable fire extinguishers of appropriate size and type shall be provided. (See NFPA 10, *Standard for Portable Fire Extinguishers*.)

3-4.2 Additional fire protection for the unloading structure and bulk storage tanks shall be provided where an exposure hazard exists.

3-5 Unloading Procedures.

3-5.1 Adequate precautions shall be taken to relieve excessive pressure in cargo tanks before unloading.

3-5.2 Tank cars shall be unloaded in accordance with accepted good practice.

3-5.3 Tank vehicles for solvents shall be unloaded in accordance with accepted good practice. (See NFPA 385, *Standard for Tank Vehicles for Flammable and Combustible Liquids*.)

Chapter 4 Preparation Process

4-1 Application.

4-1.1 The provisions of this chapter shall apply to preparation processes located within 100 ft (30.5 m) of the extraction process.

4-1.2 Where the processing operations do not involve the generation of combustible dusts, 4-2.2 through 4-4.5 shall not apply.

4-2 Construction of Building.

4-2.1 The building shall be of fire-resistive or noncombustible construction and shall be without basement or pits below grade.

4-2.2 The building shall be designed to provide explosion relief of at least 1 sq ft (.1 m²) for each 50 cu ft (15 m³) of volume.

4-2.3 The roof and exterior wall construction shall provide explosion relief by one or more of the following methods:

- (a) Open air construction with a minimum area enclosed;
- (b) Light noncombustible walls and roof lightly attached to steel frame;
- (c) Light noncombustible wall panels and roof hatches;
- (d) Top hinged windows with explosion relief hatches.

(See NFPA 68, *Guide for Venting of Deflagrations*, for further information.)

4-2.4 Space heating, if required, shall be provided by indirect means. Temperatures on heated surfaces shall be limited to 250°F (121°C).

4-3 Electricity.

4-3.1 In areas where combustible dust presents a hazard, all electrical wiring and equipment shall conform to the requirements for Class II, Group G, Division 1 locations. (See NFPA 70, *National Electrical Code*.)

4-3.2 Static protection shall be provided in equipment located in areas where combustible dust presents a hazard. (See NFPA 77, *Recommended Practice on Static Electricity*.)

4-4 Dust Removal.

4-4.1 A dust collecting system shall be provided where necessary. (See NFPA 91, *Standard for Exhaust Systems for Air Conveying of Materials*.)

4-4.2 Dust collectors of the all-metal type shall be located outside of buildings or shall be equipped with exhaust stacks or ducts leading to the outside.

4-4.3 When fabric filters are used for the collection of dust, they shall be located either outside of the building or in a fire-resistive room along an outside wall inside the building. The inside room shall be explosion-resistant, and the outside walls or roof shall have explosion relief in the ratio of 1 sq ft of relief area for each 30 to 50 cu ft (1 m^2 of relief area for each 9 to 15 m^3) of room volume. (See NFPA 61C, *Standard for the Prevention of Fire and Dust Explosions in Feed Mills*.)

4-4.3.1 Automatic sprinklers shall be installed within fabric-type dust collector housings.

4-4.4 Dust accumulations on floors, ledges, structural steel members, machinery, spouting, and other surfaces shall be removed concurrently with operations. This shall be done by vacuum cleaning or by other means that will not suspend dust in the air.

4-4.5 The use of compressed air or other means to blow dust from ledges, walls, and other areas shall not be permitted unless all machinery in the area has been shut down, and all sources of ignition have been removed.

Chapter 5 Extraction Process

5-1 Location of Extraction Process.

5-1.1 The extraction process equipment shall be located in the open or in a building suitable for the purpose. (See Figure 5-1.)

5-1.2 An industrial-type fence shall be placed at a minimum of 50 ft (15.3 m) from the extraction process. A controlled area shall extend from 50 ft (15.3 m) to at least 100 ft (30.5 m) from the extraction process. The restricted and controlled areas shall be posted with signs around the perimeter warning of the possible flammable vapor hazard. All entrances and exits into the fenced area shall be secured to prohibit unauthorized entrance, and provision shall be made for emergency ingress and egress.

5-1.3 Basements, tunnels, pipe trenches, and pits, except separation sumps, shall be prohibited within 100 ft (30.5 m) of the extraction process.

5-1.4 Except as permitted in 5-1.5, the extraction process shall be at least 100 ft (30.5 m) from any public thoroughfare, any building, or any property line that is or can be built upon. The slope of the terrain and the prevailing winds shall be considered in locating the extraction process.

5-1.5 Structures and equipment essential to the operation of the extraction process, other than boilers and other open flame operations, shall be permitted to be located less than 100 ft (30.5 m) but more than 50 ft (15.3 m) from the extraction process, provided a vapor barrier erected in accordance with the following requirements is provided.

5-1.5.1 The barrier shall be located between the extraction process and the possible source of vapor ignition and at least 50 ft (15.3 m) from the extraction process.

5-1.5.2 The barrier shall be of noncombustible vaportight construction without gates or other openings. The barrier shall be at least 4 ft (1.3 m) in height and designed so that there is at least 100 ft (30.5 m) of vapor travel around its ends to possible sources of ignition.

5-1.6 Where the circumstances or conditions of any particular installation are unusual and such as to render the strict application of distances specified in this standard impractical, the authority having jurisdiction shall be permitted to allow such deviation as will provide an equivalent degree of safety and be consistent with good engineering practice. Factors having a bearing on this deviation could be topographical conditions, nature of occupancy and proximity to buildings on adjoining property, character of construction of such buildings, and adequacy of public fire protection facilities.

5-2 Construction of Extraction Process.

5-2.1 The building or structure shall be of fire-resistive or noncombustible construction with the first floor at or above grade. All solid sections of upper floors of the extraction process and concrete pads under the entire extraction process shall be curbed and sloped to drain and shall be directly connected to an outside separation sump. Drainage lines under the ground floor slab of the extraction process are prohibited.

5-2.2 Explosion relief of at least 1 sq ft for each 50 cu ft (1 m^2 for each 15 m^3) of volume shall be provided by one or more of the following methods:

- (a) Open air construction with a minimum area enclosed;
- (b) Light noncombustible walls and roof lightly attached to steel frame;
- (c) Light noncombustible wall panels and roof hatches;
- (d) Top hinged windows with explosion relief latches.

(See NFPA 68, *Guide Venting of Deflagrations*, for further information.)

5-2.3 Provisions shall be made for the safe discharge of solvent from the process area to guard against the introduction of solvent into sewer systems.

5-2.4 A sump shall be provided to effect separation of water from oil, solvent, or miscella.¹

5-2.4.1 The separation sump shall be located within the restricted area but not closer than 25 ft (7.6 m) to the fence surrounding the restricted area.

5-2.4.2 The sump shall be concrete or of equivalent noncombustible construction, and influent and effluent lines shall be trapped.

¹In the event of flow of fire protection water, complete separation of water from oil, solvent, or miscella might not occur.

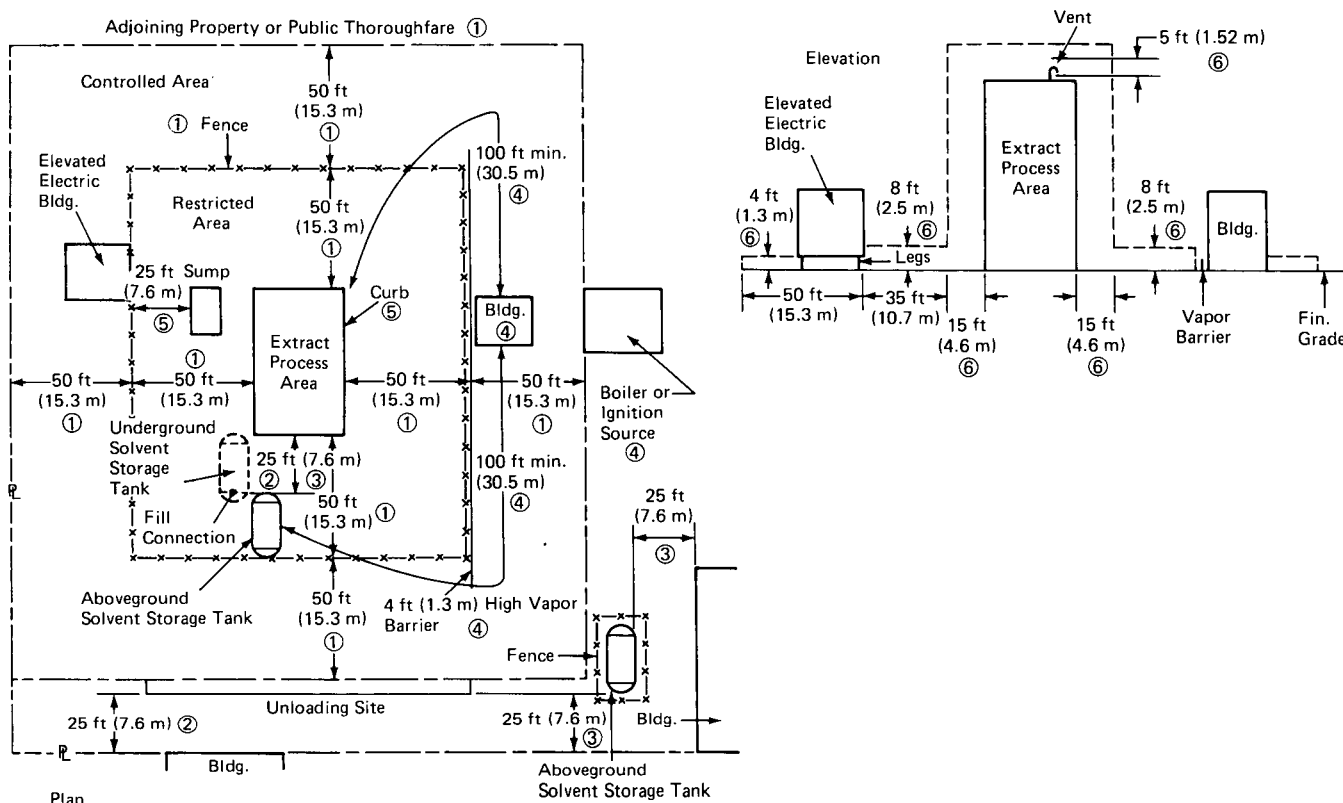


Figure 5-1 A Typical Distance Diagram.

5-2.4.3 The sump shall consist of two or more sections, the largest of which shall be sized to retain all solvent, miscella, and oil that could be released by a single break in a vessel or piping, plus an additional 50 percent of this amount.

5-2.4.4 An emergency means shall be provided to prevent the outflow of solvent, miscella, or oil from the sump to the sewer system.

5-2.4.5 A pump shall be provided to recover oil, solvent, or miscella collected in the sump.

5-2.4.6 Approved fixed automatic fire protection shall be provided above the separation sump.

5-2.5 Conveyors and spouts from or to other buildings shall be located and protected to prevent passage of solvent vapors to other areas. This shall be accomplished by one or a combination of the following methods:

(a) For other than pneumatic conveyors: by providing on the extraction end continuous air aspiration to the outside, with a visual and audible indication of blower operation and failure.

(b) For the raw flake conveying system: by providing a break in the raw flake conveyor system at a point in open air in addition to continuous air aspiration as outlined in (a).

(c) For pneumatic conveyors: by locating the air intake in a vapor-free area outside the extraction process and a minimum of 8 ft (2.5 m) above the grade level.

5-2.6 Conveyors and spouts shall be permitted to be enclosed in adequately supported, noncombustible bridge structures equipped with open grate floor sections for ventilation.

5-2.7 A cooling tower, if provided, shall be located based on its construction and fire protection. (See NFPA 214, *Standard on Water-Cooling Towers*.)

5-2.7.1 If the tower is of noncombustible construction and the fill of the tower is of limited combustible construction, as these terms are defined in NFPA 220, *Standard on Types of Building Construction*, then the tower shall be permitted to be located in the restricted area.

5-2.7.2 If the tower is of noncombustible exterior construction and protected by automatic sprinklers per NFPA 214, *Standard on Water-Cooling Towers*, it shall not be located in the restricted area but shall be permitted to be located in the controlled area.

5-2.7.3 If the tower is combustible and protected by interior and exterior automatic deluge fire protection systems, per NFPA 214, *Standard on Water-Cooling Towers*, it shall not be located in the restricted area but shall be permitted to be located in the controlled area.

5-2.7.4 If the tower is combustible and unprotected, it shall not be located in the restricted or controlled area.

5-3 Ventilation of Extraction Buildings.

5-3.1 Enclosed plants shall have sufficient ventilation to change the volume of air at least six times per hour. This shall be accomplished by exhaust fans, preferably taking suction at floor levels and discharging to a safe location outside the building. The arrangement shall be such that all portions of solid floor areas will be subjected to continuous positive movement of air.

5-3.2 Ventilation fans intended to handle solvent vapors shall be designed with the increased horsepower necessary to handle higher density vapors.

5-4 Ignition Sources and Heating.

5-4.1 Except as provided in 2-1.5.4 and 5-1.5, no ignition sources shall be used within the building or within 100 ft (30.5 m) of the process unless the unit and building are purged.

5-4.2 Space heating, if required, shall be provided by indirect means. Temperatures on heated surfaces shall not exceed 250°F (121°C).

5-4.3 If steam tracing or jacketing is provided, temperatures on both internal and external heated surfaces shall not exceed 250°F (121°C).

Exception: Process temperatures may exceed this level, provided the temperature is reduced to 250°F (121°C) during shut-down periods.

5-4.4 Power transmission belts shall not be used within Class I, Group C or D locations, as defined in Section 5-5.

5-4.5 Process vent fans, purge fans, and building ventilation fans shall be of sparkproof design.

5-5 Electricity.

5-5.1 Electrical wiring and electrical equipment of the extraction process, outward 15 ft (4.6 m) into the restricted area and vertically at least 5 ft (1.5 m) above the highest vent, vessel, or equipment containing solvent shall be installed in accordance with the requirements for Class I, Group C or D, Division 1 locations. (See Figure 5-5.2.)

5-5.2 Electrical wiring and electrical equipment within the restricted area beyond the 15 ft (4.6 m) distance and to a height of 8 ft (2.5 m) above the extraction process grade level shall be installed in accordance with the requirements of Class I, Group C or D, Division 2 locations. (See Figure 5-5.2.)

5-5.3 Electrical wiring and electrical equipment within the controlled area and within 4 ft (1.3 m) of the extraction process grade level, except the preparation process (see 5-1.5), shall be installed in accordance with the requirements of Class I, Group C or D, Division 2 locations. (See Figure 5-5.2.)

5-5.4 Permanent lights shall be installed where needed. Flashlights approved for Class I, Group C or D locations shall be provided.

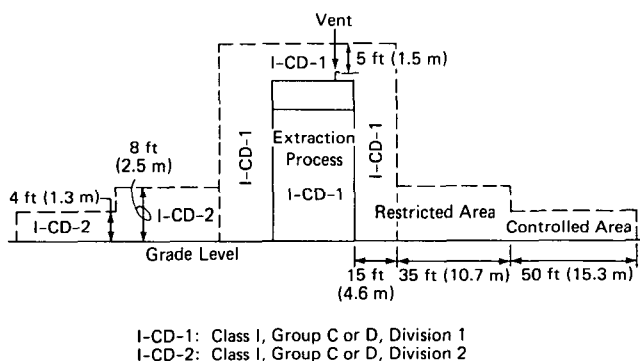


Figure 5-5.2 Type and Extent of Hazardous Areas.

5-6 Static Electricity.

5-6.1 All tanks, vessels, motors, pipes, conduit, grating, and building frames within the process shall be electrically bonded together.

5-6.2 Building frames and metal structures shall be grounded and tested periodically to determine electrical continuity. (See NFPA 70, National Electrical Code, and NFPA 77, Recommended Practice on Static Electricity.)

5-6.3 All hose except that used in water service shall be electrically bonded to the supply line and to the tank or vessel where discharge takes place.

5-6.4 Grounding wires or bonding connections shall be provided between any dispensing and any receiving vessel used for the transfer of solvent or mixtures of solvent and oil where bonding is not achieved through fixed connections. This shall include all sampling cocks.

5-6.5 If steam purging, cleaning, or sparging is used, all pipes or nozzles through which steam is discharged shall be bonded to the equipment being purged, cleaned, or sparged, or the objects shall be connected to ground. (See NFPA 77, Recommended Practice on Static Electricity.)

5-7 Lightning Protection. Where needed, approved lightning protection shall be provided for the extraction process. (See NFPA 780, Lightning Protection Code.)

5-8 Process Equipment.

5-8.1 Venting.

5-8.1.1 Process equipment shall be a closed system and vented to the outside atmosphere through approved flame arresters installed in accordance with the conditions of

approval. The manifolding of vents upstream of the flame arrester is permitted. Vents shall terminate at least 20 ft (6.1 m) above the ground and be so located that vapors will not re-enter the building. Flame arresters shall be protected against freezing and shall be easily accessible for inspection and repair. Flame arresters shall not be located within a building unless approved by the authority having jurisdiction.

5-8.1.2 Vessels or tanks containing solvent shall be protected with emergency venting to relieve excessive internal pressure in the event of fire. This applies to such vessels as extractors, solvent work tanks, miscella tanks, and solvent-water separating tanks. If the calculated required emergency vent capacity is less than the normal vent requirement, no additional emergency venting is necessary.

5-8.1.3 The total capacity of both normal and emergency venting for vessels and tanks in the extraction process, which are protected in accordance with 2-10.1, shall not be less than that derived from Table 5-1. (See *Appendix A of NFPA 30, Flammable and Combustible Liquids Code*, for background information.)

5-8.1.4 All emergency relief vents shall terminate at least 20 ft (6.1 m) above the ground and be so located that vapors will not re-enter the building or create a hazard from localized overheating of any part of a tank or structure.

5-8.1.5 Shutoff valves shall not be installed in normal or emergency vent lines.

5-8.1.6 Flares or burners from process vents shall be prohibited within the restricted and controlled areas. Flares or burners, if installed outside these areas, shall be equipped with approved devices to prevent flashbacks in the vent piping.

5-8.2 Conveying Systems for Solids.

5-8.2.1 Before entering the process, all solid material shall pass over or through a separator for the removal of tramp metal.

5-8.2.2 Pneumatic systems for handling solids shall be permitted to be used when material and air being handled are solvent-free.

5-8.2.3 An adequate vapor seal designed to prevent the escape of solvent or solvent vapors shall be provided at the point where the solids enter the system.

5-8.2.4 An adequate vapor seal shall be used on the final discharge of material from the extraction system.

5-8.2.5 Gaskets, if used in these systems, shall be of a material that will not decompose or soften in the presence of oil, solvent, or steam.

5-8.3 Extractors, Desolventizers, Toasters, Driers, and Spent Flake Conveyors. Extractors, desolventizers, toasters, driers, and spent flake conveyors shall be of a design

Table 5-1 Total Minimum Emergency Vent Capacity in Cubic Feet Free Air/Hour (14.7 Psia and 60°F) with Approved Automatic Water Spray, Deluge System, or Equivalent

| Exposed Surface Area* Square Feet | Cubic Feet Hour | Exposed Surface Area* Square Feet | Cubic Feet Hour | Exposed Surface Area* Square Feet | Cubic Feet Hour |
|--------------------------------------|--------------------|--------------------------------------|--------------------|--------------------------------------|--------------------|
| 20 | 6,300 | 160 | 50,400 | 900 | 147,900 |
| 30 | 9,480 | 180 | 57,000 | 1,000 | 157,200 |
| 40 | 12,630 | 200 | 63,300 | 1,200 | 167,100 |
| 50 | 15,810 | 250 | 71,700 | 1,400 | 176,100 |
| 60 | 18,960 | 300 | 79,500 | 1,600 | 184,200 |
| 70 | 22,110 | 350 | 86,400 | 1,800 | 191,700 |
| 80 | 25,260 | 400 | 93,600 | 2,000 | 198,600 |
| 90 | 28,440 | 500 | 106,200 | 2,400 | 211,200 |
| 100 | 31,500 | 600 | 117,600 | 2,800 | 222,600 |
| 120 | 37,800 | 700 | 128,400 | and over | |
| 140 | 44,100 | 800 | 138,600 | | |

SI Units: 10 ft² = 0.93 m²; 36 ft³ = 1.0 m³.

NOTE: Interpolate for intermediate values. If tank or vessel is protected by approved insulation in addition to water spray, deluge system, or equivalent protection as provided in 2-10.1, the flow capacities may be reduced by 50 percent.

* Exposed surface area means the exterior surface of a vessel or tank less that portion resting on a solid earth or concrete pad.

that minimizes the possibility of ignition of product deposits. Such equipment shall be protected by extinguishing systems using inert gas, steam, or a combination of the two, controlled from a safe remote location. (See 5-8.9.1.)

5-8.4 Grinders.

5-8.4.1 Finished meal grinding after the drying-cooling operation shall not be located in the restricted area. Such operations may be permitted in the controlled area only when conforming to the provisions of 5-1.5.

5-8.4.2 Finished meal grinding of materials as discharged from the desolventizer shall not be permitted.

5-8.5 Miscella Filters. Only totally enclosed filters shall be used. Ventilation shall be provided to remove residual solvent vapors when filters are open.

5-8.6 Waste Water Evaporation. Process waste water shall pass through an evaporator before entering separation sump. (See 5-8.9.4.)

5-8.7 Pressure Vessels and Tanks.

5-8.7.1 Unfired pressure vessels such as desolventizers and evaporators shall be constructed in accordance with the *Boiler and Pressure Vessel Code* of the American Society of Mechanical Engineers.

5-8.7.2 All large vessels shall be equipped with bolted and gasketed plates for inspection or repairs.

5-8.7.3 Where sight glasses are installed they shall be of the high pressure type protected against breakage and loss of product. Hydraulic transmission or hydrostatic gages shall be used for remote observation of liquid levels.

5-8.7.4 Tanks shall be equipped with manual shutoff valves at the bottom.

5-8.7.5 Armored-type liquid level gages shall be used.

5-8.8 Heat Exchangers, Condensers, and Flash Drums.

5-8.8.1 The water side of condensers and heat exchangers shall be kept at a greater pressure than the solvent or vapor side.

5-8.8.2 Provision shall be made to ensure safe shutdown in the event of loss of primary cooling water. This shall be accomplished by one or more of the following methods:

(a) An automatic emergency gravity water supply tank of sufficient capacity;

(b) A connection to an equally reliable water supply;

(c) A provision to automatically shut off steam other than smothering steam, to immediately reduce steam-heated jacket pressure to atmospheric pressure and to stop the flow of miscella to the distillation system.

5-8.8.3 All steam condensate from the extraction process that is to be returned to the boiler shall be reduced to practically atmospheric pressure in a vessel where any entrained solvent will be flashed off.

5-8.9 Process Controls.

5-8.9.1 Provision shall be made for emergency shutoff of steam, other than smothering steam, and shutdown of process equipment other than cooling water to condensers, exhaust fans, and lights. This shall be accomplished through manual operation both near the process equipment and at a safe remote location.

5-8.9.2 Except where hazardous conditions would be created by stopping process equipment, all motor controls on such equipment shall be interlocked so that the stoppage of any piece of solids-handling equipment will stop supplying material to the stopped equipment and so that all equipment conveying material away from the stopped unit will continue to operate. This interlock system shall be designed to require the proper start-up sequence and shutdown procedures.

5-8.9.3 Centrally located audible alarms, visual alarms, or both shall be provided to indicate abnormal and hazardous conditions such as loss of steam, loss of cooling water pressure, failure of process pumps and aspirating and ventilating fans, fire, and stopped motors.

5-8.9.4 Temperature sensing devices arranged to actuate audible and visual alarms shall be installed in the desolventizer and the water outlet from waste water evaporator to indicate when the temperature drops to a point where solvent carryover could create a hazard.

5-8.9.5 Automatic systems shall be provided to stop the discharge of meal or water at temperatures below which there would be a significant hazard.

5-8.9.6 Pneumatic or hydraulic controls and instruments shall be permitted to be used in place of electrical controls.

5-9 Flammable Vapor Detection.

5-9.1 Approved portable combustible gas indicators shall be provided and maintained in good working order.

5-9.2 Provisions shall be made for monitoring the atmosphere in areas where flammable vapors may present a hazard. This shall be permitted to be accomplished by installing an approved combustible gas detection system with audible and visual alarms. Where such a system is used, it shall be tested and maintained in good working order in accordance with the manufacturer's instructions.

Areas where routine sampling has been found desirable include: raw material conveyor, desolventized material conveyor, finished oil or fat containers, waste water discharge, and solvent and miscella pumps.

Chapter 6 Referenced Publications

6-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

6-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 69, *Standard on Explosion Prevention Systems*, 1992 edition

NFPA 70, *National Electrical Code*, 1993 edition

NFPA 214, *Standard on Water-Cooling Towers*, 1992 edition

NFPA 220, *Standard on Types of Building Construction*, 1992 edition

6-1.2 Other Publication. American Society of Mechanical Engineers, 345 East 47th Street, New York, NY 10017.

ASME Boiler and Pressure Vessel Code, 1980

Appendix A

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

A-2-10 Water spray or deluge systems that are used to protect solvent extraction process equipment or structures should be designed to provide a density of not less than 0.25 gpm per sq ft (10.2 Lpm/m²) of protected surface area. (See NFPA 13 and NFPA 15 for additional information.) Foam water sprinkler or deluge systems that are used for the same purposes should be designed to provide a density of not less than 0.16 gpm per sq ft (6.5 Lpm/m²) of protected surface area. (See NFPA 13 and NFPA 16 for additional information.)

Preparation buildings should be protected with automatic sprinkler systems designed for Ordinary Hazard - Group 2, in accordance with NFPA 13.

Appendix B General Description of Solvent Extraction Process

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

General. The removal of vegetable oils from oil-bearing materials by solvent extraction involves almost exclusively the use of solvents. The preparation processes that are employed depend on the oil content of the seed, the physical characteristics of the seed, the type of extraction system used, and the desired end products.

Extraction Solvents and Their Properties. The primary solvent used for the extraction of vegetable oils is the petroleum hydrocarbon fraction sold commercially as "hexane." This is because of hexane's low cost, stability, excellent thermal characteristics, and selectivity for oils and fats. Other solvents, such as pentane, heptane, and trichloroethylene, have been tried, but have not been widely used. Table B-1 shows hexane's physical properties. Table B-2 shows a typical distillation analysis for hexane.

Table B-1 Physical Properties of Hexane

| | |
|---|---------|
| Flammable limits (percent by vol.) | 1.2-6.9 |
| Ignition temperature °F | 437 |
| Flash point °F closed cup | -15 |
| Molecular weight | 86.2 |
| Melting point | -137°F |
| Coefficient of expansion | 0.00135 |
| Boiling point at 14.7 psia | 156.1°F |
| Specific gravity at 60°F | 0.664 |
| A.P.I. gravity at 60°F | 81.6 |
| Pounds per gallon at 60°F | 5.536 |
| Vapor density (air equals 1) | 2.975 |
| Cubic feet vapor per gallon liquid, 60°F, 14.7 psia | 25.5 |
| Vapor weight per cu ft (lb at 60°F) | 0.217 |
| Vapor weight, cu ft per lb at 60°F | 4.61 |
| Latent heat of vaporization at 760 mm Btu/lb | 143.3 |
| Heat of combustion, Btu/lb (gross) | 20,970 |
| Btu per cu ft vapor (gross) | 4,762 |
| Btu per pound (net) | 19,420 |
| Vapor pressure at 100°F, psia | 5.0 |
| Specific heat liquid at 60°F | 0.531 |
| Specific heat vapor at 60°F | 0.339 |
| Solubility in water, moles per liter at 60°F | 0.0016 |

Table B-2 Distillation Analysis of Hexane (°F)

| Percent Distilled | |
|-----------------------|-----|
| Initial Boiling Point | 146 |
| 5 | 148 |
| 10 | 148 |
| 20 | 149 |
| 30 | 149 |
| 40 | 149 |
| 50 | 149 |
| 60 | 150 |
| 70 | 150 |
| 80 | 151 |
| 90 | 152 |
| 95 | 153 |
| Dry end point | 156 |

Two of hexane's more important properties are also safety concerns: its flash point and its vapor density. As shown in Table B-1, the flash point is -15°F (-26°C) and the boiling point is 156°F (69°C), making hexane a Class IB Flammable Liquid. The vapors of hexane are about three times more dense than air, which accounts for their tendency to flow across a surface and to collect in low spots and confined areas.

Preparation and Pre-Treatment. Oilseeds that have a high oil content, such as sunflower seed, rapeseed (canola), peanut, and corn germ, are difficult to prepare and do not allow economical direct extraction. Experience has shown that it is less costly to remove some of the oil by first pressing the seeds prior to solvent extraction. This is called "prepressing" and is done in screw presses. The oil from this prepressing is screened to remove fine material called "foots" and is then filtered or centrifuged to produce a clear oil. The foots are returned to the inlet of the screw press. Before pressing, the oilseeds are sometimes cracked, then flaked. Generally, the seeds must be cooked before pressing. This cooking step varies widely, depending on the variety of seed and the type of press. Some screw presses are able to handle whole, uncooked seeds. In any case, the cake produced by the prepressing is the raw material for the solvent extraction process. This cake may be granulated prior to the extraction step.

There are many ways to prepare soybeans for solvent extraction, although certain operations are common to all preparation processes. Soybeans generally bypass the prepressing step. The four major steps in preparing soybeans for solvent extraction invariably follow a sequence of cleaning, cracking, heating, and flaking. The demand for high protein soybean meal for poultry feed has led some extraction plants to add a process to remove the hulls from the cracked beans, using air separation. Sometimes the soybeans are dried to a relatively low moisture level and then dehulled before any heating takes place. Another method processes the beans at their normal moisture content, preheats them quickly in a fluidized bed drier, then cracks and dehulls the beans while they are still hot. The resulting meats are then conditioned in a second fluidized bed drier, prior to flaking.

Some processors, whether they dehull the beans or not, add an additional step that uses an extrusion device called an expander to produce pellets from the flakes. This process is said to improve the extractability of the flakes and to reduce the amount of hexane holdup in the flakes that leave the extractor.

Cottonseed and other soft seeds are prepared both with and without prepressing. Some processors consider the prepressing step to be essential, while others consider it costly and unnecessary. The preparation of cottonseed by the direct extraction method, i.e., without prepressing, consists of cleaning, delinting, cooking, and flaking. The last two steps may be adjusted to optimize the efficiency of the extraction step and to overcome the toxic effects of a pigment gland, called gossypol, that is usually present in the seed. Prepressing of cottonseed produces higher-than-normal temperatures because of the cooking step prior to the prepressing and the frictional heat developed in the press. As with other soft seeds, moisture adjustment and granulation, flaking, or both, of the press cake usually follows.

Extraction. Modern systems for the extraction of vegetable oils and fats by solvents appear rather complex. This complexity, however, is largely due to the systems for control, safety, automation, and energy recovery. The basic extraction process is rather simple, as shown in Figure B-1.

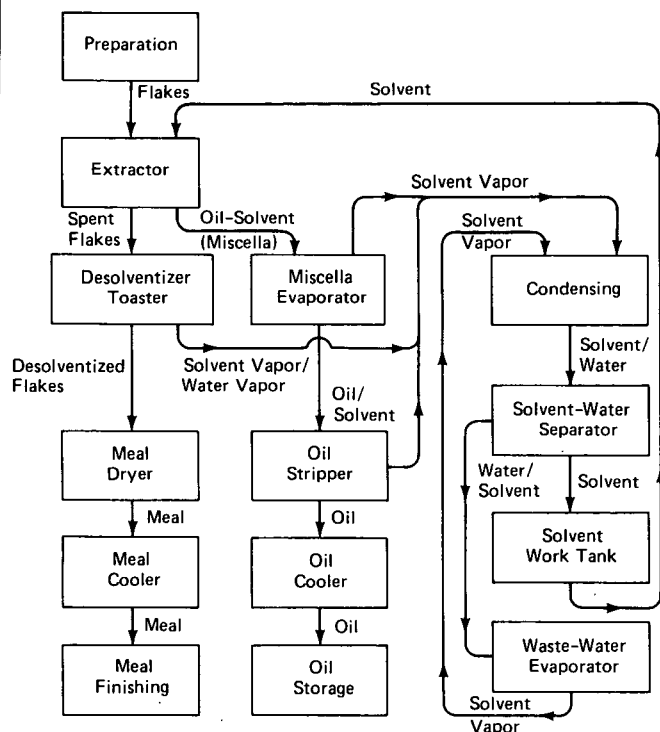


Figure B-1 Flow Diagram of Extraction Process.

Despite the seemingly complicated array of equipment, the process consists of just four major functions: extraction, desolventizing, distillation, and solvent recovery.

In the extraction step, the oil is removed from the oil-bearing material. The extraction of the oil or fat leaves the oil-bearing material saturated with solvent. This solvent is removed in the desolventizer, which drives off the solvent by direct and indirect steam heating. The miscella, or oil-bearing solvent, goes to the evaporation or distillation system, where the solvent is removed from the oil by means of heat, direct steam, and vacuum. The evaporation of the solvent from the miscella is not difficult because the solvent has the relatively low boiling point of about 156°F (69°C), compared to the boiling point of the oils, which can usually withstand temperatures as high as 250°F (121°C) without discoloration or polymerization. Thus, a wide temperature differential between the solvent and the oil, plus the use of stripping steam and vacuum in the final stage, facilitates desolventizing of the oil. The solvent recovered in this process is reused.

The functions of various components of the extraction process are described in the sections that follow.

Basket-Type Extractors. Basket extractors come in three varieties: vertical, rectangular, and horizontal. The material to be extracted is carried through the extractor in individually-suspended, perforated or screen-bottomed

baskets. The baskets are hung on longitudinal shafts located just above the center of gravity of the basket. The shaft ends are affixed to bearing brackets that are part of endless chains. The chains are supported and guided by large sprockets at the top and bottom of vertical extractors and at each end of horizontal extractors. This configuration is shown for a vertical extractor in Figure B-2.

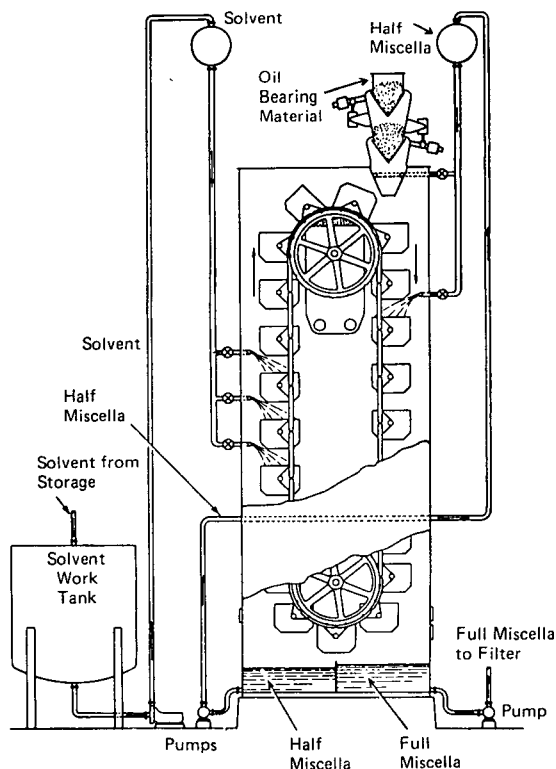


Figure B-2 Vertical Basket Extractor.

The baskets are guided by pins at the end of each basket that slide in a track fastened to the inside of the extractor. The track and pin arrangement prevents the basket from tipping until it reaches a point over a discharge hopper, where a mechanism inverts the basket and discharges the extracted material. As the basket passes the discharge position, it is righted and immediately recharged with oil-bearing material.

The number of baskets in the extractor depends on the through-put, the extraction time, and the design balance: 24 to 36 baskets would be normal. The most common type of charging system is a continuous screw conveyor that feeds a mixture of oil-bearing material and half-miscella to the baskets. The extracted material is removed from the discharge hopper by a paddle conveyor or a mass-flow type of conveyor that is set in the bottom of the hopper.

Vertical and rectangular basket extractors have both ascending and descending baskets traveling through a shower of solvent and miscella. A concurrent phase takes place from the time the baskets are filled until they reach the bottom of the extractor on the downward leg. Half-miscella from the bottom of the ascending side of the extractor is pumped to a basket near the top of the descending side and percolates down through the baskets

to the full-miscella chamber at the bottom. Raw solvent is sprayed onto one or more of the baskets near the top of the ascending side and flows concurrently through the baskets to the half-miscella chamber at the bottom of the ascending side.

Rectangular and horizontal basket-type extractors are quite similar to the vertical type, with the exception that a series of pumps continuously pump miscella to spray pipes above the baskets.

Rotary Extractors. (See Figure B-3.) A rotary extractor consists of a series of concentrically arranged cells supported from a vertical shaft. Extraction is effected in a manner similar to horizontal basket extractors, where the baskets pass beneath fixed nozzles fed from stage pumps recirculating various concentrations of miscella, as shown in Figure B-4. A primary difference is that the bed of material is much deeper in the rotary extractor; hence, the term "deep bed extractor" is sometimes applied to this type. Each cell has an open top and a hinged, perforated bottom door. As the cells travel around the track and pass beneath the feeding device, a slurry of oil-bearing material and half-miscella fills each cell. The rotation speed of the cells is variable to ensure that a continuous flow of slurry fills each cell to the desired level. While the cells are completing a revolution of the extractor, increasingly stronger concentrations of miscella, which is collected from the drain compartments that form the bottom of the extractor, are sprayed back onto the top of the cells. At approximately two-thirds of the distance around from the slurry inlet, raw solvent is sprayed onto the top of the cells, and the cells are allowed to drain free of excess solvent. After the drainage section, the cells pass over a discharge hopper. When each cell is directly over the hopper, a cut-out section of the track permits the cell bottom to be released, and the spent material drops into the hopper. Immediately after passing this position, the cell bottom is mechanically raised back to the closed position and is ready to be recharged. The spent material is continuously conveyed from the discharge hopper to the desolventizer at a uniform rate. This rate is regulated so that the discharge hopper is nearly empty when the next cell discharges.

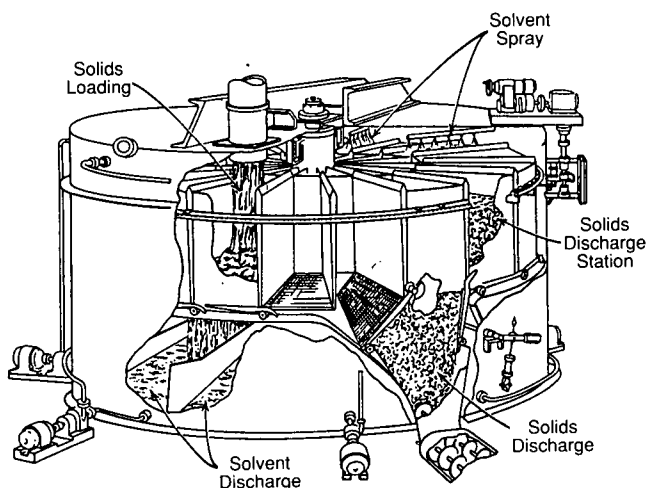


Figure B-3 Rotary or Deep Bed Extractor. (Courtesy Chemical Engineering, Vol. 57, No. 8, August, 1950, p. 109.)

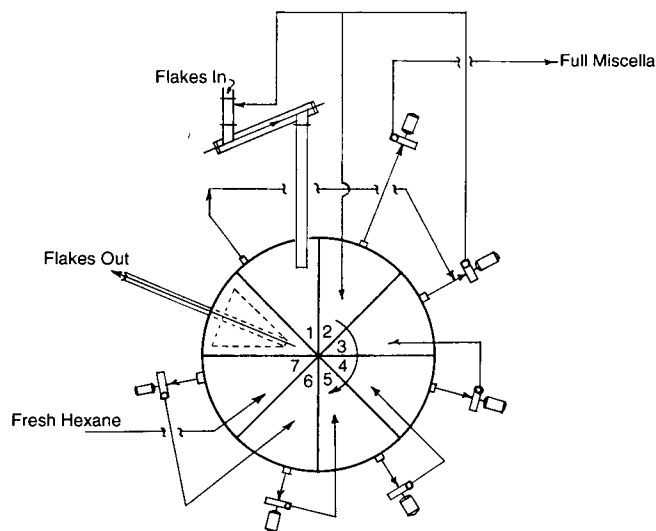


Figure B-4 Schematic of Operation of Rotary Extractor.

Stationary-bottom and sliding-plate extractors (Figure B-5) are variations of the deep-bed rotary extractor. These extractors have concentric cells affixed to a central axis that is powered by a variable speed drive. The cells slide over a self-cleaning slotted bottom plate. Because of this feature, no doors are required to support the flakes. The cells are uniformly filled to a desired level. Several stage pumps are provided to recycle the solvent and gradient miscellas countercurrent to the mass as it is extracted. A drainage section is provided after the fresh solvent is added, and the extracted material drops into a discharge hopper, where it is conveyed to the desolventizer.

The stationary cell extractor is another type of rotary extractor. This type provides countercurrent extraction without moving the cells. Instead, the fill spout, spray nozzles, bottom screens, and miscella collection compartments rotate on a central shaft. The thrust load is carried on a circular track mounted on the bottom of the extractor shell. The oil-bearing material remains in the stationary basket until drained. As the bottom screen rotates under the basket, the material discharges into the internal discharge hopper from which it is conveyed from the extractor.

Perforated Belt Extractor. (See Figure B-6.) Another type of extractor is the horizontal perforated belt extractor in which the flakes are fed in a uniform depth onto one end of a slowly moving perforated belt. As the oil-bearing material, which is not as deep as in the rotary-type extractor, travels the length of the extractor, gradient miscellas are sprayed over the moving bed from stage pumps, in much the same fashion as the horizontal basket and rotary extractors. The belt is comprised of a pair of endless chains running on a set of large sprockets at each side of the extractor. Attached across the chains and forming a flat surface are a series of perforated plates or screens. Chambers or pans are arranged beneath the belt for the entire length of the extractor for collection of various concentrations of miscellas. The spent material is continuously discharged from the end of the belt into a hopper, from which it is conveyed to the desolventizer.

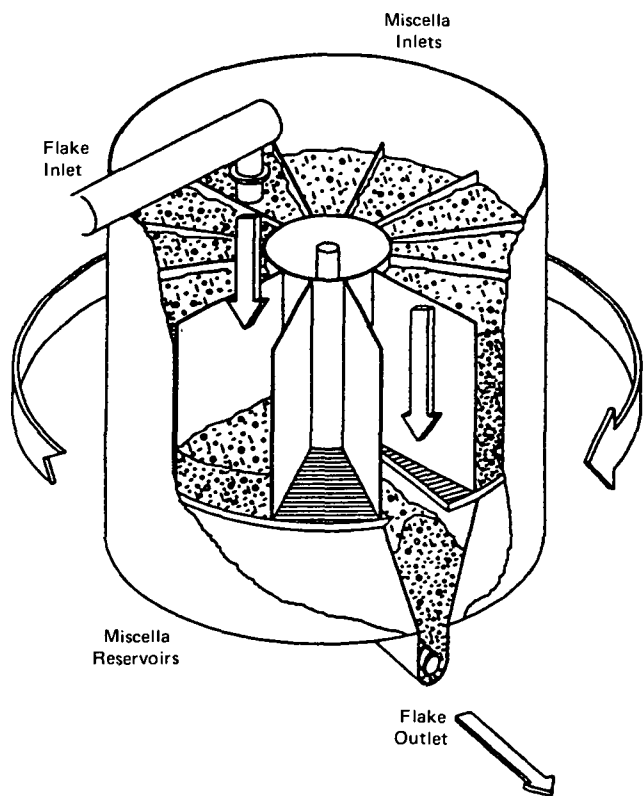


Figure B-5 Stationary-Bottom or Sliding-Plate Extractor.

Another type of perforated belt extractor, the sliding cell extractor (Figure B-7), provides two extraction surfaces where the flakes are separated by rectangular compartments, while traveling along the moving slotted screens or stationary vee-bar screen plates. This unit achieves countercurrent

extraction by employing stage pumps and a series of collecting pans to direct the flow of the various miscella concentrations. Because there is an upper and a lower screen belt or plate, the filling device can be located over, but separated from, the discharge hopper. When the partially extracted material reaches the end of the top belt, it falls from the upper cell into a similar compartment on the lower belt. The mass continues to be sprayed with miscella from the stage pumps until it reaches the fresh solvent wash prior to draining and feeding into the discharge hopper.

Rectangular Loop Extractor. (See Figure B-8.) The same basic principles are used in the rectangular loop extractor as in the sliding cell extractor. However, the overall shape of this extractor utilizes an "en masse" type conveyor instead of individual baskets. The bottom part of the conveyor uses stationary, linear vee-bar screens. Flakes enter near the top of the extractor at the inlet hopper. A conveyor chain carries the flakes away from this hopper and down the first leg of the loop, where the flakes receive their first wash. In the bottom horizontal run of the loop, the flakes are washed with progressively weaker concentrations of miscellas. As the flakes travel up the vertical part of the loop, they are further extracted by a countercurrent wash of miscella flowing down the loop. On the sloping top run of the extractor, they receive a fresh solvent wash, are allowed to drain, and are discharged continuously from the unit.

The extractor conveying chain is open at the top, bottom, and sides. This allows easy loading and emptying of the material and for passage of the solvent through the flake bed as it is turned during its extraction wash cycle. The speed of the chain is automatically controlled by the level of flakes in the inlet hopper. A sensor in the feed hopper measures the level of flakes in the hopper and sends a signal to the extractor's variable speed drive.

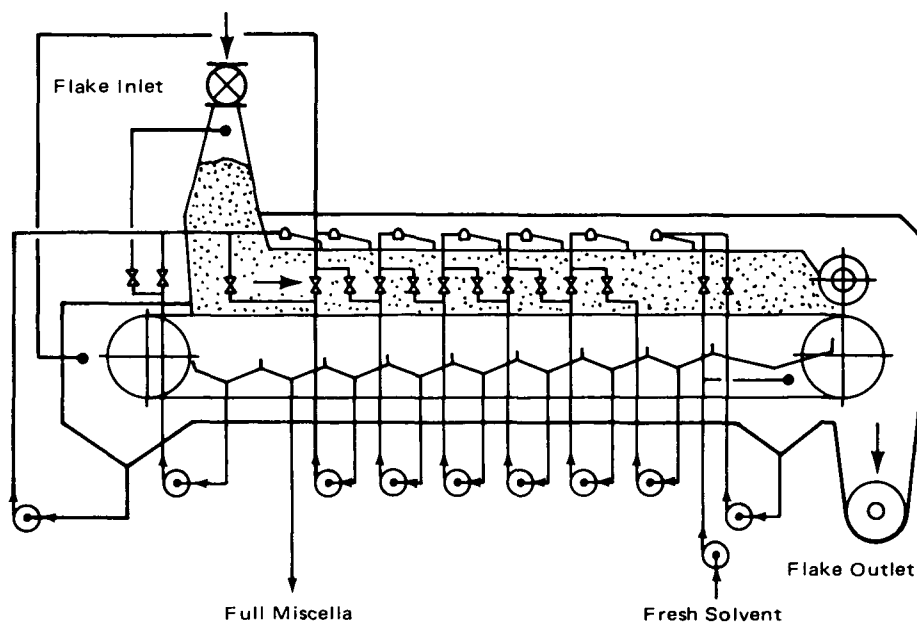


Figure B-6 Perforated Belt Extractor.

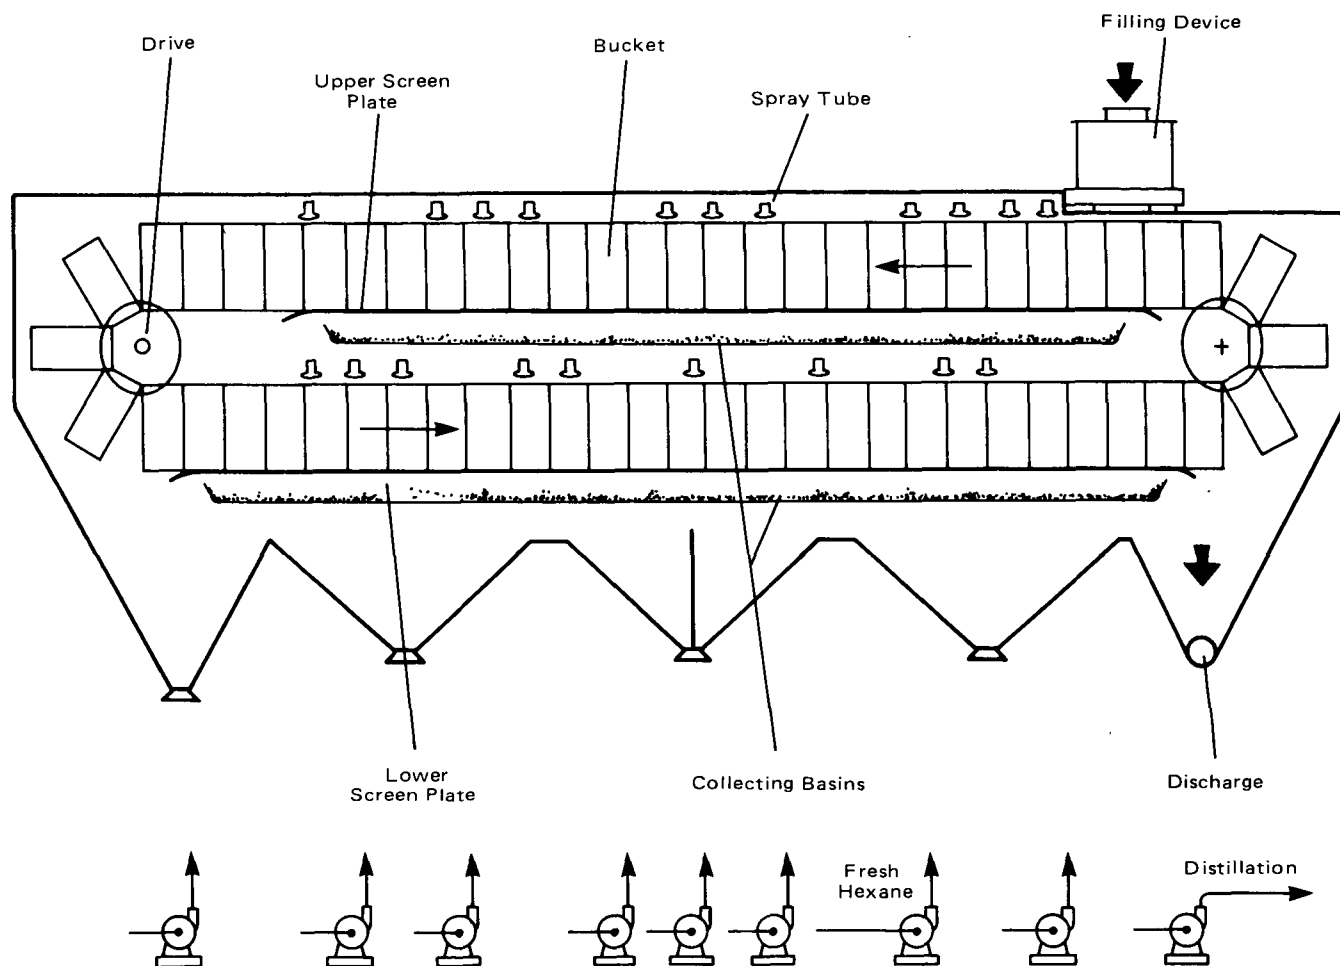


Figure B-7 Sliding Cell Extractor.

Other Types of Extractors. There are other types of extractors for extracting oil from oil-bearing materials, but they are not in general use. These other types include vertical immersion, filtration, and batch extractors. Some are used only for special applications.

Distillation. The distillation system of an extraction plant provides the means for evaporating and stripping the solvent from the oil. There are numerous methods for accomplishing this, from the early pot-type batch stills and pan-type evaporators to the currently popular long-tube rising film evaporators, followed by high vacuum stripping. Few of the pot stills or pan-type evaporators are still in use.

At this time, nearly all extraction plants use two long-tube rising film evaporators, with or without recirculation. The first evaporator usually operates under vacuum, while the second operates either under vacuum or at atmospheric pressure. Heat from the desolventizer vapor is recovered and used to supply heat to the first evaporator, while indirect steam supplies heat for the second evaporator. The choice of the type of oil stripper used depends on a number of factors, including the design and size of the other components in the system and the material being processed.

Stripping columns commonly used are either the packed column type or the disk-and-doughnut type. The stripping column distributes the oil into a very thin film on a large surface area with a relatively high velocity of dry steam passing over and through the film. A countercurrent flow is established by introducing the oil at the top of the column and allowing it to pass downward through the tower against the flow of the steam, which is introduced at the bottom of the tower. The tower must be operated under a vacuum of 22 to 28 in Hg (559 to 711 mm Hg) to achieve highest efficiency. The mixture of steam and solvent vapor passes from the top of the tower to a condenser from which the condensate is pumped to a solvent/water separator. The solvent flows from the separator to a work tank. Water flows from the separator to the waste water evaporator. Finished oil is usually pumped from the stripping column by a rotary positive displacement pump.

Desolventizing and Toasting. Desolventizing of the spent material is accomplished in several ways. In one of these, spent material is desolventized by passing through a series of steam-jacketed rotary conveyors commonly called "schneckens." These conveyors are usually stacked one above the other, and the material to be desolventized

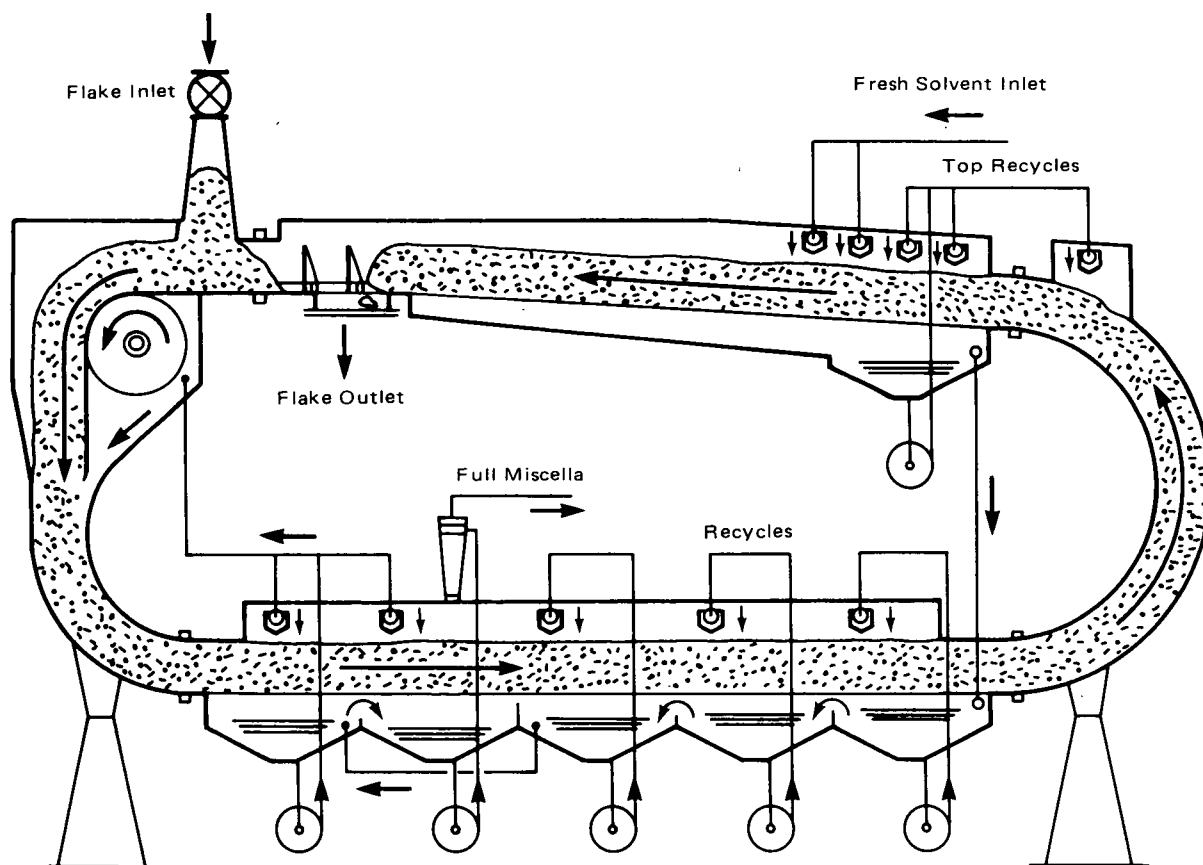


Figure B-8 Rectangular Loop Extractor.

drops by gravity from one to the next. The last conveyor often has a direct flow of steam to remove the final traces of solvent. Vapors are piped to a scrubbing and condensing system. The desolventized material is discharged from the bottom conveyor through a vapor seal.

Another type of desolventizer is the recycled vapor type, which consists of a single cylindrical vessel with a rotating element that tumbles the spent material from the inlet to the discharge end. The vessel is steam-jacketed, and part of the solvent vapor that is driven off is superheated and passed directly back to the vessel. The superheated solvent vapor provides the energy to desolventize the material. This type of desolventizer is usually followed by some type of stripper, often using heat, vacuum, and direct steam to remove the final traces of solvent. The desolventized material is then discharged through a vapor seal.

Many extracted oilseed products require toasting or cooking in order to deactivate enzymes and other constituents and yield a nutritional product. The moisture and heat of the toasting process also agglomerates the fine particles of meal into a more granular form. This helps to reduce the dust problem in subsequent cooling and milling steps. Toasting can be carried out as a separate stage of the process. The meal is conveyed from the desolventizer to the toaster, which may be a vertical stacked cooker or a jacketed stationary drum-type unit with an internal agitator. The toasting section of the combination desolventizer-toaster, often called a "D-T," is essentially a stacked cooker. The function of all toasters is to retain the spent material for a sufficient time at a tem-

perature above 212°F (100°C) and at a specific moisture content. The length of time that the meal is held at these conditions determines the degree of cooking or toasting.

From a fire protection standpoint, the development of the desolventizer-toaster, with the elimination of the intermediate vapor seals, conveyors, etc., represents a significant advance. The D-T is now used in most large capacity solvent extraction systems and accomplishes two important processing steps with a minimum of moving machinery and maximum safety against escape of solvent vapors. The D-T consists of individual kettles or trays placed one above the other, each kettle containing a layer of spent material to a depth of 1 to 4 ft (0.3 to 1.2 m). The feeding of material from one kettle to the next lower one is accomplished by an automatic gate mechanism or spout. The trays that form the floor of each kettle are steam-jacketed and direct steam is sparged into the material in the top kettle or kettles. Some of this steam condenses as it evaporates the solvent, raising the temperature and the moisture of the material to the levels required for toasting in the lower kettles. The top kettle is provided with a large pipe to conduct hot vapors through a scrubber to the condensing system. In normal operation, at least half of the kettles (trays) of the D-T are filled with desolventized material, providing an effective seal against fluctuating pressures and other changes in plant performance.

More recently, the fully counterflow D-T has been introduced. In this unit, the trays have a relatively uniform pattern of perforations that allow the passage of steam through each upper level tray and bed of material. Most or

all of the direct steam is introduced at the bottom of the D-T and flows up through the beds in counterflow to the downward flow of material. This method desolventizes and toasts effectively, reduces the danger of solvent escaping from the bottom of the D-T, and is more energy efficient.

Condensing System. Condensing of solvent vapors and steam is usually accomplished by the use of shell-and-tube condensers. The tubes are normally made of stainless steel. Water flows through the tubes, and the solvent vapor and steam condense on the outer surfaces of the tubes. The cold water used in the condensers may be supplied from deep wells, cooling towers, spray ponds, or some other source that can supply water cool enough to operate the condensers efficiently and clean enough to prevent fouling of the tubes. Solvent vapor from the desolventizer is usually passed through a scrubber to remove any solids entrained in the vapor stream. The vapors are normally washed with liquid solvent, and this scrubbing liquid, along with the removed fines, is returned to the desolventizer. Water has also been used as a scrubbing liquid.

Vent Vapor Recovery System. It is standard practice in extraction plants to vent each piece of processing equipment to a common vent header. This header contains hexane vapor, water vapor, and air, which flow to the final solvent recovery system. At a minimum, the solvent recovery system consists of a water-cooled shell-and-tube condenser and a mineral oil absorption recovery system. The noncondensable components are scrubbed in a mineral oil absorption column and are discharged through a flame arrester to atmosphere by a vent fan. The mineral oil is heated, stripped of its hexane, cooled, and returned to the absorption column. The recovered vapors are condensed and returned to the solvent separator. By today's standards of efficiency, the solvent losses in a large, well-designed, and well-run plant will not exceed one-half gallon (1.9 L) of solvent per ton of material processed. In a soybean processing plant, this is equivalent to a solvent loss of 0.14 percent by weight, based on the weight of the soybeans processed. Many plants have solvent losses that are considerably lower than this.

Waste Water Evaporator. Water is continuously produced in the extraction process from the condensation of direct sparge steam that is used in many sections of the plant. This water is continuously removed from the solvent-water separator and sent to a vessel called the waste water evaporator, where direct steam is introduced to raise the temperature to at least 185°F (85°C). Often, the direct steam is provided by the final stripper vacuum ejector (and possibly other ejectors in the process). The purpose of this waste water evaporator is to heat the waste water well above the boiling point of the solvent, thus evaporating any remaining solvent in the waste water stream. This waste water flows to a large outdoor separation sump that is also connected to the floor drains of the extraction building. This sump serves two purposes: it provides an additional level of safety by separating any remaining oils, solvents, and miscella from the waste water prior to its discharge; it also provides containment for any spills.

Appendix C Operational Practices

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

Reports. Plant supervisors and operators should be responsible for recording normal and abnormal operating

conditions and occurrences. It is recommended that operators note and log operating levels, temperatures, vacuum levels, and operating pressures on an hourly basis. Use of continuous recording instruments can greatly simplify this task. Hourly logs should be reviewed to uncover any abnormal conditions. A summary of the plant's operation should be kept in a permanent log for use by and guidance of other supervisors and managers.

Visitors. Visits to the plant should be controlled at all times and should only be permitted when conditions are normal. The size of visiting groups should be strictly controlled to a manageable level. Since visitors are not always familiar with the inherent hazards of an extraction plant, they must be properly informed of all safety regulations. Only those visitors that have been approved by management personnel should be allowed in the operating areas. All visitors should apply for permission to enter the plant at a designated place outside the fenced area, where they must leave all smoking materials, matches, lighters, and other sources of ignition. Visitors should be accompanied by a plant employee at all times. Visitors should not be permitted in the plant when solvent vapors are present. Should a dangerous concentration of solvent vapors develop at any time during the visit, guides should immediately escort the visitors to a safe location. A written record of all visitors should be kept.

Safety Work Permit. Major repairs and modifications should only be done when the plant has been shut down in an orderly manner and emptied and purged of all miscella, solvent, and solvent vapors. A shutdown and purging procedure should be developed and provided to all supervisory personnel and all affected employees. Separate purging procedures should be written for situations in which only mechanical work, i.e., no cutting or hot work, will be performed, and for shutdowns that will include hot work. A cutting and welding permit system should be developed, and compliance with it required any time hot work is anticipated, including the use of metal saws, drills, grinders, torches, and welding.

Where repair work of a mechanical nature is required in the restricted area, either by plant personnel or outside contractors, strict control is required. A work permit (Figure C-1) authorizing the work should be issued by the individual in charge only after an inspection has been made to ensure that working conditions are safe, that safe work procedures have been specified, and appropriate tools authorized. Each work permit should have a specific, definite duration.

When outside contractors are used, they should be thoroughly indoctrinated in the plant's safety procedures before starting the work, and documentation of such instruction should be recorded. The indoctrination should include a clear description of the scope of the work to be performed, the types of tools that can be used, with whom the work is to be coordinated, and conditions under which a hot work or lockout/tagout permit is required. Contractors should not start or stop any equipment, open or close valves, or open any plant system.

Preventive Maintenance. In most plants, a plan of regular, scheduled shutdowns is followed. During these periods, repairs are done that cannot be done safely when the plant is operating. These shutdowns afford excellent opportunities for detailed inspection of all equipment in order to detect and correct any deficiencies.

WORK PERMIT

TO: _____ DEPT.: _____

FOR:

- (a) All repair work done by outside departments.
- (b) Hot work, welding (gas or electric), burning or any other work requiring heat, open flame, or electric current.
- (c) Entering a Vessel.

Good From _____ Date: _____ Time: _____ (am/pm)
 To _____ Date: _____ Time: _____ (am/pm)

Area: _____

Describe Work To Be Done: _____

NOTE: Answer each question YES or NO. If Question does not apply, check off indicating that it has been given consideration.

1. Can the equipment be removed from the building?
2. Can the work be done other than by the use of flame?
3. Have all process materials (solids, liquids, gases) been removed from the equipment?
4. Have connections been blinded off?
5. Have valves been tagged and/or locked closed?
6. Have switches and electric disconnects been tagged and/or locked open? (Safety locks on push buttons are not sufficient.)
7. Has equipment and all attached piping been cleaned?
 With- water _____ steam _____ inert gas _____
8. Has equipment been ventilated?
9. Is ventilation to be continued during shutdown or repair procedures?
10. Have trenches and sewer openings been covered and steamed to eliminate explosive vapors?
11. Have gas tests been made?
12. Can sparks ignite material in vicinity or on lower floors or levels?
13. Is adjacent equipment safe?

NOTE: Equipment or material to be removed for repair or disposal must be passed by Department Head as free of dangerous material.

Are there any special precautions to be observed?

Foreman in Charge: _____

Operating Superintendent: _____

Maintenance Foreman: _____

Figure C-1

Appendix D Referenced Publications

D-1 The following documents or portions thereof are referenced within this standard for informational purposes only and thus are not considered part of the requirements of this document. The edition indicated for each reference

is the current edition as of the date of the NFPA issuance of this document.

D-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 10, *Standard for Portable Fire Extinguishers*, 1990 edition

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 1991 edition

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 1993 edition

NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*, 1990 edition

NFPA 16, *Standard on the Installation of Deluge Foam-Water Sprinkler and Foam-Water Spray Systems*, 1991 edition

NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*, 1992 edition

NFPA 30, *Flammable and Combustible Liquids Code*, 1990 edition

NFPA 61C, *Standard for the Prevention of Fire and Dust Explosions in Feed Mills*, 1989 edition

NFPA 68, *Guide for Venting of Deflagrations*, 1988 edition

NFPA 77, *Recommended Practice on Static Electricity*, 1988 edition

NFPA 91, *Standard for Exhaust Systems for Air Conveying of Materials*, 1992 edition

NFPA 385, *Standard for Tank Vehicles for Flammable and Combustible Liquids*, 1990 edition

NFPA 780, *Lightning Protection Code*, 1992 edition

Index

©1993 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

-B-

| | |
|------------------------------------|-------------------|
| Basic rules | Chap. 2 |
| Building construction | |
| Extraction process | 5-2 |
| Preparation process | 4-2 |
| Bulk solvents | Chap. 3 |
| Fire protection | 3-4 |
| Ignition sources | 3-3 |
| Procedures | 3-5 |
| Unloading and storage | Chap. 3 |
| Design and construction | 3-2 |
| Location | 3-1 |
| Storage tanks | 3-1.2, 3-2.2, 3-5 |

-C-

| | |
|---|---------------------------|
| Condensate | |
| Definition | 1-6 |
| Condensers | 5-8.8 |
| Definition | 1-6 |
| Condensing systems | App. B |
| Construction of building | see Building construction |
| Controlled areas | 5-1.2 |
| Definition | 1-6 |
| Repairs in | 2-3, 2-4 |
| Controls | 2-8 |
| Process | 5-8.9 |
| Conveying systems for solids | 5-8.2 |
| Gaskets | 5-8.2.5 |
| Pneumatic systems | 5-8.2.2 |
| Seals | 5-8.2.3, 5-8.2.4 |
| Conveyors | |
| Definition | 1-6 |
| Spent flake | 5-8.3 |
| Cooling towers | 5-2.7 |
| Cutting operations | 2-3.3 |

-D-

| | |
|--|---------|
| Deluge systems | A-2-10 |
| Desolventizers | 5-8.3 |
| Definition | 1-6 |
| Desolventizing | App. B |
| Desolventizing material | |
| Definition | 1-6 |
| Detection, flammable vapors | 5-9 |
| Distillation system | App. B |
| Drains | 2-7.3.2 |
| Driers | 5-8.3 |
| Dust removal | 4-4 |

-E-

| | |
|--|----------------------------|
| Electrical wiring and equipment | |
| Bulk solvent unloading | 3-3.1 |
| Extraction process | 5-5 |
| Preparation process | 4-3 |
| Repairs | 2-3.2 |
| Emergency devices | 2-2.6 |
| Emergency procedures | 2-2 |
| Drills | 2-2.5 |
| Fire brigade | 2-2.4 |
| Training | 2-2.1 |
| Equivalency | 1-3 |
| Evaporators | |
| Definition | 1-6 |
| Waste water | 5-8.6, App. B |
| Existing plants, applicability to | 1-4 |
| Exits | 2-9 |
| Explosion protection | 2-10.6, 5-2.2 |
| Extraction process | Chap. 5 |
| Building construction | 5-2, 5-3 |
| Definition | 1-6 |
| General description | App. B, Fig. B-1 |
| Location | 5-1 |
| Steam condensate | 5-8.8.3 |
| Extraction solvents | |
| Physical properties | App. B, Tables B-1 and B-2 |

| | |
|-------------------------|--------|
| Extractors | 5-8.3 |
| Definition | 1-6 |
| Start-up | 2-5 |
| Types of | App. B |

-F-

| | |
|--|-----------------|
| Filters, miscella | 5-8.5 |
| Fire protection equipment and systems | |
| Alarm signals | 2-10.7 |
| Automatic sprinkler | 2-10.2, 4-4.3.1 |
| Bulk solvent unloading and storage | 3-4 |
| General | 2-10, A-2-10 |
| Hydrants | 2-10.3 |
| Portable fire extinguishers | 2-10.4 |
| Fittings, pipe | 2-7 |
| Flakes | |
| Definition | 1-6 |
| Flaking mills | |
| Definition | 1-6 |
| Flame arresters | |
| Definition | 1-6 |
| Flammable liquids, Class I | |
| Definition | 1-6 |
| Flammable vapors | |
| Detection | 5-9 |
| Testing for | 2-4.4 |
| Vent recovery systems | App. B |
| Flash drums | 5-8.8 |

-G-

| | |
|-------------------------|---------------|
| Gas, inert | see Inert gas |
| Grinders | 5-8.4 |

-H-

| | |
|------------------------------|-------------------------|
| Heat exchangers | 5-8.8 |
| Definition | 1-6 |
| Heating | 5-4 |
| Hexane | see Extraction solvents |
| Housekeeping | 2-1.6 |
| Hydrocarbons | |
| Definition | 1-6 |

-I-

| | |
|-----------------------------------|-----------------|
| Ignition, sources of | 2-1.5, 3-3, 5-4 |
| Inert gas | |
| Definition | 1-6 |
| Inerting | |
| Definition | 1-6 |

-L-

| | |
|-----------------------------------|--------------------------------|
| Lightning protection | 5-7 |
| Liquids, flammable | see Flammable liquids, Class I |

-M-

| | |
|--------------------------------------|--------|
| Maintenance, preventive | App. C |
| Measurements, units of | 1-5 |
| Miscella | |
| Definition | 1-6 |
| Filters | 5-8.5 |

-O-

| | |
|------------------------------------|--------|
| Operational practices | App. C |
|------------------------------------|--------|

-P-

| | |
|---|-----------------------|
| Permits, safety work | App. C, Fig. C-1 |
| Piping | 2-7 |
| Connections | 2-7.5 |
| Identification | 2-7.7 |
| Process | 2-7.3 |
| Systems | 2-7.2 |
| Testing | 2-7.6 |
| Power tools | 2-3.1 |
| Preparation process | Chap. 4, App. B |
| Building construction | 4-2 |
| Definition | 1-6 |
| Dust removal | 4-4 |
| Electricity | 4-3 |
| Pressure vessels and tanks | 5-8.7 |
| Preventive maintenance | App. C |
| Process controls | see Controls, process |
| Process equipment | 5-8 |
| Venting | 5-8.1 |
| Pumps | 2-6 |
| Purging | |
| Definition | 1-6 |
| Methods | 2-4.3 |
| Steps taken prior to | 2-4.2 |
| Purpose of standard | 1-2 |

-R-

| | |
|---|----------|
| Repairs in restricted and controlled areas | |
| In operation or purged | 2-3 |
| Electrical equipment | 2-3.2 |
| Power tools | 2-3.1 |
| Welding and cutting operations | 2-3.3 |
| Permits | App. C |
| Shutdown and purged | 2-4 |
| Reports | App. C |
| Restricted areas | |
| Definition | 1-6 |
| Repairs in | 2-3, 2-4 |
| Retroactivity | 1-4 |

-S-

| | |
|--|---|
| Safety work permit | App. C |
| Scope of standard | 1-2 |
| Separation sump | 5-2.4 |
| Definition | 1-6 |
| Solvent process, description of | App. B |
| Solvent transfer equipment | 2-6 |
| Solvents | see also Bulk solvents; Extraction solvents |
| Definition | 1-6 |
| Spent materials | |
| Definition | 1-6 |
| Static and stray currents | 3-3.2 |
| Static electricity | 5-6 |
| Storage tanks | see Tanks, storage |
| Strippers | |
| Definition | 1-6 |