

JUL 6 1965

# ESSENTIAL ELECTRICAL SYSTEMS FOR HOSPITALS 1965



1051



Fifty Cents

Copyright © 1965

NATIONAL FIRE PROTECTION ASSOCIATION  
International

60 Batterymarch Street, Boston, Mass. 02110

# National Fire Protection Association

## International

### Official NFPA Definitions

Adopted Jan. 23, 1964. Where variances to these definitions are found, efforts to eliminate such conflicts are in process.

**SHALL** is intended to indicate requirements.

**SHOULD** is intended to indicate recommendations or that which is advised but not required.

**APPROVED** means acceptable to the authority having jurisdiction. The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of nationally recognized testing laboratories,\* i.e., laboratories qualified and equipped to conduct the necessary tests, in a position to determine compliance with appropriate standards for the current production of listed items, and the satisfactory performance of such equipment or materials in actual usage.

\*Among the laboratories nationally recognized by the authorities having jurisdiction in the United States and Canada are the Underwriters' Laboratories, Inc., the Factory Mutual Engineering Division, the American Gas Association Laboratories, the Underwriters' Laboratories of Canada, the Canadian Standards Association Testing Laboratories, and the Canadian Gas Association Approvals Division.

**LISTED:** Equipment or materials included in a list published by a nationally recognized testing laboratory that maintains periodic inspection of production of listed equipment or materials, and whose listing states either that the equipment or material meets nationally recognized standards or has been tested and found suitable for use in a specified manner.

**LABELED:** Equipment or materials to which has been attached a label of a nationally recognized testing laboratory that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling is indicated compliance with nationally recognized standards or the conduct of tests to determine suitable usage in a specified manner.

**AUTHORITY HAVING JURISDICTION:** The organization, office or individual responsible for "approving" equipment, an installation, or a procedure.

### Units of Measurements

Units of measurements used here are U. S. standard. 1 U. S. gallon = 0.83 Imperial gallons = 3.785 liters. One foot = 0.3048 meters. One inch = 25.40 millimeters. One pound per square inch = 0.06805 atmospheres = 2.307 feet of water. One pound = 453.6 grams.

### Copyright and Republishing Rights

This publication is copyrighted © by the National Fire Protection Association. Permission is granted to republish in full the material herein in laws, ordinances, regulations, administrative orders or similar documents issued by public authorities. All others desiring permission to reproduce this material in whole or in part shall consult the National Fire Protection Association.

## Standard for Essential Electrical Systems for Hospitals

NFPA No. 76 — 1965

### 1965 Edition of No. 76

This edition supersedes the 1962 edition which was entitled "Essential Hospital Electrical Service" and was adopted by the NFPA at its Annual Meeting on May 20, 1965. This edition is a major revision and reflects experience with the 1962 text. Former Critical Electrical Systems I and II are combined in a single Critical Electrical System. Former Par. 412 has been deleted.

### Origin and Development of No. 76

Work on this standard was initiated in 1959 under the title "Hospital Emergency Electrical Systems." Editions were tentatively adopted in 1960 and 1961. The first final edition was adopted in 1962. This is the second edition.

### Contents

Foreword . . . . .	76-3
Chapter	
1. General . . . . .	76-4
2. Sources of Power . . . . .	76-7
3. Emergency and Critical Classifications . . . . .	76-8
4. Electrical Characteristics . . . . .	76-12
5. Arrangement of Wiring . . . . .	76-13
6. Generator Sets and Prime Movers . . . . .	76-15
7. Maintenance . . . . .	76-17
Appendix A — Definitions . . . . .	76-18

## Committee on Hospitals

**Carl W. Walter, M.D.,** *Chairman,*

Peter Bent Brigham Hospital, 721 Huntington Ave., Boston, Mass. (rep. American College of Surgeons and American Assn. of Hospital Consultants)

**Noyce L. Griffin,** *Secretary,*

Dept. of Health, Education, and Welfare, U. S. Public Health Service, Div. of Hospital & Medical Facilities, 7915 Eastern Avenue, Silver Spring, Md. 20910

**Harriet L. Aberg,** American Assn. of Nurse Anesthetists.

**Kenneth B. Babcock, M.D.,** Joint Commission on Accreditation of Hospitals.

**Arthur G. Billin,** Manufacturers Surgical Trade Assn.

**Richard Bleier,** American Ins. Assn.

**Julius Chezmar,** Department of the Army, Office of the Surgeon General.

**Ralph E. DeForest, M.D.,** American Medical Assn.

**Joseph W. Degen,** American Hospital Assn.

**Wm. H. L. Dornette, M.D.,** American Society of Anesthesiologists, Inc.

**Richard P. Gaulin,** American Society of Heating, Refrigerating & Air-Conditioning Engineers, Inc.

**Lt. Ralph T. Goerner, Jr.,** MSC, USN, Dept. of the Navy.

**Roy Hudenburg,** Kiff, Voss & Franklin.

**William K. Klein,** American Hospital Assn.

**J. P. Lenihan,** Edison Electric Institute.

**Sherman Morss,** American Institute of Architects.

**Leonard Negus,** U. S. Public Health Service.

**Batt. Chief Chas. J. Pierce,** Chicago Fire Department.

**John F. Schreiber,** Rubber Manufacturers Assn.

**Peter J. Sereda,** National Research Council.

**Earle P. Shoub,** U. S. Bureau of Mines.

**Kent P. Stiner,** International Assn. of Electrical Inspectors and Panel No. 14, National Electrical Code Committee.

**Gordon N. Stroppe,** Compressed Gas Assn., Inc.

**Dr. Gilbert E. Teal,** National Safety Council.

**George J. Thomas, M.D.,** Treasure Island, Florida.

**Ralph M. Tovell, M.D.,** American Society of Anesthesiologists.

**F. A. Van Atta,** U. S. Dept. of Labor.

**John P. Watson,** Veterans Administration.

**W. C. Westerberg,** Underwriters' Laboratories, Inc.

**E. E. Williams,** Factory Insurance Assn.

### Alternates.

**R. P. Day,** Factory Insurance Assn. (Alternate to E. E. Williams.)

**Lt. Commander Thomas G. Doneker,** Dept. of the Navy. (Alternate to Lt. Ralph T. Goerner, Jr.)

**Paul Fenoglio,** Edison Electric Institute. (Alternate to J. P. Lenihan.)

**Nathaniel Glickman,** American Society of Heating, Refrigerating & Air-Conditioning Engineers, Inc. (Alternate to R. P. Gaulin.)

**Paul Guest,** U. S. Bureau of Mines. (Alternate to Earle P. Shoub.)

**Richard L. Lloyd,** Underwriters' Laboratories, Inc. (Alternate to W. C. Westerberg.)

**James M. McCormick, M. D.,** American Society of Anesthesiologists, Inc. (Alternate to Dr. Ralph M. Tovell and Dr. Wm. H. L. Dornette.)

**Edwin A. Olsen,** Compressed Gas Assn., Inc. (Alternate to Gordon N. Stroppe.)

**Robert G. Pullen,** Indiana Rating Bureau. (Alternate to Kent P. Stiner.)

**Grant O. Shibley,** National Safety Council. (Alternate to Gilbert E. Teal.)

## **Standard for Essential Electrical Systems for Hospitals**

**NFPA No. 76 — 1965**

### **Foreword**

Medical and nursing sciences are becoming progressively more dependent upon electrical apparatus for the preservation of life of hospitalized patients. For example, year by year, more surgeons in more hospitals perform cardiac operations, in some of which the patient's life depends upon artificial circulation of the blood; in other patients, life is sustained by means of electrical impulses that stimulate and regulate heart action; in still others, suction developed by electrical means is routinely relied upon to remove body fluids and mucous that might otherwise cause suffocation. In another sense, lighting is needed in strategic areas in order that precise procedures may be carried out, and power is needed to safeguard such vital services as refrigerated stores held in tissue, bone, and blood banks.

Interruption of normal electrical service to hospitals may be caused by catastrophes such as storms, floods, fires, earthquakes, or explosions; by pyramiding failures of substations transmitting electrical power; or by incidents within the hospital. For all such situations, electrical systems should be planned to limit internal disruption and to provide for continuity of vital services at all times. Outages may be corrected in seconds or may require hours for correction. This implies that the system of protection must be designed to cope with the longest probable outage which experience indicates is infrequently as long as six to eight hours, but in extreme cases may persist for many days.

Selecting vital areas and functions considered to be essential, designing safeguards to assure continuity in these circuits, and maintaining the electrical components of such essential services so that they will work when called on, are complex problems that warrant standardized guidance for regulating agencies, governing boards and administration of hospitals, and architects and engineers concerned with hospital construction. Such guidance is offered in this standard.

## CHAPTER 1. GENERAL

### 11. Purpose

**111.** The purpose of this standard is to delineate minimum factors governing the design, operation, and maintenance of those portions of hospital electrical systems whose interruption in any degree would jeopardize the effective and safe care of hospitalized patients.

### 12. Scope

**121.** This standard applies to hospitals serving patients who are unable to provide for their own safety. It does not apply to nursing homes, convalescent homes, old age homes, and facilities providing care only for ambulatory patients.

**122.** No requirement of this standard shall supersede any specific requirement of NFPA No. 70\* — National Electrical Code — except that this standard limits the type of the alternate source of electrical power allowable for use in systems designed to assure continuity of electric power in hospitals.

**123.** This standard does not cover the requirements for fire pumps. Refer to NFPA No. 20,\* Standard for the Installation of Centrifugal Fire Pumps.

### 13. Mandatory and Advisory Rules

**131.** Mandatory Rules of this Standard are characterized by the use of the word “shall.” Advisory rules are characterized by the use of the word “should”, or are stated as recommendations of that which is advised but not required.

### 14. Systems

**141.** Essential electrical systems for hospitals comprise two systems capable of supplying a limited amount of lighting and power service considered essential for life safety and protection of property during the time the normal electrical service is interrupted for any reason. This service is supplied by two systems: the Emergency Electrical System and the Critical Electrical System.

**142.** The Emergency Electrical System embodies circuits customarily required in hospitals by local codes or regulations to conform with the provision of Article 700 of the National Electrical

---

\*Available from the NFPA Publications Department.

Code (NFPA No. 70) that wiring be run in separate raceways and boxes. This standard specifies those circuits that are mandatory in this classification and prohibits others from being added.

**143.** The Critical Electrical System embodies other essential circuits which should be selected to meet local needs, whose wiring may be run in raceways and boxes with other wiring. The predicted reliability of the normal electrical source should be considered in determining the areas and functions to be served by this system.

## **15. Design Considerations**

**151.** The design of essential electrical systems for hospitals should give consideration to the possible interruption of normal electrical service to hospitals which may be caused by such catastrophes as storms, floods, fires, earthquakes, and similar cataclysms to which the hospital locality may be subject, usually local in nature.

**152.** Electrical design should also take into consideration possible disruption of normal electrical service due to internal wiring and equipment failures within the hospital.

## **16. Reliability of Two Separate Central Station-Fed Services**

**161.** This standard recognizes that hospitals supplied by two separate central station-fed services should experience greater electric service reliability than those with only a single feed. In dual-feed hospitals the areas and functions to be served by the Critical System may with relative safety be reduced. Regardless of the degree of reliability, however, consideration must always be given that other local circumstances, including the need for providing care to disaster victims, may prompt hospital officials to consult with their architects and engineers, utility planning services, and other agencies with respect to the desirability of increasing the hospital functions that are to be served by the Critical System for improved effectiveness of patient care and safety.

**162.** Guidance in determining the reliability of electric service continuity may be obtained from the electric utility service records. When a hospital is to be served by two central station feeders, records over the preceding five-year period should indicate the reliability of the central station services. Records indicating such simultaneous interruptions limited to two hours or less, for any single occurrence, should be considered as an acceptable record.

## **17. Location of Automatic Transfer Equipment and Emergency Prime Mover**

**171.** The physical location of both the automatic transfer equip-

ment and alternate source prime mover is of utmost importance. The integrity of the system will be no better than the integrity of this emergency equipment. Plans for the location of equipment should provide protection against external or internal hazardous conditions that might cause complete failure of the equipment, such as floods and fires.

## **18. Maintenance of Equipment**

**181.** Maintenance of the automatic transfer devices and the prime mover equipment is fundamentally essential to any consideration of service continuity. When hospital authorities place reliance on auxiliary equipment for assuring the continuity of essential electrical systems, it is vital that automatic equipment operate without exception or delay. Such assurance is dependent upon alert and unabated maintenance of this type of equipment. Organized periodic testing under actual conditions with a full understanding as to the proper test procedures, is absolutely essential, both as to operation and to personnel.



## CHAPTER 2. SOURCES OF POWER

### 21. Required Power Sources

**211.** The Essential Electrical Systems, as described in Chapter 3, have a minimum of two independent sources of power: a normal source generally supplying the entire hospital and an alternate source for use when the normal source is interrupted.

**212.** The alternate source of power shall be a generator set driven by some form of prime mover, and located on the hospital premises, except as permitted in 213.

**213.** Where the normal source consists of generating units on the premises the alternate source shall be either another generating set as described in 212, or an external utility service.

**214.** All electrical services shall comply with Article 230 of the National Electrical Code, NFPA No. 70.

**NOTE:** For the greatest assurance of continuity of electrical service it is recommended that, wherever feasible, hospitals should be served by two separate full capacity central station services (Section 700-9, National Electrical Code), connected in such a manner as to pick up the load automatically and so arranged that the load of the Emergency and Critical Electrical Systems will not be transferred to the generator set if either of the central station-fed services is energized. It is recommended that such services be selected and installed with full recognition of local hazards of interruption, such as icing and floods. Battery and trickle charger sets located outside the anesthetizing location may be used as additional provisions for the lighting of operating rooms, for delivery rooms, and stairways, exitways or other emergency incandescent lighting.

## CHAPTER 3. EMERGENCY AND CRITICAL CLASSIFICATIONS

### 31. Emergency Electrical System

#### 311. General:

(a) Those areas and functions in hospitals, which are required to be connected to the Emergency Electrical System, are given in 312. No lighting, receptacles or equipment other than those listed herein, are to be connected to the Emergency Electrical System.

(b) The Emergency Electrical System shall be so installed and connected to the alternate source of power as specified in Chapter 2, that all lighting and equipment specified herein will be automatically restored to operation within 10 seconds after interruption of the normal source.

#### 312. Required Areas and Functions:

(a) Exit ways illumination as required in the Building Exits Code, NFPA No. 101,\* Section 52, such as lighting required for corridors, passageways, stairways and landings at exit doors, and all necessary ways of approach to exits.

(b) Exit signs and exit directional signs required in Building Exits Code, NFPA No. 101,\* Section 53.

(c) Alarm systems, including fire alarms actuated at manual stations, by electric water flow alarm devices in connection with sprinkler systems and by automatic fire detection systems (see Building Exits Code, 2332, 2368 and 4531, alarms required for systems used for the piping of nonflammable medical gases as specified in Standard for Nonflammable Medical Gas Systems, NFPA No. 565,\* and generator unit derangement signals.

(d) Fire alerting systems, including hospital paging systems when these are intended for alerting or issuing instructions during emergency conditions, as described in 2335 of the Building Exits Code, NFPA No. 101.\*

(e) Surgical and obstetrical suite electrical circuits required by the Code for Use of Flammable Anesthetics, NFPA No. 56,\* to be ungrounded circuits fed through isolating transformers.

NOTE: Permanently installed overhead surgical lights and receptacles in anesthetizing locations are required to be supplied by ungrounded electrical circuits. It is not the intention of the above requirement that circuits other than those in the anesthetizing locations will be connected to the Emergency Electrical System, nor is it intended that anesthetizing locations other than those located in the surgical and obstetrical suites will be served from the Emergency Electrical System.

---

\*Available from the NFPA Publications Department.

## CHAPTER 5. ARRANGEMENT OF WIRING

### 51. Automatic Operation

**511.** The Emergency System and Critical System shall be so arranged that in the event of interruption of the normal source, the alternate source shall be automatically placed in operation.

NOTE: Appendix B — Diagrams offer guidance in typical hospital wiring arrangements for both single and double normal source hospitals. These are intended for reference only as an aid in design of essential systems.

**512.** Automatic switching equipment shall be approved for emergency service and shall be designed and installed with interlocking provisions that will prevent the interconnection of normal and alternate sources of power in any operation of the automatic switching equipment. The operation of the equipment shall be so arranged that the load will be served by the normal power source, except when normal source is interrupted. Controls and switching equipment shall be so arranged that interruption of the normal source will automatically start the alternate source generator, and when it has attained rated voltage, automatically disconnect the normal source of power and connect the Emergency and Critical Systems to the alternate source. Certain Critical System loads may be restored manually or by means of time delay switches in such a sequential manner as not to overload the generator. When the normal power source is restored, the switch should operate automatically to disconnect the Emergency and Critical Systems from the alternate source and connect them to the normal source. For such automatic operation, a time delay feature should be provided to avoid short time re-establishment of the normal source causing erratic operation of the transfer switch. (See note following 721 for precautions relative to short time operation of the generator set.)

### 52. Overcurrent Protection

**521.** The emergency electrical system shall be connected to a transfer device supplying no other part of the hospital wiring system. It shall be protected by overcurrent devices in such a manner that interruption of service in other hospital wiring systems due to internal failure will not disrupt service to the Emergency System.

**522.** The Critical Electrical System should be connected to one or more transfer devices supplying no other part of the hospital wiring system. Each subdivision of the Critical System should be protected by overcurrent devices in such a manner that interruption of service in other hospital wiring systems, or other subdivision of the Critical System, due to internal failure will not disrupt its service.

**NOTE:** It is extremely important that the various overcurrent devices in the Emergency and Critical Systems be coordinated to protect against cascading operation on short circuit faults. Primary consideration should also be given to the prevention of overloading wiring devices by limiting the possibilities of large current inrushes due to instantaneous re-establishment of connections to heavy loads.

## **54. Wiring Requirements**

**541.** The Emergency Electrical System wiring shall be kept entirely independent of all other wiring and equipment and shall not enter the same raceways, boxes or cabinets with other wiring, except as permitted in Section 700-17 of the National Electrical Code. Exceptions are (a) transfer switches, and (b) exit lighting fixtures which are supplied from two sources. Section 230-73 of the National Electrical Code also applies to the connection of the Emergency System to the generator.

**542.** The Critical System is not subject to the provisions of Section 700-17, National Electrical Code, and the wiring of these systems may occupy the same raceways, boxes or cabinets with other wiring, except that such wiring may not occupy the same raceways, boxes or cabinets as wiring for Emergency Electrical Systems.

**543.** Provisions of Section 700-18 of the National Electrical Code with respect to switches installed in emergency lighting circuits shall apply to lighting requirements for exit lighting required under the Building Exits Code, except that as provided in Section 700-20(b) of the National Electrical Code, switching arrangements to transfer corridor lighting in patient areas of hospitals from overhead fixtures, to fixtures designed to provide night lighting may be permitted, provided the switching system is so designed that switches can only select between two sets of fixtures and cannot extinguish both sets at the same time.

**544.** Provisions of Section 700-18 of the National Electrical Code with respect to the location and installation of switches in lighting circuits other than those controlling exit way lighting and exit directional signs, shall be applied in the light of the interpretation that personnel ordinarily assigned to work in an area illuminated by fixtures connected to the Emergency Electrical System shall be considered as authorized personnel. (This provision applies particularly to ungrounded circuits in anesthetizing locations connected to Emergency Systems.)

## CHAPTER 6. GENERATOR SETS AND PRIME MOVERS

### 61. Installation

**611.** Generator sets and prime movers installed as a source of power for hospital essential electrical systems shall be specifically designed and reserved exclusively for such service and to operate in conjunction with each other. Generator units, including fuel tanks, exhaust lines and all appurtenant parts, shall be installed in accordance with Standard for the Installation and Use of Combustion Engines and Gas Turbines (NFPA No. 37) except as provided in this chapter. Adequate space shall be provided for housing and servicing the generator unit and associated equipment for its starting and control. Service transformers shall not be installed in this area.

NOTE: For additional guidance see "Engine Installation Manual," Internal Combustion Engine Institute, 201 N. Wells, Chicago, Illinois. For additional material on diesel engines, see "Diesel Engines for Use with Generators to Supply Emergency and Short Term Electric Power", Publication 1132, available from National Academy of Sciences — National Research Council, Washington, D. C.

### 62. Generator Set

**621.** The generator set shall be of sufficient capacity and proper rating to supply adequately circuits of the Emergency and Critical Electrical Systems.

**622.** The generator set capacity for the Emergency Electrical System and Critical System shall be sufficient for picking up the load and supplying the full current demands of these systems, stabilized within plus or minus five per cent frequency stability, within ten seconds after loss of the normal power source. This provision shall be deemed to meet requirements for immediate restoration of service.

### 623. Maintenance of Temperatures:

(a) Diesel engines: Provision shall be made for maintaining a temperature of not less than 50 degrees Fahrenheit in the generator room or for maintaining a water jacket temperature of not less than 70 degrees Fahrenheit.

(b) Gasoline, natural gas and liquefied petroleum gas engines: Provision shall be made for maintaining a temperature of not less than 50 degrees Fahrenheit in the generator room or for maintaining a water jacket temperature of not less than 70 degrees Fahrenheit.

**624.** Provision shall be made for adequate replenishment of air

required for engine combustion and for the cooling of engines cooled by the recirculation of water through engine radiators.

**625.** Battery-starting systems for internal combustion engines shall be provided with a battery providing a minimum of 60 seconds continuous cranking time.

NOTE: Starting equipment should be arranged to provide for a starting cycle of short cranking times, set to terminate with enough battery reserve to permit additional cranking after the cause of the nonfunction has been discovered.

### **63. Safety Devices**

**631.** All prime movers serving generator sets shall be equipped with an automatic engine shutdown device for engine overspeed.

### **64. Derangement Signals**

**641.** Audible and visual signal devices, powered by an electric storage battery (see Section 700-12, National Electrical Code), shall be provided for the following purposes:

(a) To give warning of the derangement of the alternate power source, including excessive water temperature, water jacket temperatures below those required in 623. low lubricating oil pressure and high lubricating oil temperatures;

(b) To indicate that the generator set is carrying the load;

(c) To indicate when the main fuel storage tank contains less than a three-hour operating supply.

**642.** A visual signal device shall be provided when practical to indicate when the battery charger is properly functioning.

**643.** Audible warning signals, except for battery charging malfunction, shall be so arranged that they will operate outside of the generator room in a location readily observed by operating personnel at a regular work station.

NOTE: In the planning of the location of required derangement signals and other indicating instruments of the Emergency System, consideration should be given to locating them in such a way as to permit closed-circuit television monitoring.

## CHAPTER 7. MAINTENANCE

### 71. Maintenance Requirements

**711.** The generator set or other alternate power source and associated equipment including all appurtenant parts, shall be so maintained at all times as to be capable of supplying service within the shortest time practicable and within the time interval specified in 311(b) and 321(b).

### 72. Inspection and Test

**721.** Generator sets serving Emergency and Critical Systems shall be inspected daily and shall be exercised for at least 30 minutes under load conditions at intervals of not more than seven days.

NOTE: When indications such as the issuance of storm warnings indicate that power outages may be likely, good practice recommends the warming up of generator sets by a regular 30-minute exercise period. Operation of generator sets for short intervals should be avoided, particularly with compression ignition engines, since if condensation vapors formed before the engine becomes properly warmed up are not dissipated, they will form varnish in the cylinders and acid in the oil crankcase which are harmful to the engine.

**722.** Automatic transfer switches shall include a test switch, or other device, to allow for frequent testing of the transfer operation under full load conditions, at regularly scheduled intervals — normally not exceeding seven days.

### 73. Battery Maintenance

**731.** Storage batteries used in connection with hospital Emergency and Critical Systems shall be inspected at intervals of not more than seven days and shall be maintained in full compliance with manufacturers' specifications. Defective batteries shall be repaired or replaced immediately upon discovery of defects. (See Section 700-4, National Electrical Code.)

### 74. Written Record

**741.** A written record of inspection, performance, exercising period and repairs shall be regularly maintained and available for inspection by the authority having jurisdiction.

## APPENDIX A — DEFINITIONS

**ALTERNATE POWER SOURCE:** One or more generator sets intended to provide power during the interruption of the normal electrical service or the public utility electrical service intended to provide power during interruption of service normally provided by the generating facilities on the premises.

**AUTOMATIC:** Self-acting, operating by its own mechanism when actuated by some impersonal influence as for example, a change in current strength, pressure, temperature, or mechanical configuration.

**CRITICAL SYSTEM:** A system of feeders and branch circuits connected to alternate power sources by one or more transfer switches and supplying energy to critical hospital functions.

**EMERGENCY ELECTRICAL SYSTEM:** A system of feeders and branch circuits meeting the requirements of Article 700 of the National Electrical Code, connected to alternate power sources by a transfer switch and supplying energy to an extremely limited number of prescribed functions vital to the protection of life and patient safety, with automatic restoration of operation with power interruptions of not more than ten seconds; only circuits serving those areas or functions specifically listed in Article 31 may be connected to this system.

**ESSENTIAL ELECTRICAL SYSTEMS FOR HOSPITALS:** Systems comprised of alternate sources of power, transfer switches, overcurrent protection devices, distribution cabinets, feeders, branch circuits, motor controls, and all connected electrical equipment, designed to assure designated areas and functions of a hospital continuity of electrical service during disruption of normal power sources, and also designed to minimize the interruptive effects of disruption within the internal wiring system.

**IMMEDIATE RESTORATION OF SERVICE:** Automatic restoration of operation with an interruption of not more than ten seconds as applied to those areas and functions served by the Emergency Electrical System, except for areas and functions for which the Building Exits Code, NFPA No. 101, or the National Electrical Code, NFPA No. 70, otherwise make specific provisions.

**INTENSIVE NURSING CARE UNITS.** Groups of beds, rooms, or wards, specifically designated by the hospital to provide intensive nursing care for critically ill patients and intended to be specifically

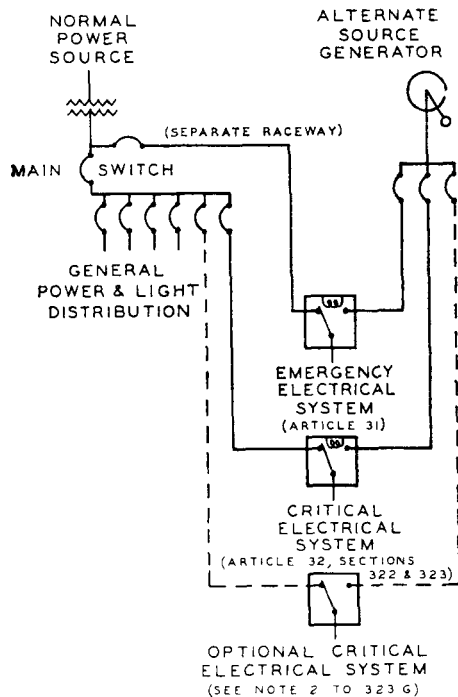
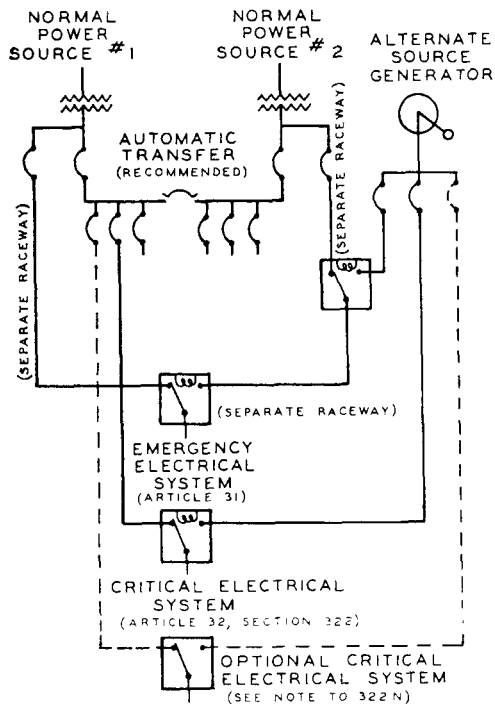


staffed and organized for such service, distinct from a surgical or obstetrical recovery unit forming a part of a surgical or obstetrical suite.

**NURSES STATIONS:** Areas intended to provide a center of nursing activity for a group of nurses working under one nurse supervisor and serving bed patients, where the patient calls are received, nurses are dispatched to the bedside, nurses notes are written, in-patient charts prepared, and medications are prepared for distribution to patients. Where such activities are carried on in more than one location within a nursing unit, all such separate areas are considered a part of the nurses' station.

**PSYCHIATRIC PATIENT BED AREAS:** Areas specifically set aside for active inpatient care of psychiatric patients, excluding bed areas not specifically assigned to psychiatric care and general care unit beds that may occasionally be assigned to psychiatric patients.

References to the National Electrical Code, NFPA No. 70, are to the applicable requirements contained in the 1965 edition. Requirements in this code are intended as minimums.

TYPICAL WIRING ARRANGEMENT  
SINGLE FEED HOSPITALTYPICAL WIRING ARRANGEMENT  
DOUBLE FEED HOSPITAL

Appendix B. Typical Hospital Wiring Arrangements

# National Fire Protection Association

International

60 Batterymarch Street, Boston, Mass. 02110

The National Fire Protection Association was organized in 1896 to promote the science and improve the methods of fire protection. Anyone interested may become an Associate Member; the annual dues are \$20.00. National and regional societies and associations are eligible to be Organization Members, annual dues are \$150. Full membership information is available on request.

This is one of a large number of publications on fire safety issued by the Association. All NFPA codes, standards, and recommended practices are prepared by NFPA Technical Committees and adopted at an Annual Meeting of the Association. They are intended to prescribe reasonable measures for minimizing losses of life and property by fire.

This and other NFPA codes, standards, and recommended practices are published in the **National Fire Codes**, a ten-volume compilation of NFPA's official technical material. Following are the titles of the ten-volume set.

- Vol. 1 Flammable Liquids
- Vol. 2 Gases
- Vol. 3 Combustible Solids, Dusts and Explosives
- Vol. 4 Building Construction and Facilities
- Vol. 5 Electrical
- Vol. 6 Sprinklers, Fire Pumps and Water Tanks
- Vol. 7 Alarms and Special Extinguishing Systems
- Vol. 8 Portable and Manual Fire Control Equipment
- Vol. 9 Occupancy Standards and Process Hazards
- Vol. 10 Transportation

Write the Association for full information.

## Discount Prices on this Pamphlet

The following schedule of discount prices for multiple copies of this pamphlet have been established:

1-5 copies: Single copy price	24- 47: 20%
6-11 copies: 10%	48-100: 25%
12-23 copies: 15%	Over 100: Special Quotation