



UL 580

STANDARD FOR SAFETY

Tests for Uplift Resistance of Roof Assemblies

ULNORM.COM : Click to view the full PDF of UL 580 2019

ULNORM.COM : Click to view the full PDF of UL 580 2019

UL Standard for Safety for Tests for Uplift Resistance of Roof Assemblies, UL 580

Fifth Edition, Dated November 2, 2006

Summary of Topics

This revision of ANSI/UL 580 dated March 29, 2019 is being issued to update the title page to reflect the most recent designation as a Reaffirmed American National Standard (ANS). No technical changes have been made.

Text that has been changed in any manner or impacted by UL's electronic publishing system is marked with a vertical line in the margin.

The requirements are substantially in accordance with Proposal(s) on this subject dated January 4, 2019.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

Users of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgment (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 580 2019

NOVEMBER 2, 2006
(Title Page Reprinted: March 29, 2019)



ANSI/UL 580-2009 (R2019)

1

UL 580

Standard for Tests for Uplift Resistance of Roof Assemblies

The First and Second editions were titled Test for Wind-Uplift Resistance of Roof Assemblies.

First Edition – August, 1973
Second Edition – November, 1980
Third Edition – May, 1988
Fourth Edition – May, 1994

Fifth Edition

November 2, 2006

This ANSI/UL Standard for Safety consists of the Fifth Edition including revisions through March 29, 2019.

The most recent designation of ANSI/UL 580 as a Reaffirmed American National Standard (ANS) occurred on March 29, 2019. ANSI approval for a standard does not include the Cover Page, Transmittal Pages, and Title Page.

Comments or proposals for revisions on any part of the Standard may be submitted to UL at any time. Proposals should be submitted via a Proposal Request in UL's On-Line Collaborative Standards Development System (CSDS) at <https://csds.ul.com>.

UL's Standards for Safety are copyrighted by UL. Neither a printed nor electronic copy of a Standard should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

COPYRIGHT © 2019 UNDERWRITERS LABORATORIES INC.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 580 2019

CONTENTS

INTRODUCTION

1 Scope	4
2 General	4
2.1 Units of measurement	4
2.2 Undated references	4

TEST APPARATUS

3 General	5
4 Pressure Chamber	6
5 Vacuum Chamber	7
6 Test Frame	8
6.1 General	8
6.2 Steel test frame	8
6.3 Wood test frame	8A

TEST METHOD

7 Procedure	8A
-------------------	----

TEST ASSEMBLY

8 Construction Features	9
-------------------------------	---

CLASSIFICATIONS

9 General	10
-----------------	----

INTRODUCTION

1 Scope

1.1 The method of test specified in this standard is intended to determine the uplift resistance of roof assemblies consisting of the roof deck and roof covering materials. It is applicable to any type of roof assembly which is adaptable to the test equipment. Tests to evaluate other potential hazards of roof assemblies are not within the scope of these requirements.

1.2 The purpose of this test is to evaluate the comparative resistance of roof assemblies to positive and negative pressures.

1.3 The test evaluates the roof deck, its attachment to supports, and roof covering materials. It does not evaluate roofs adjacent to chimneys, overhanging eaves, or similar construction, connections of the assembly to main structural supports (girders, columns, or other supports), structural integrity of secondary supports (purlins, joists, bulb tees, or the like), or deterioration of roofing materials.

1.4 Deleted July 9, 2009

2 General

2.1 Units of measurement

2.1.1 If a value for measurement is followed by a value in other units in parentheses, the first stated value is the requirement.

2.2 Undated references

2.2.1 Any undated reference to a code or standard shall be interpreted as referring to the latest edition of that code or standard.


ULNORM.COM : Click to view the full PDF of UL 580 2019

TEST APPARATUS

3 General

3.1 The test apparatus is to consist of three sections which include a top section to create a uniform vacuum, a center section in which the roof assembly is constructed, and a bottom section to create a uniform positive pressure. See Figure 3.1. Each section is to be sealed to maintain the specified pressures.

Figure 3.1
Assembled uplift test apparatus

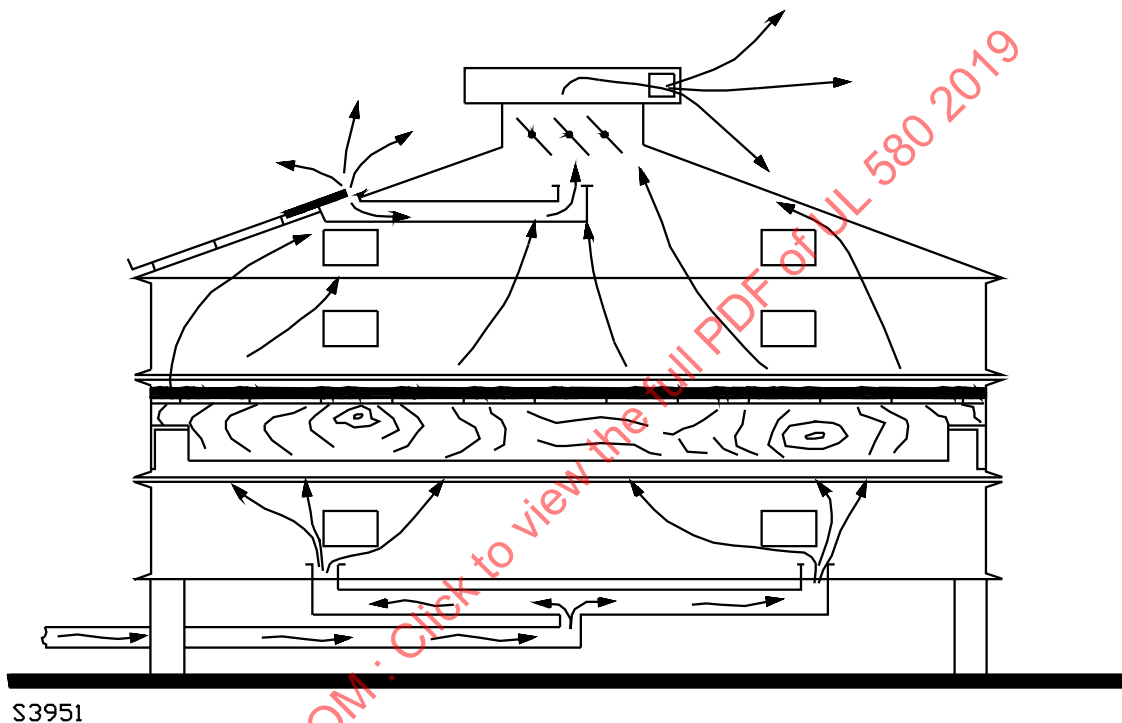

3.2 The inside dimensions of the test apparatus are to be a minimum of 10 by 10 feet (3.05 by 3.05 m).

3.3 The test chamber is to be capable of applying steady positive pressures on the underside of the test assembly and both steady and oscillating negative pressures, as specified, upon the top surface.

3.4 Recording equipment is to be used to make a permanent record of the pressure levels developed in the test as a function of time.

3.5 Sections 4 – 6 contain a specification of the presently used test apparatus. Design modifications shall not be made unless the test results are equivalent to the results obtained from the specified apparatus.

4 Pressure Chamber

4.1 The pressure chamber is to be formed from C12 x 30 channels and is to measure a minimum of 10 by 10 feet (3.05 by 3.05 m) by 9 inches (229 mm) deep. A 4-1/2 inch (114 mm) wide by 1/4 inch (6.4 mm) thick steel plate is to be welded around the top of the chamber.

4.1 revised July 9, 2009

4.2 The floor of the pressure chamber is to be fabricated from 1/8 inch (3.2 mm) thick sheet steel, welded at the seams and supported by five 3- by 7.5-inch (76- by 190-mm) steel shapes. The chamber is to be supported by an MC8 x 20 channel at each side and a W8 x 28 beam at each corner.

4.3 Several windows constructed of break-resistant glazing material are to be installed in the chamber walls to allow observation of the underside of the test assembly.

4.4 Flood lights are to be mounted in the chamber for illumination of the under surface of the test assembly.

4.5 Air is to be admitted into the chamber through a 6- by 6-inch (152- by 152-mm) opening cut into the bottom of the chamber.

4.6 A steel baffle is to be placed over the air inlet opening for even distribution of air pressure. The baffle consists of two vanes with the lower vane measuring 22 by 22 inches (559 by 559 mm) and the upper vane measuring 16 by 16 inches (406 by 406 mm). The vanes are set at an angle of 30 degrees from the horizontal.

4.7 Air is to be provided by a blower attached to a 3 horsepower (2.2 kW output) electric motor that is capable of delivering 862 cubic feet (24.4 m³) of air per minute at a static pressure of 11 inches (2739 Pa) of water.

4.8 The pressure blower starter controls are to be located on the side of the chamber for ease of access and rapid shut down.

4.9 The inlet pressure is to be controlled at the blower by a manually operated steel damper measuring 2 by 18 inches (51 by 457 mm) which is mounted on a sheet steel collar. The chamber pressure is to be controlled by an automatic relief damper measuring 4-3/4 by 11-3/4 inches (121 by 298 mm) located on the bottom of the chamber. The automatic damper is to be controlled by means of an adjustable weight system.

4.10 The air pressure is to be measured at five points by means of 1/4 inch (6.4 mm) outside diameter copper tubing extending from the floor into the chamber at an angle of 45 degrees from the floor. Each of four tubes is to be diagonally located 42 inches (1067 mm) from a corner of the chamber. A fifth tube is to be located 18 inches (457 mm) from the center of the air inlet opening. The end of each tube is to be 7 inches (178 mm) above the chamber floor. The tubes are to be connected through 1/4 inch valves into a manifold that, in turn, is to be connected to a manometer having a range of 0 – 12 inches of water (0 – 2988 Pa), graduated into 0.10 inch (24.9 Pa) increments.

5 Vacuum Chamber

5.1 The vacuum chamber is to be formed from C12 x 30 channels and is to measure a minimum of 10 by 10 feet (3.05 by 3.05 m) by 12 inches (305 mm) high at the base. A 4-1/2 inch (114 mm) wide by 1/4 inch (6.4 mm) thick steel plate is to be welded to the bottom of the channels. A reinforced hood, constructed from 0.105 inch (2.66 mm) thick steel with 2-1/2- by 2-1/2- by 1/2-inch (64- by 64- by 12.7-mm) angles at the corners and 2-1/2- by 2-3/4-inch (64- by 70-mm) tee sections at the center, is to be mounted on the base.

5.1 revised July 9, 2009

5.2 Several windows constructed of break-resistant glazing material are to be installed in the chamber base to allow observation of the upper surface of the test assembly.

5.3 The hood is to have a 30 degree slope from the horizontal at each side and is to have observation windows constructed of break-resistant glazing material in each wall.

5.4 The hood is to be terminated in a 24- by 24-inch (610- by 610-mm) metal platform constructed from 1/8 inch (3.2 mm) thick steel plate. A 7 inch (178 mm) diameter opening is to be cut into the plate for the blower.

5.5 Negative pressure is to be provided by a blower and a 3 horsepower (2.2 kW output) motor which are to be mounted on top of the chamber with their shafts in a vertical position. The combination is to be capable of delivering 862 cubic feet (24.4 m³) of air per minute at a static pressure of 11 inches (2739 Pa) of water.

5.6 The vacuum blower starter controls are to be located on a platform welded to the top of the hood.

5.7 The pressure in the vacuum chamber is to be controlled by an automatic damper measuring 18 by 2-1/4 inches (457 by 57 mm). The damper door is to be moved by means of an air motor hooked to an air line and controlled by pressure switches located in a control console.

5.8 An additional manually controlled sliding damper is to be located on the sloped wall of the chamber. It is to be constructed of 1/8 inch (3.2 mm) thick steel plate and a screw gear which opens or closes the damper by turning. The damper is to measure 6 by 18 inches (152 by 457 mm).

5.9 Sheet metal baffles are to be located on the underside of the damper to prevent direct air flow onto the test assembly.

5.10 The air pressure is to be measured at five points by means of 1/4 inch (6.4 mm) outside diameter copper tubing extending from the floor into the chamber at an angle of 45 degrees from the floor. Each of four tubes is to be diagonally located 18 inches (457 mm) from a corner of the chamber. The ends of these four tubes are to be 8 inches (203 mm) above the chamber floor. The fifth tube is to enter the chamber at a point 12 inches (305 mm) from the center of the exhaust opening, and its end is to be 6 inches (152 mm) below the opening. The tubes are all to be connected through 1/4 inch valves into a manifold that, in turn, is to be connected to a manometer having a range of 0 – 12 inches of water (0 – 2988 Pa) graduated into 0.10 inch (24.9 Pa) increments.

5.11 An additional 1/4 inch (6.4 mm) outside diameter copper tube is to be connected from the manifold to an exterior junction for use of the pressure switches which control the automatic damper.

5.12 Flood lights are to be mounted in the chamber for illumination of the top surface of the test assembly.

5.13 Lifting hooks fabricated from 5/8 inch (15 mm) diameter steel rod are to be welded at each corner of the hood.

6 Test Frame

6.1 revised and relocated as 6.2.1 July 9, 2009

6.2 relocated as 6.2.2 July 9, 2009

6.3 revised and relocated as 6.2.3 July 9, 2009

6.4 relocated as 6.2.4 July 9, 2009

6.1 General

6.1 added July 9, 2009

6.1.1 The test frame is to consist of a wood or steel structure that measures a minimum of 10 by 10 feet (3.05 by 3.05 m).

6.1.1 added July 9, 2009

6.2 Steel test frame

6.2 added July 9, 2009

6.2.1 The steel test frame is to be fabricated from C15 x 33.9 steel channels and measure a minimum of 10 by 10 feet (3.05 by 3.05 m) by 15 inches (381 mm) deep. A 4-1/2 inch (114 mm) wide by 1/4 inch (6.4 mm) thick steel plate is to be welded to the top and bottom of the channels at all four sides.

6.1 revised and relocated as 6.2.1 July 9, 2009

6.2.2 Machine nuts used for attaching assembly supports to the test frame are to be welded to all four sides of the test frame. The nuts are to be located 36 inches (914 mm) on center, beginning 18 inches (457 mm) from the frame center lines. Each line includes six 5/8-inch (15-mm) diameter nuts spaced 2 inches (51 mm) apart.

6.2 relocated as 6.2.2 July 9, 2009

6.2.3 A gasket is to be secured to the top flange of the test frame as well as to the top flange of the pressure chamber to provide an air seal.

6.3 revised and relocated as 6.2.3 July 9, 2009

6.2.4 Lifting hooks fabricated from 5/8 inch (15 mm) diameter steel rods are to be welded to each corner of the test frame.

6.4 relocated as 6.2.4 July 9, 2009

6.3 Wood test frame

6.3 added July 9, 2009

6.3.1 The wood test frame perimeter supports are to be fabricated from a minimum of 2 by 10 (nominal), No. 2 or better, graded structural lumber. The perimeter supports are to consist of at least two layers of the graded structural lumber mechanically joined.

6.3.1 added July 9, 2009

6.3.2 Joist hangers are to be used to support wood joists. When used, structural supports consisting of wood trusses or light gauge structural steel framing members are to be secured to the perimeter supports of the assembly as required by the manufacturer of the structural support.

6.3.2 added July 9, 2009

TEST METHOD

7 Procedure

7.1 The test assembly shall be subjected to positive and negative pressures at the values and time durations specified in Table 7.1. Negative pressure is to be applied to the top surface of the assembly and positive pressure is to be applied to the bottom surface. During Phase 3 of the test, the oscillation frequency is to be 10 ± 2 seconds per cycle.

Table 7.1
Test pressures

Test phase	Time duration, minutes	Negative pressure		Positive pressure	
		Pounds per square foot (kPa)	Inches of water (mm)	Pounds per square foot (kPa)	Inches of water (mm)
			Class 15		
1	5	9.4 (0.45)	1.8 (46)	0.0 (0.00)	0.0 (0)
2	5	9.4 (0.45)	1.8 (46)	5.2 (0.25)	1.0 (25)
3	60	5.7 – 16.2 (0.27 – 0.78)	1.1 – 3.1 (28 – 79)	5.2 (0.25)	1.0 (25)
4	5	14.6 (0.70)	2.8 (71)	0.0 (0.00)	0.0 (0)
5	5	14.6 (0.70)	2.8 (71)	8.3 (0.40)	1.6 (41)
			Class 30		
1	5	16.2 (0.79)	3.1 (79)	0.0 (0.00)	0.0 (0)
2	5	16.2 (0.79)	3.1 (79)	13.8 (0.66)	2.7 (69)
3	60	8.1 – 27.7 ^a (0.39 – 1.33)	1.5 – 5.3 (38 – 135)	13.8 (0.66)	2.7 (69)
4	5	24.2 (1.16)	4.7 (119)	0.0 (0.00)	0.0 (0)
5	5	24.2 (1.16)	4.7 (119)	20.8 (1.00)	4.0 (102)
			Class 60		
1	5	32.3 (1.55)	6.2 (157)	0.0 (0.00)	0.0 (0)
2	5	32.3 (1.55)	6.2 (157)	27.7 (1.33)	5.3 (135)

Table 7.1 Continued on Next Page